



REGISTRATION TECHNICAL DATA GUIDE

Version 4.2

Deleted: 1

May 2024

Deleted: July 2023

Important notice

PURPOSE

AEMO has prepared this document to provide information about the formats for registration data required by AEMO in the Wholesale Electricity Market Systems (WEMS) in accordance with the WEM Rules, as at the date of publication.

DISCLAIMER

This document or the information in it may be subsequently updated or amended. This document does not constitute legal or business advice and should not be relied on as a substitute for obtaining detailed advice about the Electricity Industry Act 2004, the Wholesale Electricity Market (WEM) Rules, or any other applicable laws, procedures or policies. AEMO has made every effort to ensure the quality of the information in this document but cannot guarantee its accuracy or completeness.

Accordingly, to the maximum extent permitted by law, AEMO and its officers, employees and consultants involved in the preparation of this document:

- make no representation or warranty, express or implied, as to the currency, accuracy, reliability or completeness of the information in this document; and
- are not liable (whether by reason of negligence or otherwise) for any statements or representations in this document, or any omissions from it, or for any use or reliance on the information in it.

VERSION CONTROL

Version	Release date	Changes
3.90	28/01/2021	Updated WEM Rule references related to NSG maximum sent-out generation.
4.00	03/05/2023	Updated to meet new Taxonomy and registration data requirements under new Amending Rules that have been made by the Minister for Energy to give effect to the Energy Transformation Strategy.
4.1	18/07/2023	Updated to amend manifest errors and provide clarity on specific data fields.
4.2	6/05/2024	<u>Updated descriptions to clarify elapsed times and synchronisation times for hot, warm and cold. Additional appendix 8.1 and 8.2 with worked examples of elapsed times and synchronisation times for restart.</u> <u>Updated descriptions to clarify the following Facility capacity related terms of: maximum sent out capacity of the Facility under optimal conditions, maximum Withdrawal capacity of the Facility under optimal conditions, dependence of sent out capacity on temperature at the location of the Facility, overload Injection capacity of the Facility, overload Withdrawal capacity of the Facility, minimum stable loading level, minimum dispatchable loading level, and dependence of sent out capacity on temperature at the location.</u> <u>Minor updates to other data fields to provide clarity on specific data fields.</u>

Formatted Table

Deleted: sent out

Deleted: 1

Deleted: ,

Deleted: 2023

Contents

1. Overview	4
1.1 Purpose	4
1.2 Application	4
1.3 Associated Market Procedures and Market Documents	4
1.4 Further Information	5
2. Participant Registration	6
2.1 Participant Information – General Information	6
2.2 Participant Information – Financial Information	7
2.3 Market Participant Standing Data	9
3. Facility Registration	10
3.1 Facility General Information	10
4. Standing Data	14
4.1 All Facilities – fields common to all Standing Data forms	14
4.2 Network	14
4.3 Scheduled Facility	15
4.4 Non-Scheduled Facility	31
4.5 Semi-Scheduled Facility	40
4.6 Non-Dispatchable Load	54
4.7 Interruptible Load	59
4.8 Demand Side Programme	63
5. Reserve Capacity	66
5.1 Reserve Capacity Status	66
5.2 Current Effective and Future Approved Facility Reserve Capacity Temperature Information	66
5.3 Facility Reserve Capacity Temperature Information	67
6. Facility Technology Type	68
6.1 Scheduled Facility	68
6.2 Semi-Scheduled Facility	69
6.3 Non-Scheduled Facility	71
7. Separately Certified Component	72
7.1 Scheduled Facility	72
7.2 Semi-Scheduled Facility	75
8. Appendices	78

- Deleted: 404039
- Deleted: 545453
- Deleted: 595958
- Deleted: 636362
- Deleted: ~~666665~~
- Deleted: 666665
- Deleted: 666665
- Deleted: 676766
- Deleted: ~~686867~~
- Deleted: 686867
- Deleted: 696968
- Deleted: 717170
- Deleted: ~~727271~~
- Deleted: 727271
- Deleted: 757574
- Deleted: ~~787877~~
- Deleted: 2023

8.1	Appendix 1 - Start-Up Times	79
8.2	Appendix 1 - Start-Up Times Examples of Scenario 1 to 6	80
8.3	Appendix 2 - Minimum Physical Responses Time to a Dispatch Instruction	81

1. Overview

1.1 Purpose

- 1.1.1 This document is the WEM Registration Technical Guide. It specifies the [online](#) application forms ([WEMS change requests](#)) and field requirements that are to be submitted to AEMO for the purposes of section 2 and Appendix 1 of [the WEM Rules](#) which come into operation at a time specified by the Minister in a notice published in the Gazette.
- 1.1.2 This technical guide outlines [data](#) required to be provided to AEMO for a Rule Participant or Facility in relation to the Post-Amended Rules and the form and manner in which the Standing Data referred to in clause 1.54A.2(a) [of the WEM Rules](#) is to be provided to AEMO.
- 1.1.3 This technical guide supports the completion of the application forms outlined in the following WEM Procedures: [Rule Participant Registration Processes](#) and [Facility Registration Processes](#).
- 1.1.4 Each of the tables below in this document corresponds with [Participant Registration and Facility Registration application forms which are to be submitted online in WEMS](#) and outlines the data fields and specification requirements.

1.2 Application

- 1.2.1 This document applies to AEMO and Rule Participants who are required to submit Participant Registration or Facility Registration application forms.
- 1.2.2 All references to rules and procedures relate to the Wholesale Electricity Market (WEM).

1.3 Associated Market Procedures and Market Documents

- 1.3.1 The following AEMO WEM Documents are associated with this technical guide:
 - Participant Registration Processes WEM Procedure ([link under Market operations market procedure section](#))
 - Facility Registration Processes WEM Procedure ([link under Market operations market procedure section](#))
 - [WEMS MPI User Guide: Registration](#) ([link under user guide section](#))

Deleted: 797978

Deleted: 808079

Deleted: 818180

Deleted: 1. Overview 41

- 1.1 Purpose 41
- 1.2 Application 41
- 1.3 Associated Market Procedures and Market Documents 41
- 1.4 Further Information 51

2. Participant Registration 61

- 2.1 Participant Information – General Information 61
- 2.2 Participant Information – Financial Information 71
- 2.3 Market Participant Standing Data 91

3. Facility Registration 101

- 3.1 Facility General Information 101

4. Standing Data 141

- 4.1 All Facilities – fields common to all Standing Data forms 141
- 4.2 Network 141
- 4.3 Scheduled Facility 151
- 4.4 Non-Scheduled Facility 301
- 4.5 Semi-Scheduled Facility 391
- 4.6 Non-Dispatchable Load 521
- 4.7 Interruptible Load 561
- 4.8 Demand Side Programme 611

5. Reserve Capacity 641

- 5.1 Reserve Capacity Status 641
- 5.2 Current Effective and Future Approved Facility Reserve Capacity Temperature Information 641
- 5.3 Facility Reserve Capacity Temperature Information 651

6. Facility Technology Type 661

- 6.1 Scheduled Facility 661
- 6.2 Semi-Scheduled Facility 671
- 6.3 Non-Scheduled Facility 691

7. Separately Certified Component 701

- 7.1 Scheduled Facility 701
- 7.2 Semi-Scheduled Facility 731

8. Appendices 761

- 8.1 Appendix 1 - Start-Up Times 771
- 8.2 Appendix 1 - Start-Up Times Examples of Scenario 1 to 6 781

Deleted: Standing Data

Deleted:

Deleted: Transitional Registration Processes,

Deleted: ,

Deleted: WEMS

Deleted: applications

Deleted: Transitional Registration Processes, WEM MPI User AEMO - Registration User Guide

Deleted: 2023

[Excel applications forms for provisional approval \(link\)](#)
[Facility Standing Data Templates \(link\)](#)

Deleted: Excel Application Forms for Facility General Information, Facility Standing Data, Facility Technology Types, Separately Certified Components.

1.4 Further Information

1.4.1 Please contact [the WA Energy Market Management \(WA EMM\) team](#) for further information regarding the [fields](#) contained in this document.

Deleted: Operations and Support

Deleted: (WA)

Deleted: materials

Contact	Telephone	Email
WA Energy Market Management (WA EMM) team contact number during office hours, after hours, weekends, and public holidays.	1300 989 797 (option 1)	wa.operations@aemo.com.au

Deleted: Operations and Support. Contact

Deleted: and

Deleted: 2023

2. Participant Registration

2.1 Participant Information – General Information

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Short Name	Legal entity's WEM participant short name as set by AEMO during the participant registration application.	Pre-populated	Text	N/A	2.33.1 (c) Deleted: Person's/Organisation's
Organisation Name	The legal name of the entity (business) for this Participant. This should be the same legal name that appears in the Australian Business Number register, with the exception where the legal entity is the trustee for a trust and the trustee's name must be specified in full.	Text Box	Text	N/A	2.33.1 (c) Deleted: Legal Deleted: /organisation
Authorised Person	The Authorised Person is a person within the legal entity who has signing authority for agreements and contracts and should match the Authorised Person as stated in the WEMS Market Participant Interface (WEMS MPI). For a corporation, this should be a person that meets the definition of an "officer" under the Corporations Act.	Text Box	Text	N/A	2.33.1 (c) Deleted: your Deleted: /organisation Deleted: .
Other Participant Types	If applicable, select the applicable Participant type: -Meter Data Agent -Non-Trading Participant -Regulator	Non-mandatory. Select Box	Tick Box	N/A	2.33.1 (b)
Australian Business Number	Legal entity's business number identifier is registered with the Australian Tax Office and other government agencies.	Text Box	Numeric	N/A	2.33.1 (d) Deleted: Entity/organisation's
Mailing Address	Address where all physical correspondence from AEMO to the participant will be sent.	Text Box	Text/ Numeric	N/A	2.33.1 (d)
City/Town	City or Town where the legal entity (business) resides.	Text Box	Text	N/A	2.33.1 (d) Deleted: /organisation Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
State	State where the <u>legal entity (business)</u> resides.	Drop down list	Only one option may be selected	N/A	2.33.1 (d) Deleted: /organisation
Postal Code	<u>Postcode</u> for the <u>legal entity (business)</u> address.	Text Box	Numeric	N/A	2.33.1 (d) Deleted: Post code
Country	Country where the <u>legal entity (business)</u> resides.	Drop down list	Only one option may be selected	N/A	2.33.1 (j) Deleted: /organisation's Deleted: /organisation
Phone	Phone number of <u>the legal entity (business)</u> .	Text Box	Numeric	N/A	2.33.1 (c) Deleted: /organisation.
Fax	Fax number of <u>the legal entity (business)</u> .	Text Box	Numeric	N/A	2.33.1 (c) Deleted: /organisation.
Email	Email address of authorised person.	Text Box	Text/ Numeric	N/A	2.33.1 (c)
Website	Website address of <u>the legal entity (business)</u> .	Text Box	Text/ Numeric	N/A	2.33.1 (c) Deleted: /organisation.
Main Contact User	The <u>Main Contact is the person within your legal entity (business) for which all correspondence will be sent to from AEMO (including market advisories and WEMS notifications) and should match the Main Contact stated in the WEMS MPL.</u>	Drop down list	Only one option may be selected	N/A	2.33.1 (c) Deleted: /organisation who AEMO will send WEMS related... Deleted: user digital certificates

2.2 Participant Information – Financial Information

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Bank Name	Name of <u>the legal entity's (business)</u> bank.	Text Box	Text	N/A	2.33.1(m) Deleted: entity/organisation's
Branch Name	Branch name of <u>the legal entity's</u> bank.	Text Box	Text	N/A	2.33.1(m) Deleted: entity/organisation's
Branch Description	Description of <u>the legal entity's</u> bank branch.	Text Box	Text	N/A	2.33.1(m) Deleted: entity/organisation's
BSB No	<u>The legal entity's six-digit</u> number as part of their bank account number that indicates the bank and the branch where the account is held.	Text Box	Numeric	N/A	2.33.1(m) Deleted: Entity/organisation's
Branch Address	<u>The legal entity's</u> bank branch address.	Text Box	Text/ Numeric	N/A	2.33.1(m) Deleted: Entity/organisation's Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement	
City/Town	City/ Town of the <u>legal entity's</u> bank branch.	Text Box	Text	N/A	2.33.1(m)	Deleted: entity/organisation's
State	State that the <u>legal entity's</u> bank branch resides.	Drop down list	Only one option may be selected	N/A	2.33.1(m)	Deleted: entity/organisation's
Postal Code	Postal Code of <u>the legal entity's</u> bank branch.	Text Box	Numeric	N/A	2.33.1(m)	Deleted: entity/organisation's
Country	Country the <u>legal entity's</u> bank branch resides.	Drop down list	Only one option may be selected	N/A	2.33.1(m)	Deleted: entity/organisation's
Phone	Phone number of <u>the legal entity's</u> bank branch.	Text Box	Numeric	N/A	2.33.1(m)	Deleted: entity/organisation's
Fax	Fax number of <u>the legal entity's</u> bank branch.	Text Box	Numeric	N/A	2.33.1(m)	Deleted: entity/organisation's
Austraclear Id	<p><u>The legal entity's</u> Austraclear identification number assigned by Austraclear, which allows AEMO to settle funds in <u>real time</u>.</p> <p>This is required prior to the first invoice <u>being</u> settled and at least five business days prior to the date from which a participant intends to participate in the WEM. (i.e. commence trading, consuming or generating in the WEM).</p> <p>Further information on Austraclear and settlement in the WEM is on the following webpage (link here).</p> <p>To apply for an Austraclear account you must apply via <u>the</u> Austraclear website (link here). <u>Please apply for Austraclear account at least 2 months prior to participant participating in the WEM. (i.e. commence trading, consuming or generating in the WEM which will result in an invoice being issued).</u></p>	Text Box	Text/ Numeric	N/A	2.33.1(f)	Deleted: Entity/organisation's Deleted: real-time Deleted: be
Account No	<u>The legal entity's</u> bank account number.	Text Box	Numeric	N/A	2.33.1(m)	Deleted: Entity/organisation's
Account Name	<u>The legal entity's</u> bank account name.	Text Box	Text	N/A	2.33.1(m)	Deleted: Entity/organisation's Deleted:

Deleted: 2023

2.3 Market Participant Standing Data

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
For each Market Participant, the maximum Loss Factor adjusted quantity of energy, in units of MWh, that could be consumed during a Trading Interval by the Market Participant's Registered Facilities and Non-Dispatchable Loads [Appendix 1(a)]	<p><u>This value is used to set a Market Participant's Portfolio Demand Curve as referenced in Appendix 6 of the WEM Rules, and. It is the maximum cumulative quantity that a Market Participant is prepared to buy from the Short Term Energy Market (STEM) from all of its Price-Quantity Pairs in its Portfolio Demand Curve, as referenced in Appendix 6(a)iii.</u></p> <p><u>AEMO advises that changes to this value will affect the Market Participant's single STEM Price Curve and the values that are converted into STEM Bids and STEM Offers relative to its Net Bilateral Position, as outlined under Appendix 6.</u></p> <p><u>Please note that prior to changing this value that the Market Participant should consider testing their STEM submissions relative to this standing data value in a test environment to better under the STEM Bids and STEM Offers process.</u></p> <p><u>It should also be noted:</u></p> <ul style="list-style-type: none"> <u>If you were previously registered as a Market Generator only in the Balancing Market, then no MWh was attributed and for the purposes of the new Market, a value of zero MWh can submitted to effect the same outcome.</u> <u>This value is shown as "Max Demand Capability (MWh)" as shown in the WEMS MPI Report "EM PartLimit"</u> <u>This field is not applicable to the Network Operator Class and Non-Rule Participants.</u> <u>This value should not be higher than the aggregate Contract Maximum Demand for all the Market Participant's loads.</u> <u>If the Market Participant does not have any applicable Contract Maximum Demand, then a value of zero is acceptable if the consumption is negligible or if consumption is not negligible an estimate of the aggregated maximum consumption (MWh) of their loads will be sufficient.</u> 	Text Box	Numeric	MWh	Appendix 1(a)

Deleted: can bid to

Deleted: This value should not be higher than the aggregate Contract Maximum Demand for all the Market Participant's loads. ¹
 If the Market Participant does not have any applicable Contract Maximum Demand for their loads, then an estimate of the aggregated maximum consumption (MWh) of their loads is....

Deleted: 1

Deleted: 2023

3. Facility Registration

3.1 Facility General Information

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
General Facility Information					
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i.
Facility Owner	The WEMS Participant Code has a maximum of 9 characters and is set by AEMO during Participant Registration. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)ii.
Facility Class	Facility Class applicable as set out in clause 2.29 of the WEM Rules. This field is set by AEMO during the creation of the candidate facility. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)iv.
Facility Street Address	Street address where the facility is located.	Text Box	Text/ Numeric	N/A	2.33.3(c)v.
City/Town	City or Town where the Facility is located.	Text Box	Text	N/A	2.33.3(c)v.
State	State where the Facility is located.	Drop down list	Only one option may be selected	N/A	2.33.3(c)v.
Postal Code	Postal Code for the Facility's street address	Text Box	Numeric	N/A	2.33.3(c)v.
Country	Country where the Facility is located.	Drop down list	Only one option may be selected	N/A	2.33.3(c)v.
Associated Intermittent Load	Specifies the Intermittent Load that is associated with the Generation System (where applicable). This field is set by participants through the Facility General Information Change Request. <u>This field only applies to Scheduled Facilities, Semi-Scheduled Facilities and Non-Scheduled Facilities, and only one load in the drop-down menu may be associated.</u>	Drop down list	Only one option may be selected	N/A	2.30B.5(b)

Deleted: which

Deleted: c

Deleted: Applicable

Deleted: Applies to Scheduled and Non-Scheduled Generators only. Can only be associated with one load.

Deleted: drop down

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<u>If your Facility is a Non-Dispatchable Load (with or without an intermittent Load), Demand Side Programme or Interruptible Load then this field is not applicable and should be left blank.</u>				
Registration Sub-Type	<p>This field is <u>only applicable to Scheduled Facility, Semi-Scheduled Facility or Non-Scheduled Facility and used to specify the sub-type of the associated Intermittent Load (if applicable).</u></p> <p>Specifies the sub-type of Intermittent Load:</p> <ul style="list-style-type: none"> • EG • MIL • REG • SIL <p>The default value is "EG" for all <u>Registered Facilities in class of Scheduled Facility, Semi-Scheduled Facility or Non-Scheduled Facility</u>, that have an Associated Intermittent Load.</p>	Drop down list	Only one option may be selected	N/A	System Requirement
Remote Flag	<p>Denotes if the Scheduled Facility, Semi-Scheduled Facility or Non-Scheduled Facility is located at another connection point that differs from the associated Intermittent Load.</p> <p><u>If your Facility is a Non-Dispatchable Load (with or without an intermittent Load), Demand Side Programme or Interruptible Load then this field is not applicable.</u></p> <p><u>Please note since 1 Oct 2023, the WEM Rules no longer permit a generator to be located at another connection point that differs from the associated Intermittent Load.</u></p>	Tick Box	<p>Yes or No</p> <p><u>This must be "No" since the WEM Rules no longer permit a generator to be located at another connection point that differs from the associated Intermittent Load.</u></p>	N/A	2.30B.2(d)
NMI	<p>Denotes the national meter identifiers (NMIs) for the Associated Intermittent Load. This field is pre-populated.</p> <p><u>If your Facility is a Non-Dispatchable Load (with or without an intermittent Load), Demand Side Programme or Interruptible Load this field is not applicable.</u></p>	Pre-populated	Numerical	N/A	Appendix 1(g)i.
Facility Contact Information					
Site Contact Phone (Primary)	Contact number for the site control room or person that is responsible for physical plant operations. The control room or the responsible person must be	Pre-populated	Text	N/A	2.33.3(c)xii.

Deleted: If

Deleted: used to associate a

Deleted: to a registered

Deleted: d.

Deleted: . Sub-type includes

Deleted: , where the sub-type is MIL

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	contactable <u>24 hours and 7 days (24/7) a week</u> . It is the Applicant's responsibility to ensure that incoming calls will be responded to at all times.				Deleted: /
Site Contact Phone (Backup)	<u>The backup</u> number for the site control room or person that is responsible for physical plant operations. The control room or the responsible person must be contactable 24/7. It is the Applicant's responsibility to ensure that incoming calls will be responded to at all times.	Pre-populated	Text	N/A	2.33.3(c)xii. Deleted: Backup
Site Email Address (Primary)	Primary email for the site control room or person that is responsible for physical plant operations.	Pre-populated	Text	N/A	2.33.3(c)xii.
Site Email Address (Backup)	Backup email for the site control room or person <u>who is</u> responsible for physical plant operations.	Pre-populated	Text	N/A	2.33.3(c)xii. Deleted: that
Other Facility Registration Information					
Evidence of Arrangement for Access	A copy of the contract with <u>the</u> Network Operator to gain access to the network. Given <u>the meaning of "Arrangement for Access"</u> in the glossary of the WEM Rules.	File Upload	Word or PDF document	N/A	2.33.3(c)xiv.
Details of the operational control over the Facility	Evidence that the communication and control systems required by clause 2.35 of the WEM Rules are in place and operational, including information on the communication systems. A countersigned "Communication Protocol" document is required and <u>a</u> template for completion must be requested by emailing wa.operations@aemo.com.au N.b. AEMO will include unique Facility specific dial in numbers to the AEMO's control room in the template for each Facility's Communication Protocol. N.b. If your Facility is a Non-Dispatchable Load (with or without an Intermittent Load) or Network Facility then this field is not applicable.	File Upload	<u>PDF document</u>	N/A	2.33.3(c)xv. Deleted: A word Deleted: or pdf.
Commencement Information					
Proposed Current Date of Commencement of Commissioning of the Facility	The Participant's declaration of the proposed start date of commissioning for the facility. Submitted to AEMO in accordance with clause 3.21A of the WEM Rules. <u>If your Facility has previously been commissioned, then this field is not applicable.</u> <u>If your Facility is a Non-Dispatchable Load (with or without an Intermittent Load) or Network Facility then this field is not applicable.</u>	Text Box	Numeric or select date from calendar ratio pop-up. <u>If you do not have proposed date of commencement of commissioning, then you may leave this field blank.</u>	N/A	2.33.3(c)xiii.1 Deleted: n Deleted: n Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Current Commissioning Test Plan	<p>The latest uploaded Commissioning Test Plan (CTP) of the facility. Submitted to AEMO in accordance with clause 3.21A of the WEM Rules. The CTP should complement the approved GPS Test Procedure and encapsulate as much of the commissioning schedule as practical.</p> <p><u>If your Facility has previously been commissioned, then this field is not applicable.</u></p> <p><u>If your Facility is a Non-Dispatchable Load (with or without an intermittent Load) or Network Facility then this field is not applicable.</u></p> <p><u>If you do not have a Commissioning Test Plan, then you may leave this field blank.</u></p>	File Upload	<p>PDF document</p> <p><u>If you do not have a Commissioning Test Plan, then you may leave this field blank.</u></p>	N/A	2.33.3(c)xiii.2

Deleted: n

Deleted: 2023

4. Standing Data

4.1 All Facilities – fields common to all Standing Data forms

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Standing Data Change Supporting Evidence Comment	Participants can provide a comment on the reason for the Standing Data change(s) as per clause 2.34.3(b) of the WEM Rules.	Text Box	Text/ Numeric	N/A	2.34.3(b)
Further support documentation	Optional field, that a Participant may use to provide any supporting documentation for their Standing Data application.	File Upload	A Word document or pdf.	N/A	System Requirement

Deleted: Participant

Deleted: word

4.2 Network

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Facility Name	Name of Facility. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i
RoCoF Ride-Through Capability of the Facility as determined by AEMO [Appendix 1(i).]	<p>The Rate of Change of Frequency (RoCoF) Ride-Through Capability of the Facility, expressed in Hz per 500ms, as determined by AEMO under clause 2.34A.12C of the WEM Rules.</p> <p>If AEMO has not made a separate determination under paragraph 11.2.6 of the FCESS Accreditation WEM Procedure (link here) then the value of 0.25 Hz over 500ms (RoCoF Safe Limit) must be submitted.</p> <p>Published RoCoF Ride-Through Capability values which had have separate determinations are also available in the link (here) under the sheet "Current RoCoF Ride-Through Values"</p>	Text Box	<p>Numeric</p> <p>Value must be positive</p> <p>If you intend to apply for a separate determination for RoCoF Ride-Through Capability then information on the process is available here.</p> <p>Facilities with a RoCoF Ride-Through capability value above the RoCoF Ride-Through Cost Recovery Limit, will not be deemed causers of the RoCoF Control Service and will be excluded from recovery of the costs of the control service.</p>	Hz over 500ms	Appendix 1(i)

Deleted: ¶

Deleted: ¶

Deleted: MWs

Deleted: (MWs)

Deleted: 2023

Deleted:Page Break.....

4.3 Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i
The total nameplate capacity of the Facility's Energy Producing System, expressed in MW [Appendix 1(b)i.]	Name plate capacity of facility, as per the output subject to ratings of any primary plant or equipment. For synchronous generators this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters. Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves.	Text Box	Numeric	MW	Appendix 1(b)i.
The System Size [Appendix 1(b)iii.]	The MW value in accordance with the glossary definition in WEM Rules for System Size.	Text Box	Numeric	MW	Appendix 1(b)iii.
Is the Facility a Small Aggregation [Appendix 1(b)iv.]	Denotes whether the Facility meets the glossary definition in the WEM Rules for Small Aggregation.	Tick Box	Ticked = Yes, Unticked = No		Appendix 1(b)iv.
The maximum sent out capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(b)v.]	<u>This is the maximum sent-out capacity at optimal operating conditions for the Facility.</u> <u>This represents the maximum physical capacity available for Injection to AEMO under normal operating conditions for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s).</u>	Text Box	Numeric	MW	Appendix 1(b)v.
The maximum Withdrawal capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(b)vi.]	Maximum capacity withdrawn from the SWIS at the connection point, including any downstream loads such as intermittent or parasitic/auxiliary loads. <u>Where maximum Withdrawal capacity is at optimal conditions from withdrawing from the network.</u>	Text Box	Numeric	MW	Appendix 1(b)vi.

Deleted: Maximum

Deleted: (for Non-Synergy facilities) or generated capacity (for Synergy facilities where relevant) when operating ...

Deleted: .

Deleted: Capacity withdrawn

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The dependence of sent out capacity on temperature at the location of the Facility [Appendix 1(b)vii.]	<p><u>Sent out</u> capacity as a function of temperature at the location of the facility.</p> <p><u>Please note the temperature dependence data must be provided to at least the maximum sent out capacity of the Facility under optimal conditions.</u></p> <p>A separate relationship for each fuel type is required expressed in terms of generated MW.</p> <p>Maximum <u>sent out capacity (MW)</u> details for each 0.1°C interval from 0°C to 45°C, or higher if specified by the Network Operator based on physical location.</p>	File Upload	<p>File format to be .csv with the following fields on each line:</p> <ul style="list-style-type: none"> • facility_identity (character 24), • fuel_type (character 1) – L N, followed by the following data pairs for each temperature breakpoint: • temperature (real 3:1), • facility_capability (real 6:3) <p>Note that the first row must be a header row, containing the names of the four columns respectively; facility_identity, fuel_type, temperature, facility_capability.</p> <p><u>File template can be found on the following link (here).</u></p>	MW and °C	Appendix 1(b)vii. Rated (installed) generation 1 The last pair terminated by a carriage return.
The method to be used for determining the ambient temperature at the site of the Facility (where if no method is specified, a constant temperature of 41 degrees Celsius will be assumed) [Appendix 1(b)viii.]	<p>One of the following methods must be chosen:</p> <ul style="list-style-type: none"> • 41°C • SCADA • BOM <p><u>If your Facility is not temperature dependent or comprised of Intermittent Generation Systems only, then a value of 41°C should be submitted.</u></p>	Drop Down	Can only select one option	N/A	Appendix 1(b)viii. <#>41 degrees
Temperature Location	Location of BOM or SCADA temperature station.	Drop Down	<p>Can only select one option.</p> <p>For SCADA one of the following:</p> <ul style="list-style-type: none"> • CKB AMBIENT C • KMP AMBIENT C • MGA AMBIENT C • PJR AMBIENT C <p>For BOM one of the following: Albany Airport, Badgingarra, Bickley, Bunbury, Collie East, Dwellingup, Garden Island HSF, Geraldton Airport 8351, Hopetoun</p>	N/A	Appendix 1(b)viii. option s

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
			North, Jandakot Aero, Kalgoorlie- Boulder Airport, Mandurah, Pearce RAAF, Perth Airport, Perth Metro, Rottneest Island, Southern Cross Airfield, Swanbourne. <u>If an appropriate BOM station is not on the list above please contact wa.operations@aemo.com.au to discuss if another option exists.</u>		
Details of any potential energy limits of the Facility [Appendix 1(b)xvi.]	Details of any potential energy limits of the facility. <u>This field is only applicable if AEMO requests specific information from the Rule Participant in relation to permanent operational limits that has not been captured in other registration data fields. This information is used by AEMO to develop rules for scheduling plant in case of an emergency or non-standard scenario. (e.g. if the plant has an ancillary load at a different connection point to the main generation equipment, and outages at different substations can impact facility output levels).</u>	File Upload	<u>Word or Pdf document</u>	N/A	Appendix
Is the Facility a Fast Start Facility [Appendix 1(b)xvii.]	Denotes whether the Facility meets the definition of a Fast Start Facility under the WEM Rules Glossary.	Tick Box	Ticked = Yes, Unticked = No	N/A	Appendix
Minimum Synchronisation Time (Cold) [Appendix 1(b)xviii.1.]	Cold synchronisation time. The minimum time to synchronise <u>(if applicable for the Facility)</u> and be available for dispatch <u>when the Facility is in a "cold" state. "Cold" state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Cold) has subsequently passed.</u> <u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 5 and 6.</u> <u>If this field is not applicable, please leave field as zero.</u>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix

Deleted: Karlgoolie

Deleted:

Deleted: Word or Pdf document
Description to indicate where energy limits occur and how it impacts the scheduling of the plant in the case AEMO directs the Facility under an emergency or a non-standard scenario...Description to indicate where energy limits occur because of fuel or other constraints which AEMO would not know about otherwise. AEMO may want to work with the Participant in determining a suitable method of incorporating this into SMMITS or WEMS...

Deleted: These are

Deleted:

Deleted: This may be user specific and broad ranging given experience in Reserve Capacity certification. Ideally Database Value so that AEMO can develop rules for scheduling plant.

Deleted: this

Deleted: , as

Deleted:).

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Elapsed Synchronisation Time (Cold) [Appendix 1(b)xviii.1.]	<p>Number of minutes elapsed for Cold Sync time.</p> <p>This is the time relative to the Facility shutdown, after which the Facility will be considered in the “cold” state for synchronisation purposes.</p> <p>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 5 and 6.</p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xviii.1.
Minimum Synchronisation Time (Warm) [Appendix 1(b)xviii.2.]	<p>Warm synchronisation time. The minimum time to synchronise (if applicable for the Facility) and be available for dispatch when the Facility is in a “warm” state, “Warm” state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Warm) has subsequently passed.</p> <p>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 3 and 4.</p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xviii.2.
Elapsed Synchronisation Time (Warm) [Appendix 1(b)xviii.2.]	<p>Number of minutes elapsed for Warm Sync time.</p> <p>This is the time related to the Facility shutdown, after which the Facility will be considered in the “warm” state for synchronisation purposes, until it transitions to the “cold” state.</p> <p>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 3 and 4.</p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xviii.2.
Minimum Synchronisation Time (Hot) [Appendix 1(b)xviii.3.]	<p>Hot synchronisation time. The minimum time to synchronise (if applicable for the Facility) and be available for dispatch when the Facility is in a “hot” state, “Hot” state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Hot) has subsequently passed.</p> <p>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 1 and 2.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xviii.3.

Deleted: this

Deleted: , as

Deleted:).

Deleted: relative

Deleted: this

Deleted: , as

Deleted:).

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<u>If this field is not applicable, please leave field as zero.</u>				
Elapsed Synchronisation Time (Hot) [Appendix 1(b)xviii.3.]	<p>Number of minutes elapsed for Hot Sync time.</p> <p>This is the time <u>related</u> to the Facility shutdown, after which the Facility will be considered in the “hot” state for synchronisation purposes, until it transitions to the “warm” state.</p> <p><u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 1 and 2.</u></p> <p><u>N.b. This should typically be zero, as a Facility is generally considered “hot” immediately after shutdown after operation, and any “deadtime” before being able to restart is covered by the Minimum Restart Time property.</u></p> <p><u>If this field is not applicable, please leave field as zero.</u></p>	Input Stepper	<p>Numeric and in the following format:</p> <p>Days, Hours, Minutes, Seconds</p>	Refer to Format	Appendix 1(b)xviii.3.
The sent-out capacity when the Facility is operating at minimum stable loading level, expressed in MW [Appendix 1(b)xx.]	<p>The minimum stable <u>injection</u> level of the <u>Facility</u>, expressed in MW for primary Non-Liquid Fuel. It is the technical minimum <u>injection level at which the Facility can remain in stable operation. This is the level that the Facility would not normally be dispatched to (see Minimum Dispatchable Load Level), but may be directed to operate at by AEMO if required (e.g. under emergency conditions).</u></p> <p>Note that this is generally equal to Minimum Generator Capacity and may be equal or lower than the Minimum Dispatchable Generation. <u>The value specified must be applicable for an ambient temperature of 15 °C.</u></p>	Text Box	Numeric	MW	Appendix 1(b)xx.
The sent-out capacity when the Facility is operating at the minimum dispatchable loading level, expressed in MW [Appendix 1(b)xxi.]	<p><u>The normal minimum injection for the Facility after which it can be dispatched by AEMO, expressed in MW for primary Non-Liquid Fuel.</u> Note that this is typically equal to Minimum Generator Capacity, however the dispatchable generation could be set higher than the <u>Minimum Stable Load Level. The value specified must be applicable for an ambient temperature of 15 °C.</u></p>	Text Box	Numeric	MW	Appendix 1(b)xxi.

Deleted: relative

Deleted: 1
Should not be longer than the Facility’s minimum restart time.

Deleted: loading

Deleted: generator

Deleted: generating capacity.

Deleted: defined as the

Deleted: level.

Deleted: This is generated at

Deleted: Defined as

Deleted: emergency level.

Deleted: technical minimum generator capacity. This is generated at...

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The minimum physical response time before the Facility can begin to respond to a Dispatch Instruction when the Facility is running. [Appendix 1(b)xxii.]	<p><u>The minimum time before a Facility can respond after receiving an Electronic Dispatch Instruction, when the Facility is running.</u></p> <p><u>Refer to Appendix 2 of this guide for more details, where the $t_2 - t_1$.</u></p> <p><u>N.b. The Minimum Physical Responses Time to a Dispatch Instruction should be less than a minute. If the time is longer please include an explanation of why the electronic response is more than a minute in the "Further supporting documentation" section of the change request.</u></p>	Text Box	Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xxii.
Any output range between minimum dispatchable loading level and nameplate capacity in which the Facility is incapable of stable or safe operation [Appendix 1(b)xxiii.]	Any output ranges between minimum dispatchable loading level and nameplate capacity in which the facility is incapable of stable or safe operation.	File Upload	<p>File format to be .csv with the following fields on each line:</p> <ul style="list-style-type: none"> • sequence_number (integer 3), • facility_identity (character 24) • fuel_type (character 24) <p>Followed by the following data pairs for each disallowed region:</p> <ul style="list-style-type: none"> • lower_disallowed_load (real 6:1), • upper_disallowed_load (real 6:1), <p>The last pair determined by carriage return.</p> <p>A separate set of data is required for each fuel type.</p> <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>	MW	Appendix 1(b)xxiii.
The minimum load at the connection point of the Facility that will automatically trip off if the Facility fails, expressed in MW [Appendix 1(b)xxiv.]	Refers to parts of the generator unit/station service load which are automatically disconnected by the Participant. Includes unit auxiliary load which is supplied directly from the generator via the unit transformer and station	Text Box	<p>Numeric</p> <p><u>Value must be positive</u></p>	MW	Appendix 1(b)xxiv.

Deleted: ,

Deleted: The minimum time before a Facility is ready to receive a Dispatch Instruction, after returning from shutdown and is synchronised.[¶]

Deleted: Where applicable, this

Deleted: is greater

Deleted: or equal to the Elapsed Synchronisation Time (Hot).

Deleted: File Upload

Deleted: File format to be .csv with each line having the following fields:[¶]

- generator_sequence_number (integer 3),
- generator_identity (character 24),
- load_tripped (real 8:3)

The first line is to indicate the field names as above.[¶] File template can be found on the following link ([here](#))

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	load supplied from the network if disconnected automatically when the generator trips. Participants may need to know how to handle where trippable load is dependent on the unit generated output load.				
The sub-transient, transient and steady state impedances (positive, negative and zero sequence) for the Facility [Appendix 1(b)xxv.]	<p>Sub-transient, transient and steady state impedances (positive, negative and zero sequences) for the facility and any other related data required.</p> <p>Positive Impedance for Element</p> <p>While included, AEMO will generally get this information via access connection information through Generator Performance Standard (GPS) submissions, and therefore should align with the GPS process.</p>	File Upload	<p>Electrical model <u>data</u> - file format to be .csv with each line in the file having the fields indicated below:</p> <ul style="list-style-type: none"> Item_sequence_number (Integer 3), facility_identity (character 24), resistance (real 8:5 with exponent), positive_sequence_steadystate_reactance (real 8:5 with exponent), positive_sequence_steadystate_susceptance (real 8:5 with exponent), negative_sequence_reactance (real 8:5 with exponent), zero_sequence_reactance (real 8:5 with exponent), sub_transient_reactance (real 8:5 with exponent), transient_reactance (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>	N/A	Appendix
Standing Maximum Upwards Ramp Rate [Appendix 1(b)xxvi.]	<p>Normal ramp up (generated basis).</p> <p>Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).</p>	Text Box	Numeric Value must be positive	MW/min	Appendix
Standing Maximum Downwards Ramp Rate [Appendix 1(b)xxvii.]	<p>Normal ramp down (generated basis).</p> <p>Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).</p>	Text Box	Numeric Value must be positive	MW/min	Appendix

Deleted: data

Deleted: sequence

Deleted: the

Deleted: (

Deleted:)

Deleted: File

Deleted: Ramp

Deleted: f

Deleted: Ramp

Deleted:

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Emergency upwards ramp rate [Appendix 1(b)xxviii.]	Emergency Ramp up (generated basis), If an Emergency Ramp up is not applicable, provide the <u>normal ramp up rate</u> (generated basis). <u>Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).</u>	Text Box	Numeric Value must be positive	MW/min	Appendix 1(b)xxviii.
Emergency downwards ramp rate [Appendix 1(b)xxix.]	Emergency Ramp down (generated basis), If Emergency Ramp down is not applicable, provide the <u>normal ramp down</u> (generated basis). <u>Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).</u>	Text Box	Numeric Value must be positive	MW/min	Appendix 1(b)xxix.
The overload Injection capacity of the Facility, if any, expressed in MW [Appendix 1(b)xxx.]	<u>This is the maximum sent-out capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS.</u> <u>This represents the maximum physical capacity available for Injection to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s).</u> If your Facility does not have an overload Injection capacity, provide the <u>maximum sent-out capacity at optimal operating conditions for the Facility.</u> <u>This field sets the maximum absolute value that may be submitted for Injection in Real-Time Market Submissions.</u>	Text Box	Numeric Value must be positive	MW	Appendix 1(b)xxx.
The overload Withdrawal capacity of the Facility, if any, expressed in MW [Appendix 1(b)xxxi.]	<u>This is the maximum Withdrawal capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS.</u> <u>This represents the maximum physical capacity available for Withdrawal to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the contracted maximum demand for the Facility's connection point(s).</u>	Text Box	Numeric Value must be positive	MW	Appendix 1(b)xxxi.

Deleted: Ramp

Deleted: Ramp

Deleted: The overload Injection capacity of the generator, if any, expressed in MW. Typically, any quantity above the specified nameplate value.†

Deleted: is not applicable

Deleted: Maximum

Deleted: (for Non-Synergy facilities) or generated capacity (for Synergy facilities) when operating

Deleted: .

Deleted: The

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<p><u>If your Facility does not have an overload withdrawal capacity, provide the maximum Withdrawal capacity of the Facility under optimal conditions.</u></p> <p><u>This field sets the maximum absolute value that may be submitted for Withdrawal in Real-Time Market Submissions.</u></p>				
The AGC capabilities of the Facility [Appendix 1(b)xxxii.]	<p>AGC Capabilities including:</p> <ul style="list-style-type: none"> - Min loading at which AGC can be provided. - Max loading at which AGC can be provided. - AGC response rate <p>A separate set of data is required for each fuel type.</p> <p><u>If the Facility does not have AGC capability then:</u></p> <ul style="list-style-type: none"> • <u>specify if the Facility is Business-to Business (B2B) enabled for 5-minute dispatch; or</u> • <u>has neither AGC nor B2B enable for 5-minute dispatch.</u> 	File Upload	<p>Generated MW/min should not be greater than <u>the normal ramp, and</u> must not be greater than <u>the emergency ramp.</u></p> <p>File format to be .csv with the following fields on each line:</p> <ul style="list-style-type: none"> • sequence_number (integer 3), • facility_identity (character 24), • fuel_type (character 24), • min_agc_load (real 6:1), <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p> <p><u>OR</u></p> <p><u>If the Facility does not have AGC capability then:</u></p> <ul style="list-style-type: none"> • <u>specify if the Facility is Business-to Business (B2B) enabled for 5-minute dispatch; or</u> • <u>has neither AGC nor B2B enable for 5-minute dispatch.</u> 	MW	Appendix 1(b)xxxii.
The black start capability of the Facility [Appendix 1(b)xxxiii.]	Details of facilities capability to provide system start capacity.	File Upload	File format to be .csv with each line in the file having the following fields:	N/A	Appendix 1(b)xxxiii.

Deleted: generator, if any, expressed in MW. Typically any quantity above the specified nameplate value

Deleted: If overload Withdrawal capacity is not applicable, provide the maximum capacity withdrawn from the SWIS at the connection point, withdrawn is at optimal conditions.†

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
			<ul style="list-style-type: none"> Item_sequence_number (integer 3), generator_id (character 24), black_start (Boolean 1=yes, 0=no) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>		
The short circuit capability of Facility equipment [Appendix 1(b)xxxiv.]	<p>Details the circuit fault devices and ratings.</p> <p>The circuit fault <u>devices'</u> identity information should match those identified on the Single Line Diagram, (Appendix 1.(b).xxi)</p> <p>Typically, short circuit ratings of primary plant such as circuit breakers are provided at the point of connection and downstream busbar.</p>	File Upload	<p>Data required in kiloamps for each circuit making/breaking device in the generator connection circuit.</p> <p>File format should be .csv with the following fields on each line</p> <ul style="list-style-type: none"> sequence_number (integer 3), facility_identity (character 24), circuit_fault_make_break_device_identity (character 24), fault_make_rating (real 8:5 with exponent), fault_break_rating (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>	N/A	Appendix 1(b)xxxiv.
Evidence that the communication and control systems required by section 2.35 are in place and operational [Appendix 1(b)xxxv.]	This field is redundant, <u>instead</u> participants should have uploaded this information in a document called the "Communication Protocol" in the Facility General Information Change Request under the field of "Details of the operational control over the Facility", <u>refer to Section 3.1 of this Technical Guide.</u>	File Upload	<p><u>As this field is mandatory in WEMS MPI please attach a document with the following wording:</u></p> <p>"The Communication Protocol will or has been submitted in the Facility General Information Change Request under the field of Details of the operational control over the Facility."</p>	N/A	Appendix 1(b)xxxv.

Deleted: devices

Deleted: and i

Deleted: ,

Deleted: Word document with the below text, a

Deleted: e

Deleted: ::

Deleted: ¶

Deleted: ¶

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The single line diagram for the Facility, including the locations of transformers, switches, operational and settlement meters [Appendix 1(b)xxxvi.]	<p>Details the locations of transformers, switches, operational and settlement meters.</p> <p>Same information and format required as for network topology.</p> <p>Any other related data should include generator winding configuration (e.g. connection delta, star, other).</p> <p>Operations data is also required to allow AEMO to model the connecting network and its equipment capabilities.</p> <p>Data required includes:</p> <ul style="list-style-type: none"> • circuit ratings in amps calculated as the rating of the lowest rated series connected item of plant in a circuit • circuit high and low voltage limits in kilovolts (kV) – determined from the rating of the equipment comprising the circuit components (e.g. voltage and current transformers, surge diverters, transformers, insulation, etc). • Fault make/ fault break capability for each circuit making/breaking device in a circuit. 	File Upload	<p>AEMO requires clearly labelled single line diagrams in Adobe Acrobat format (.pdf files) and .dxf/.dgn if relevant.</p> <p>Diagrams must include the location of transformers, switches, operation and interval meters (which are to be maintained in the Meter Registry)</p> <p>Diagrams must illustrate the following.</p> <p>Circuit rating:</p> <ul style="list-style-type: none"> • circuit_identity • circuit_rating_amps (real 8:3), • circuit_high_kvolt_limit (real 8:3), • circuit_low_kvolt_limit (real 8:3) <p>Circuit fault make and break capability:</p> <ul style="list-style-type: none"> • circuit_identity (character 24), • circuit_fault_make_break_device_identity (character 24), • fault_make_rating (real 8:5 with exponent), • fault_break_rating (real 8:5 with exponent) <p>Diagrams must be kept up to date and revised diagrams with amendments clearly indicated to AEMO in accordance with the WEM Rules.</p>	N/A	Appendix 1(b)xxxvi.
The network node or nodes at which the facility can connect [Appendix 1(b)xxxvii.]	<p>The network nodes at which the facility can connect (if more than one).</p> <p>If the facility can be connected at more than one connection point, the alternate connection points should be detailed.</p> <p>Note that the primary connection point is entered in the field "Connection Point". For a facility without an</p>	File Upload	<p>The name of the network node at which the facility is connected.</p> <p>If facility can connect at more than one node a circuit single line diagram in similar format as the facility single line diagram showing each network connection node and the circuit elements in each connection node.</p>	N/A	Appendix 1(b)xxxvii.

Deleted: SM

Deleted: kVvolt

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	alternate connection point, please submit a file with the message "Only 1 connection point for this facility."		The connection node should include the busbar name, number and section of that busbar if there is more than one section. The description must be completely unambiguous.		
The Transmission Node Identifier [Appendix 1(b)xxxviii.]	The Transmission Node Identifier for the Facility,	Text Box	<u>4-digit</u> alphanumeric TNI value, <u>The TNI value can be confirmed by the meter data agent (i.e. Western Power).</u>	N/A	Appendix 1(b)xxxviii.
National Meter Identifier (NMI) of each metering point for the Facility, where applicable [Appendix 1(b)xxxix.]	The National Meter Identifier (NMI) of each metering point for the Facility,	Text Box	<u>10-digit</u> NMI value. If multiple NMIs are applicable then use commas to separate, with a single space. <u>The NMI value can be confirmed by the meter data agent (i.e. Western Power).</u>	N/A	Appendix 1(b)xxxix.
The Metering Data Agent for the Facility [Appendix 1(b)xl.]	The Metering Data Agent for the facility. One Meter Data Agent must be selected.	Drop down list	Only one option may be selected, <u>(i.e. WPNTWK)</u>	N/A	Appendix 1(b)xl.
FCESS & ROCOF Ride-Through Capability					
Frequency Co-optimised Essential System Service Accreditation Parameters [Appendix 1(h).]	Frequency Co-optimised Essential System Service Accreditation Parameters approved by AEMO.	File Upload	<u>If this field is not applicable, please leave field blank.</u> <u>The template FCESS Accreditation Form is available here and the form must be approved by AEMO prior to submitting in WEMS.</u> <u>This must be in excel format and must be the same version AEMO approved.</u> <u>Further information on FCESS Accreditation process is available here.</u>	N/A	Appendix 1(h).
RoCoF Ride-Through Capability of the Facility as determined by AEMO [Appendix 1(i).]	RoCoF Ride-Through Capability of the Facility as determined by AEMO. <u>If AEMO has not made a separate determination under paragraph 11.2.6 of the FCESS Accreditation WEM Procedure (link here) then the value of 0.25 Hz over 500ms (RoCoF Safe Limit) must be submitted.</u>	Text Box	Numeric Value must be positive <u>If you intend to apply for a separate determination for RoCoF Ride-Through Capability then information on the process is available here.</u>	<u>Hz over 500ms</u>	Appendix 1(i).

Deleted: If multiple TNIs are applicable then use commas to separate, with a single space

Deleted: If this field is not applicable, please leave field blank.

Deleted: The FCESS which has been reviewed and approved by AEMO.¹
This must be in excel format and must be the same version AEMO approved.

Deleted: MWs

Deleted: If this field is not applicable, please leave field blank....

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	Published RoCoF Ride-Through Capability values which had have separate determinations are also available in the link (here) under the sheet "Current RoCoF Ride-Through Values"		Facilities with a RoCoF Ride-Through capability value above the RoCoF Ride-Through Cost Recovery Limit, will not be deemed causers of the RoCoF Control Service and will be excluded from recovery of the costs of the control service.		

Deleted: be

WEMDE and Operational Planning Data

Normally-on Load	<p><u>A Facility, for which the forecast quantity of Withdrawal is already accounted for in the Forecast Operational Demand.</u></p> <p><u>By having Normally-on load ticked, the following applies:</u></p> <p>1. <u>The Withdrawal quantity for the Facility is already forecasted by AEMO and accounted for in the Forecast Unscheduled Operational Demand; and</u></p> <p>2. <u>Notwithstanding the above, the Market Participant for this Facility must still bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status) as it does not change a Market Participant rule obligation to submit a market Withdrawal quantity.</u></p> <p><u>By having Normally-on load unticked, the following applies:</u></p> <p>1. <u>The Withdrawal quantity for the Facility is not forecasted by AEMO and will not be accounted for in the Forecast Unscheduled Operational Demand; and</u></p>	Tick Box	Ticked = Yes, Unticked = No	N/A	2.1A.2.(m) Market S Procedur
------------------	---	----------	-----------------------------	-----	---------------------------------

Deleted: Defines whether AEMO treats this Facility as a normally-on load for the purposes of the Dispatch Algorithm....

Deleted: A

Deleted: n

Deleted: is one which

Deleted: ,

Deleted: therefore needs

Formatted: Font: Bold, Underline

Deleted: flagged to avoid double counting.

Deleted: ¶

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<p><u>2. The Market Participant for this Facility must bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status).</u></p> <p><u>If you are unsure, please leave as unticked for "No". AEMO will review your circumstances and notify you if the value should be a "Normally-on Load"</u></p>				
Storage Constraints	<p>Where there are limitations on the Injection or Withdrawal capability of a Registered Facility based on the Charge Level of associated Electric Storage Resources.</p> <p><u>If the Facility does not contain an Electric Storage Resource (battery) it must be left unticked.</u></p>	Tix Box	Ticked = Yes, Unticked = No	N/A	7.5.10 and 7.5.10A
Inertia	<p>The kinetic energy (at nominal frequency) that is extracted from the rotating mass of a machine coupled to the power system to compensate an imbalance in the system frequency.</p> <p>Alternatively, the 'synthetic inertia' provided by non-rotating machines which can be programmed to provide inertia to the system. An example is inverter-based technology.</p> <p><u>If the Facility does not provide inertia then enter a value of zero.</u></p> <p><u>Otherwise, if the Facility does provide inertia, the value should be one of the following:</u></p> <ul style="list-style-type: none"> <u>If the Facility has been accredited for RoCoF control service, the value approved by AEMO ; or</u> <u>If the Facility has not been accredited for RoCoF control service then the inertia value submitted must be reflect the sum of all inertia values in the manufacturer's data sheets for all the generation systems behind the Facility's connection point(s); or</u> 	Text Box	Numeric	MWs	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph 2.4.2(a))

Deleted: 1

Deleted: 1

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<ul style="list-style-type: none"> If neither of the above information is available then contact wa.operations@aemo.com.au so AEMO can assist you in deriving an appropriate value. 				
Tau Factor	The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure; or if it has not undergone the Accreditation process the value must be "999".	Text Box	Numeric	seconds	2.1A.2.(m) WEM Proc FCESS Ac (paragra
Unconstrained Forecasts	<p>This determines where the Unconstrained Forecast Source for the Primary Dispatch Interval or Primary Pre-Dispatch Intervals will come from.</p> <p><u>AEMO recommends the following forecast types for the respective Facility Classes:</u></p> <ul style="list-style-type: none"> Scheduled Facility, Demand Side Programme and Interruptible Load must specify RTMS Semi-Scheduled Facility should specify SCADA. Non-Scheduled Facility should specify Persistence <p>If you operate a Semi-Scheduled Facility or Non-Scheduled Facility and you would prefer to submit a different forecast type other than that outlined above, you must email wa.operations@aemo.com.au to have AEMO to assess the suitability of an alternate forecast type.</p>	Drop Down	Can only select one: <ul style="list-style-type: none"> RTMS SCADA PERSISTENCE 	N/A	2.1A.2.(m) Market S Procedur
If the Facility has an Electric Storage Resource, the normal ramp rate upwards whilst withdrawing, expressed as MW/min	<p>Normal ramp up (change towards injection) on an as generated basis.</p> <p>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</p>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m) Appendix

Field Code Changed

Deleted: The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure...

Deleted: N/A

Deleted:

Deleted: :

Deleted: If Facility is a SSF must specify source of

Field Code Changed

Deleted: RTMS, SCADA or persistence. If a Facility is not a NSF, this can be defaulted to "RTMS".

Deleted: R

Deleted: amp

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
If the Facility has an Electric Storage Resource, the normal ramp rate downwards whilst withdrawing, expressed as MW/min	<u>Normal ramp</u> down (change towards withdrawal) on <u>an</u> as generated basis. <u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m) and Appendix 1(b)xvi.
If the Facility has an Electric Storage Resource, the emergency ramp rate upwards whilst withdrawing, expressed as MW/min	Emergency Ramp up (change towards injection). If Emergency Ramp up is not applicable, provide the <u>normal ramp</u> up (change towards injection) on <u>an</u> as generated basis. <u>If this field is not applicable, then leave as blank.</u>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m) and Appendix 1(b)xvi.
If the Facility has an Electric Storage Resource, the emergency ramp rate downwards whilst withdrawing, expressed as MW/min	Emergency Ramp down (change towards withdrawal). If Emergency Ramp down is not applicable, provide the <u>normal ramp</u> down (change towards withdrawal) on <u>an</u> as generated basis. <u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m) and Appendix 1(b)xvi.
If the Facility has an Electric Storage Resource, the Minimum State of Charge Capacity, expressed as a percentage (%)	State of Charge (%) should be expressed relative to the total usable (dispatchable) storage quantity of the Facility, at optimal conditions, where the usable quantity may be lower than the Facility's nominal capacity. <u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u>	Text Box	Numeric Value must be positive	%	2.1A.2.(m) and Appendix 1(b)xvi.
If the Facility has an Electric Storage Resource, the Facility's Electric Storage Resource's total MWh capacity	The usable (dispatchable) storage quantity of the Electric Storage Resource, where the usable quantity may be lower than the Facility's nominal capacity. <u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u>	Text Box	Numeric	MWh	2.1A.2.(m) and Appendix 1(b)xvi.

Deleted: Ramp

Deleted: Ramp

Deleted: applicable

Deleted: R

Deleted: amp

Deleted: 2023

4.4 Non-Scheduled Facility

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Requirements
Non-Scheduled Facility					
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33 Deleted: Non-Scheduled Facility Deleted: D
The total nameplate capacity of the Facility's Energy Producing System, expressed in MW [Appendix 1(d)i.]	Nameplate capacity of facility, as per the output subject to ratings of any primary plant or equipment. For synchronous generators this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters. Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves.	Text Box	Numeric		2.33 Deleted: (c) Appendix 1(d)i.
The System Size [Appendix 1(d)iii.]	The MW value in accordance with the glossary definition in WEM Rules for System Size.	Text Box	Numeric	MW	Appendix 1(d)iii.
Is the Facility a Small Aggregation [Appendix 1(d)iv.]	Denotes whether the Facility meets the glossary definition in the WEM Rules for Small Aggregation.	Tick Box	Ticked = Yes, Unticked = No	N/A	Appendix 1(d)iv.
The maximum sent out capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(d)v.]	<u>This is the maximum sent-out capacity at optimal operating conditions for the Facility.</u> <u>This represents the maximum physical capacity available for Injection to AEMO under normal operating conditions for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s).</u>	Text Box	Numeric	MW	Appendix 1(d)v. Deleted: Maximum Deleted: (for Non-Synergy facilities) or generated capacity (for Synergy facilities) when operating Deleted: .
The maximum Withdrawal capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(d)vi.]	Maximum capacity withdrawn from the SWIS at the connection point, including any downstream loads such as intermittent or parasitic/auxiliary loads. <u>Where Withdrawal capacity is at optimal conditions for withdrawing from the network.</u>	Text Box	Numeric	MW	Appendix 1(d)vi. Deleted: Capacity withdrawn Deleted: .
The dependence of sent out capacity on temperature at the location of the Facility, if applicable [Appendix 1(d)vii.]	<u>Sent out capacity as a function of temperature at the location of the facility.</u> <u>Please note the temperature dependence data must be provided to at least the maximum sent out capacity of the</u>	File Upload	File format to be .csv with the following fields on each line: • facility_identity (character 24), • fuel_type (character 1) – L N, followed by the	MW and °C.	Appendix 1(d)vii. Deleted: Rated (installed)
					Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Requirement
	<p><u>Facility under optimal conditions, which must be up to the declared sent-out capacity (if applicable).</u></p> <p><u>A separate relationship for each fuel type is required expressed in terms of generated MW.</u></p> <p>Maximum sent out capacity (MW) details for each 0.1°C interval from 0°C to 45°C, or higher if specified by the Network Operator based on physical location.</p>		<p>following data pairs for each temperature breakpoint:</p> <ul style="list-style-type: none"> temperature (real 3:1), facility_capability (real 6:3) <p>Note that the first row must be a header row, containing the names of the four columns respectively; facility_identity, fuel_type, temperature, facility_capability.</p> <p>File template can be found on the following link (here)</p> <p><u>OR</u></p> <p><u>If your Facility is not temperature dependent, then attach a file with comment "Facility is not temperature dependent".</u></p>		
The sent-out capacity when the Facility is operating at the minimum dispatchable loading level, expressed in MW [Appendix 1(d)ix.]	Defined as the emergency level. Note that this is typically equal to Minimum Generator Capacity, however the dispatchable generation could be set higher than the technical minimum generator capacity. This is as generated at 15 °C.	Text Box	Numeric	MW	Appendix 1(d)ix
The minimum physical response time before the Facility can begin to respond to a direction from AEMO to change its output when the Facility is running [Appendix 1(d)x.]	Minimum response time before the facility can begin to respond to a direction from AEMO to change its output.	Text Box	Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(d)x.
The minimum load at the connection point of the Facility that will automatically trip off if the Facility fails, expressed in MW [Appendix 1(d)xi.]	<p>Refers to parts of the generator unit/station service load which are automatically disconnected by the Participant.</p> <p>Includes unit auxiliary load which is supplied directly from the generator via the unit transformer and station load supplied from the network if disconnected automatically when the generator trips. Participants may need to know how to handle where trippable load is dependent on the unit generated output load.</p>	Text Box	Numeric Value must be positive	MW	Appendix 1(d)xi

Deleted: D

Deleted: °

Deleted: The last pair terminated by carriage return.¶

Deleted: File Upload

Deleted: File format to be .csv with each line having the following fields:¶

- generator_sequence_number (integer 3),
- generator_identity (character 24),
- load_tripped (real 8:3)

The first line is to indicate the field names as above.¶
File template can be found on the following link ([here](#))...

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Requirement
Sub-transient, transient and steady state impedances (positive, negative and zero sequence) for the Facility [Appendix 1(d)xii.]	<p>Sub-transient, transient and steady state impedances (positive, negative and zero sequence) for the facility and any other related data required.</p> <p>Positive Impedance for Element,</p> <p>While included, AEMO will generally get this information via access connection information through Generator Performance Standard (GPS) submissions, and therefore should align with the GPS process.</p>	File Upload	<p>Electrical mode- data - file format to be .csv with the each line in the file having the fields indicated below:</p> <ul style="list-style-type: none"> • Item_sequence_number (Integer 3), • facility_identity (character 24), • resistance (real 8:5 with exponent), • positive_sequence_steadystate_reactance (real 8:5 with exponent), • positive_sequence_steadystate_susceptance (real 8:5 with exponent), • negative_sequence_reactance(real 8:5 with exponent), • zero_sequence_reactance (real 8:5 with exponent), • sub_transient_reactance (real 8:5 with exponent), • transient_reactance (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>	N/A	Appendix 1(d)xii.
Standing Maximum Upwards Ramp Rate [Appendix 1(d)xiii.]	<u>Normal ramp</u> up (generated basis).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(d)xiii.
Standing Maximum Downwards Ramp Rate [Appendix 1(d)xiv.]	<u>Normal ramp</u> down (generated basis).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(d)xiv.
Emergency upwards ramp rate, if applicable [Appendix 1(d)xv.]	Emergency Ramp up (generated basis), If Emergency Ramp up is not applicable, provide the <u>normal ramp</u> up (generated basis).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(d)xv.
Emergency downwards ramp rate, if applicable [Appendix 1(d)xvi.]	Emergency Ramp down (generated basis) If Emergency Ramp down is not applicable, provide the <u>normal ramp</u> down (generated basis).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(d)xvi.

Deleted: D

Deleted: model

Deleted: t

Deleted: (

Deleted:).

Deleted: Ramp

Deleted: Ramp

Deleted:

Deleted: Ramp

Deleted: Ramp

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Requirement
<p>The overload Injection capacity of the Facility, if any, expressed in MW [Appendix 1(d)xvii.]</p>	<p><u>This is the maximum sent-out capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS.</u></p> <p><u>This represents the maximum physical capacity available for Injection to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s).</u></p> <p><u>If your Facility does not have an overload Injection capacity, provide the maximum sent-out capacity at optimal operating conditions for the Facility.</u></p> <p><u>This field sets the maximum absolute value that may be submitted for Injection in Real-Time Market Submissions.</u></p>	Text Box	<p>Numeric</p> <p>Value must be positive</p>	MW	<p>Appendix 1(d)xvii</p> <p>Deleted: D</p> <p>Deleted: The overload Injection capacity of the generator, if any, expressed in MW. Typically, any quantity above the specified nameplate value.†</p> <p>Deleted: is not applicable</p> <p>Deleted: Maximum</p> <p>Deleted: (for Non-Synergy facilities) or generated capacity (for Synergy facilities) when operating</p>
<p>The overload Withdrawal capacity of the Facility, if any, expressed in MW [Appendix 1(d)xviii.]</p>	<p><u>This is the maximum Withdrawal capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS.</u></p> <p><u>This represents the maximum physical capacity available for Withdrawal to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the contracted maximum demand for the Facility's connection point(s).</u></p> <p><u>If your Facility does not have an overload withdrawal capacity, provide the maximum Withdrawal capacity of the Facility under optimal conditions.</u></p> <p><u>This field sets the maximum absolute value that may be submitted for Withdrawal in Real-Time Market Submissions.</u></p>	Text Box	<p>Numeric</p> <p>Value must be positive</p>	MW	<p>Appendix 1(d)xviii</p> <p>Deleted: .</p> <p>Deleted: The</p> <p>Deleted: generator, if any, expressed in MW. Typically, any quantity above the specified nameplate value</p> <p>Deleted: If overload Withdrawal capacity is not applicable, provide the maximum capacity withdrawn from the SWIS at the connection point, withdrawn is at optimal conditions....</p>
<p>The short circuit capability of equipment [Appendix 1(d)xix.]</p>	<p>Details the circuit fault devices and ratings.</p> <p>The circuit fault <u>devices</u> identity information should match those identified on the Single Line Diagram. (Appendix 1.(b).xxi)</p> <p>Typically, short circuit ratings of primary <u>plants</u> such as circuit breakers are provided at the point of connection and downstream busbar.</p>	File Upload	<p>Data required in kiloamps for each circuit making/breaking device in the generator connection circuit.</p> <p>File format should be .csv with the following fields on each line</p> <ul style="list-style-type: none"> • sequence_number (integer 3), • facility_identity (character 24), 	N/A	<p>Appendix 1(d)xix</p> <p>Deleted: devices</p> <p>Deleted: plant</p> <p>Deleted: 2023</p>

Data Field	Description	Field type	Format	Units	WEMS Requirement
			<ul style="list-style-type: none"> circuit_fault_make_break_device_identity (character 24), fault_make_rating (real 8:5 with exponent), fault_break_rating (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>		
Evidence that the communication and control systems required by section 2.35 are in place and operational [Appendix 1(d)xx.]	<p>▼ This field is redundant, instead participants should have uploaded this information in a document called the "Communication Protocol" in the Facility General Information Change Request under the field of "Details of the operational control over the Facility", refer to Section 3.1 of this Technical Guide.</p>	File Upload	<p><u>As this field is mandatory in WEMS MPI please attach a document with the following wording:</u></p> <p>▼ "The Communication Protocol will or has been submitted in the Facility General Information Change Request under the field of Details of the operational control over the Facility."</p>	N/A	Appendix 1(d)xx
The single line diagram for the Facility, including the locations of transformers, switches, operational and settlement meters [Appendix 1(d)xxi.]	<p>Details the locations of transformers, switches, operational and settlement meters.</p> <p>Same information and format required as for network topology.</p> <p>Any other related data should include generator winding configuration (e.g. connection delta, star, other).</p> <p>Operations data is also required to allow AEMO to model the connecting network and its equipment capabilities.</p> <p>Data required includes:</p> <ul style="list-style-type: none"> circuit ratings in amps calculated as the rating of the lowest rated series connected item of plant in a circuit circuit high and low voltage limits in kilovolts (kV) – determined from the rating of the equipment comprising the circuit components (e.g. voltage and current transformers, surge diverters, transformers, insulation, etc.). 	File Upload	<p>AEMO requires clearly labelled single line diagrams in Adobe Acrobat format (.dxf, .dgn or .pdf files).</p> <p>Diagrams must include the location of transformers, switches, operation and interval meters (which are to be maintained in the Meter Registry)</p> <p>Diagrams must illustrate the following.</p> <p>Circuit rating:</p> <ul style="list-style-type: none"> circuit_identity circuit_rating_amps (real 8:3), circuit_high_kvolt_limit (real 8:3), circuit_low_kvolt_limit (real 8:3) <p>Circuit fault make and break capability:</p> <ul style="list-style-type: none"> circuit_identity (character 24), circuit_fault_make_break_device_identity (character 24), 	N/A	Appendix 1(d)xxi

Deleted: D

Deleted: The

Deleted: and

Deleted: ,

Deleted: Word document with the below text, as the field is mandatory in WEMS MPI: ¶

Deleted:

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Requirement
	<ul style="list-style-type: none"> Fault make/ fault break capability for each circuit making/breaking device in a circuit. 		<ul style="list-style-type: none"> fault_make_rating (real 8:5 with exponent), fault_break_rating (real 8:5 with exponent) <p>Diagrams must be kept up to date and revised diagrams with amendments clearly indicated to AEMO in accordance with the WEM Rules.</p>		
The network node or nodes at which the Facility can connect [Appendix 1(d)xxii.]	<p>The network nodes at which the facility can connect (if more than one).</p> <p>If the facility can be connected at more than one connection point, the alternate connection points should be detailed.</p> <p>Note that the primary connection point is entered in the field "Connection Point". For a facility without an alternate connection point, please submit a file with the message "Only 1 connection point for this facility."</p>	File Upload	<p>The name of the network node at which the facility is connected.</p> <p>If facility can connect at more than one node a circuit single line diagram in similar format as the facility single line diagram showing each network connection node and the circuit elements in each connection node.</p> <p>The connection node should include the busbar name, number, and section of that busbar if there is more than one section. The description must be completely unambiguous.</p>	N/A	Appendix 1(d)xxii.
The Transmission Node Identifier [Appendix 1(d)xxiii.]	The Transmission Node Identifier for the Facility.	Text Box	4-digit alphanumeric TNI value. The TNI value can be confirmed by the meter data agent (i.e. Western Power).	N/A	Appendix 1(d)xxiii.
The National Meter Identifier (NMI) of each metering point for the Facility, where applicable [Appendix 1(d)xxiv.]	The National Meter Identifier (NMI) of each metering point for the Facility.	Text Box	10-digit NMI value. If multiple NMIs are applicable then use commas to separate, with a single space. The NMI value can be confirmed by the meter data agent (i.e. Western Power).	N/A	Appendix 1(d)xxiv.
The Metering Data Agent for the Facility [Appendix 1(d)xxv.]	The Metering Data Agent for the facility. One Meter Data Agent must be selected.	Drop down list	Only one option may be selected. (i.e. WPNTWK)	N/A	Appendix 1(d)xxv.
FCESS & ROCOF Ride-Through Capability					
Frequency Co-optimised Essential System Service Accreditation Parameters [Appendix 1(h).]	Frequency Co-optimised Essential System Service Accreditation Parameters approved by AEMO. If this field is not applicable, please leave field blank.	File Upload	<p>If this field is not applicable, please leave field blank.</p> <p>The template FCESS Accreditation Form is available here and the form must be approved by AEMO prior to submitting in WEMS.</p>	N/A	Appendix 1(h).

Deleted: D

Deleted: Id in

Deleted: If multiple TNIs are applicable then use commas to separate, with a single space.

2023

Data Field	Description	Field type	Format	Units	WEM Requirement
RoCoF Ride-Through Capability of the Facility as determined by AEMO [Appendix 1(i).]	<p>RoCoF Ride-Through Capability of the Facility as determined by AEMO.</p> <p><u>If AEMO has not made a separate determination under paragraph 11.2.6 of the FCESS Accreditation WEM Procedure (link here) then the value of 0.25 Hz over 500ms (RoCoF Safe Limit) must be submitted.</u></p> <p><u>Published RoCoF Ride-Through Capability values are also available in the link (here) under the sheet "Current RoCoF Ride-Through Values".</u></p>	Text Box	<p>Numeric Value must be positive</p> <p><u>If you intend to apply for a separate determination for RoCoF Ride-Through Capability then information on the process is available here.</u></p> <p><u>Facilities with a RoCoF Ride-Through capability value above the RoCoF Ride-Through Cost Recovery Limit, will be not be deemed causers of the RoCoF Control Service and will be excluded from recovery of the costs of the control service.</u></p>	<p><u>Hz over 500ms</u></p>	<p>Deleted: D</p> <p>Deleted: The FCESS Accreditation Form which has been reviewed and approved by AEMO. If This must be in excel format and must be the same version AEMO approved.</p> <p>Deleted: MWs</p> <p>Deleted: If this field is not applicable, please leave field blank.</p>
WEMDE and Operational Planning Data					
Normally-on Load	<p><u>A Facility, for which the forecast quantity of Withdrawal is already accounted for in the Forecast Operational Demand.</u></p> <p><u>By having Normally-on load ticked, the following applies:</u></p> <p><u>1. The Withdrawal quantity for the Facility is already forecasted by AEMO and accounted for in the Forecast Unscheduled Operational Demand; and</u></p> <p><u>2. The Market Participant for this Facility must still bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status) as it does not change a Market Participant rule obligation to submit a market Withdrawal quantity.</u></p> <p><u>By having Normally-on load unticked, the following applies:</u></p>	Tick Box	Ticked = Yes, Unticked = No	N/A	<p>2.1A.2.(m) and the Market Schedule Procedure.</p> <p>Deleted: Defines whether AEMO treats this Facility as a normally-on load for the purposes of the Dispatch Algorithm. A...</p> <p>Deleted: n</p> <p>Deleted: is one which</p> <p>Deleted: ,</p> <p>Deleted: therefore needs</p> <p>Deleted: 2023</p>

Data Field	Description	Field type	Format	Units	WEM Requirement
	<p><u>1. The Withdrawal quantity for the Facility is not forecasted by AEMO and will not be accounted for in the Forecast Unscheduled Operational Demand; and</u></p> <p><u>2. The Market Participant for this Facility must bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status).</u></p> <p><u>If you are unsure, please leave as unticked for "No". AEMO will review your circumstances and notify you if the value should be a "Normally-on Load"</u></p>				<p>Deleted: D</p> <p>Deleted: flagged to avoid double counting.</p>
Storage Constraints	<p>Where there are limitations on the Injection or Withdrawal capability of a Registered Facility based on the Charge Level of associated Electric Storage Resources.</p> <p><u>If the Facility does not contain an Electric Storage Resource (battery) it must be left unticked.</u></p>	Tix Box	Ticked = Yes, Unticked = No	N/A	7.5.10 and 7.5.10A
Inertia	<p>The kinetic energy (at nominal frequency) that is extracted from the rotating mass of a machine coupled to the power system to compensate an imbalance in the system frequency.</p> <p>Alternatively, the 'synthetic inertia' provided by non-rotating machines which can be programmed to provide inertia to the system. An example is inverter-based technology.</p> <p><u>If the Facility does not provide inertia then enter a value of zero (e.g. wind farms and solar farms typically do not provide inertia).</u></p> <p><u>Otherwise, if you Facility does provide inertia, the value should be one of the following:</u></p> <ul style="list-style-type: none"> <u>If the Facility has been accredited for RoCoF control service, the value approved by AEMO ;</u> <u>or</u> <u>If the Facility has not been accredited for RoCoF control service then the inertia value submitted must be reflect the sum of all inertia values in</u> 	Text Box	Numeric	MWs	<p>2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (para 2.4.2(a))</p> <p>Deleted: f</p> <p>Deleted: 2023</p>

Data Field	Description	Field type	Format	Units	WEM Requirement
	<p>the manufacturer's data sheets for all the generation systems behind the Facility's connection point(s); or</p> <ul style="list-style-type: none"> If neither of the above information is available then contact wa.operations@aemo.com.au so AEMO can assist in deriving an appropriate value. 				Deleted: D
Tau Factor	<p>The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure; or if it has not undergone the Accreditation process the value must be "999"</p>	Text Box	Numeric	N/A	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation para 7.2.1
Unconstrained Forecasts	<p>This determines where the Unconstrained Forecast Source for the Primary Dispatch Interval or Primary Pre-Dispatch Intervals will come from:</p> <p>AEMO recommends the following forecast types for the respective Facility Classes:</p> <ul style="list-style-type: none"> Scheduled Facility, Demand Side Programme and Interruptible Load must specify RTMS Semi-Scheduled Facility should specify SCADA. Non-Scheduled Facility should specify Persistence <p>If you operate a Semi-Scheduled Facility or Non-Scheduled Facility and you would prefer to submit a different forecast type other than that outlined above, you must email wa.operations@aemo.com.au to have AEMO assess the suitability of an alternate forecast type.</p>	Drop Down	<p>Can only select one:</p> <ul style="list-style-type: none"> RTMS SCADA PERSISTENCE 	N/A	2.1A. the Market Schedules Procedure.

Field Code Changed

Deleted: The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure.

Deleted: If Facility is a SSF must specify source of RTMS, SCADA or persistence. If a Facility is not a NSF, this can be defaulted to "RTMS".

Deleted: ¶

Deleted: ¶

Deleted: 2023

4.5 Semi-Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Semi-Scheduled Facility					
Facility Name	This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i
The total nameplate capacity of the Facility's Energy Producing System, expressed in MW [Appendix 1(c)i.]	Nameplate capacity of facility, as per the output subject to ratings of any primary plant or equipment. For synchronous generators this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters. Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves.	Text Box	Numeric	MW	Appendix 1(c)i.
The System Size [Appendix 1(c)iii.]	The MW value in accordance with the glossary definition in WEM Rules for System Size.	Text Box	Numeric	MW	Appendix 1(c)i.
Is the Facility a Small Aggregation [Appendix 1(c)iv.]	Denotes whether the Facility meets the glossary definition in the WEM Rules for Small Aggregation.	Tick Box	Yes or No	N/A	Appendix 1(c)i.
The maximum sent out capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(c)v.]	<u>This is the maximum sent-out capacity at optimal operating conditions for the Facility.</u> <u>This represents the maximum physical capacity available for Injection to AEMO under normal operating conditions for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s).</u>	Text Box	Numeric	MW	Appendix 1(c)v.
The maximum Withdrawal capacity of the Facility under optimal conditions, expressed in MW [Appendix 1(c)vi.]	<u>This is the maximum capacity to withdraw from the SWIS at the connection point(s) for the Facility.</u> <u>This represents the maximum physical capacity to Withdraw for the Facility and any of its co-located loads under normal operating conditions for the SWIS. This value does not need to match the contracted maximum demand for the Facility's connection point(s).</u>	Text Box	Numeric	MW	Appendix 1(c)vi.
The dependence of sent out capacity on temperature at the location of the Facility [Appendix 1(c)vii.]	<u>Sent out</u> capacity as a function of temperature at the location of the facility.	File Upload	File format to be .csv with the following fields on each line:	MW and °C,	Appendix 1(c)vii.

- Deleted:** 1
Further guidance can also be found in the Engineering internal guideline (link here)
- Deleted:** [
- Deleted:** Maximum
- Deleted:** (for Non-Synergy facilities) or generated capacity (for Synergy facilities) when operating
- Deleted:** .
- Deleted:** Maximum
- Deleted:** withdrawn
- Deleted:** ,
- Deleted:** , including
- Deleted:** downstream
- Deleted:** such as intermittent or parasitic/auxiliary loads, withdrawn is at optimal
- Deleted:** .1
- Deleted:** **Rated (installed)**
- Deleted:**
- Deleted:** 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<p><u>Please note the temperature dependence data must be provided to at least the maximum sent out capacity of the Facility under optimal conditions.</u></p> <p>A separate relationship for each fuel type is required expressed in terms of generated MW.</p> <p>Maximum <u>sent out capacity (MW)</u> details for each 0.1°C interval from 0°C to 45°C, or higher if specified by the Network Operator based on physical location.</p>		<ul style="list-style-type: none"> • facility_identity (character 24), • fuel_type (character 1) – L N, followed by the following data pairs for each temperature breakpoint: • temperature (real 3:1), • facility_capability (real 6:3) <p>Note that the first row must be a header row, containing the names of the four columns respectively; facility_identity, fuel_type, temperature, facility_capability.</p> <p>File template can be found on the following link (here)</p> <p>OR</p> <p><u>If your Facility is not temperature dependent, then attach a file with comment "Facility is not temperature dependent".</u></p>		
Temperature Location	<p>One of the following methods must be chosen:</p> <ul style="list-style-type: none"> • <u>41 °C</u> • SCADA • <u>BOM</u> <p><u>If your Facility is not temperature dependent or comprised of Intermittent Generation Systems only, then a value of 41 °C must be submitted.</u></p>	Drop Down	Can only select one options.	N/A	Appendix 1(c)viii.
Temperature Location	Location of BOM or SCADA temperature station	Drop Down	<p>For SCADA one of the following:</p> <ul style="list-style-type: none"> • CKB AMBIENT C • KMP AMBIENT C • MGA AMBIENT C • PJR AMBIENT C <p>For BOM one of the following: Albany Airport, Badgingarra, Bickley, Bunbury, Collie East, Dwellingup, Garden Island HSF, Geraldton Airport 8351, Hopetoun North, Jandakot Aero, Kalgoorlie-Boulder Airport, Mandurah, Pearce RAAF, Perth</p>	N/A	Appendix 1(c)viii.

Deleted: generation

Deleted: 1

Deleted: The last pair terminated by carriage return.\f

Deleted: <#>41 degrees\f

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
			Airport, Perth Metro, Rottneest Island, Southern Cross Airfield, Swanbourne.		
Is the Facility a Fast Start Facility [Appendix 1(c)xvi.]	Denotes whether the Facility meets the definition of Fast Start Facility under the WEM Rules Glossary.	Tick Box	Yes or No	N/A	Appendix 1(c)xvi.
Minimum Synchronisation Time (Cold) [Appendix 1(c)xvii.1.]	Cold synchronisation time. The minimum time to synchronise <u>(if applicable for the Facility)</u> and be available for dispatch <u>when the Facility is in a "cold" state. "Cold" state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Cold) has subsequently passed.</u> <u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details., specifically to Scenario 5 and 6.</u> If this field is not applicable, please leave field as zero.	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.1.
Elapsed Synchronisation Time (Cold) [Appendix 1(c)xvii.1.]	Number of minutes elapsed for Cold Sync time. This is the time relative to the Facility shutdown, after which the Facility will be considered in the "cold" state for synchronisation purposes. <u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details., specifically to Scenario 5 and 6.</u> If this field is not applicable, please leave field as zero.	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.1.
Minimum Synchronisation Time (Warm) [Appendix 1(c)xvii.2.]	Warm synchronisation time. The minimum time to synchronise <u>(if applicable for the Facility)</u> and be available for dispatch <u>when the Facility is in a "warm" state. "Warm" state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Warm) has subsequently passed.</u> <u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details., specifically to Scenario 3 and 4.</u> If this field is not applicable, please leave field as zero.	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.2.

Deleted: this

Deleted: , as

Deleted:).

Deleted: this

Deleted: , as

Deleted:).

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Elapsed Synchronisation Time (Warm) [Appendix 1(c)xvii.2.]	<p>Number of minutes elapsed for Warm Sync time.</p> <p>This is the time related to the Facility shutdown, after which the Facility will be considered in the "warm" state for synchronisation purposes, until it transitions to the "cold" state.</p> <p><u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 3 and 4.</u></p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.2.
Minimum Synchronisation Time (Hot) [Appendix 1(c)xvii.3.]	<p>Hot synchronisation time. The minimum time to synchronise (if applicable for the Facility) and be available for dispatch when the Facility is in a "hot" state. "Hot" state is defined by when the Facility has been shutdown after operating and the Elapsed Synchronisation Time (Hot) has subsequently passed.</p> <p><u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 1 and 2.</u></p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.3.
Elapsed Synchronisation Time (Hot) [Appendix 1(c)xvii.3.]	<p>Number of minutes elapsed for Hot Sync time.</p> <p>This is the time related to the Facility shutdown, after which the Facility will be considered in the "hot" state for synchronisation purposes, until it transitions to the "warm" state.</p> <p><u>Refer to Appendix 1 (section 8.1 and 8.2) of this guide for more details, specifically to Scenario 1 and 2.</u></p> <p>N.b. This should typically be zero, as Facilities are generally considered "hot" immediately after shutdown after operation, and any "deadtime" before being able to restart is covered by the Minimum Restart Time property.</p> <p><u>If this field is not applicable, please leave field as zero.</u></p>	Input Stepper	Numeric and in the following format: Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xvii.3.

Deleted: relative

Deleted: before

Deleted: this

Deleted: , as

Deleted:).

Deleted: relative

Deleted: before

Deleted: Should not be longer than the Facility's minimum restart time....

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The sent-out capacity when the Facility is operating at minimum stable loading level, expressed in MW [Appendix 1(c)xix.]	<p>The minimum stable <u>injection level</u> of the <u>Facility</u>, expressed in MW for primary Non-Liquid Fuel. It is the technical minimum <u>injection level at which the Facility can remain in stable operation</u>. This is a level that the <u>Facility would not normally be dispatched to (see Minimum Dispatchable Load Level), but may be directed to operate at by AEMO if required (e.g. under emergency conditions)</u>.</p> <p>Note that this is generally equal to Minimum Generator Capacity and may be equal or lower than the Minimum Dispatchable Generation. <u>The value specified must be applicable for an ambient temperature of 15 °C.</u></p>	Text Box	Numeric	MW	<p>App 1(c)xix]</p> <p>Deleted: loading</p> <p>Deleted: generator</p> <p>Deleted: generating capacity.</p> <p>Deleted: defined as the</p> <p>Deleted: level.</p> <p>Deleted: This is generated at</p>
The sent-out capacity when the Facility is operating at the minimum dispatchable loading level, expressed in MW [Appendix 1(c)xx.]	<p><u>The normal minimum injection for the Facility after which it can be dispatched by AEMO, expressed in MW for primary Non-Liquid Fuel.</u> Note that this is typically equal to Minimum Generator Capacity, however the dispatchable generation could be set higher than the <u>Minimum Stable Load Level. The value specified must be applicable for an ambient temperature of 15 °C.</u></p>	Text Box	Numeric	MW	<p>App 1(c)xx]</p> <p>Deleted: Defined as</p> <p>Deleted: emergency level.</p> <p>Deleted: technical minimum generator capacity. This is generated at...</p>
The minimum physical response time before the Facility can begin to respond to a Dispatch Instruction, when the Facility is running. [Appendix 1(c)xxi.]	<p>The minimum time before a Facility can respond after receiving an Electronic Dispatch Instruction, when the Facility is running. Refer to Appendix 2 of this guide for more details, where the $t_2 - t_1$.</p> <p>N.b. The Minimum Physical Responses Time to a Dispatch Instruction should be less than a minute. If the time is longer please include an explanation of why electronic response is greater than a minute in the "Further supporting documentation" section of the change request or send an email to wa.operations@aemo.com.au</p>	Text Box	Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(c)xxi.
Any output range between minimum dispatchable loading level and nameplate capacity in which the Facility is incapable of stable or safe operation [Appendix 1(c)xxii]	Any output ranges between minimum dispatchable loading level and nameplate capacity in which the facility is incapable of stable or safe operation.	File Upload	<p>File format to be .csv with the following fields on each line:</p> <ul style="list-style-type: none"> sequence_number (integer 3), facility_identity (character 24) fuel_type (character 24) <p>Followed by the following data pairs for each</p>	MW	Appendix 1(c)xxii

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
			<p>disallowed region:</p> <ul style="list-style-type: none"> • lower_disallowed_load (real 6:1), • upper_disallowed_load (real 6:1), <p>The last pair determined by carriage return.</p> <p>A separate set of data is required for each fuel type.</p> <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>		
The minimum load at the connection point of the Facility that will automatically trip off if the Facility fails, expressed in MW [Appendix 1(c)xxiii.]	<p>Refers to parts of the generator unit/station service load which are automatically disconnected by the Participant.</p> <p>Includes unit auxiliary load which is supplied directly from the generator via the unit transformer and station load supplied from the network if disconnected automatically when the generator trips. Participants may need to know how to handle where trippable load is dependent on the unit generated output load.</p>	Text Box	<p>Numeric</p> <p>Value must be positive</p>	MW	<p>Deleted: File Upload</p> <p>Deleted: File format to be .csv with each line having the following fields: 1 • generator_sequence_number (integer 3), • generator_identity (character 24), • load_tripped (real 8:3)</p>
Sub-transient, transient and steady state impedances (positive, negative and zero sequence) for the Facility [Appendix 1(c)xxiv.]	<p>Sub-transient, transient and steady state impedances (positive, negative and zero sequence) for the facility and any other related data required.</p> <p>Positive Impedance for Element</p> <p>While included, AEMO will generally get this information via access connection information through Generator Performance Standard (GPS) submissions, and therefore should align with the GPS process.</p>	File Upload	<p>Electrical model data - file format to be .csv with the each line in the file having the fields indicated below:</p> <ul style="list-style-type: none"> • Item_sequence_number (Integer 3), • facility_identity (character 24), • resistance (real 8:5 with exponent), • positive_sequence_steadystate_reactance (real 8:5 with exponent), • positive_sequence_steadystate_susceptance (real 8:5 with exponent), • negative_sequence_reactance (real 8:5 with exponent), • zero_sequence_reactance (real 8:5 with exponent), • sub_transient_reactance (real 8:5 with exponent), • transient_reactance (real 8:5 with exponent) 	N/A	<p>Deleted: (</p> <p>Deleted:)</p> <p>Deleted: 2023</p>

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
			The first line is to indicate the field names as above. File template can be found on the following link (here)		
Standing Maximum Upwards Ramp Rate [Appendix 1(c)xxv.]	Normal ramp up (generated basis). Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).	Text Box	Numeric Value must be positive	MW/min	App 1(c)xxv. Deleted: R Deleted: amp Deleted:
Standing Maximum Downwards Ramp Rate [Appendix 1(c)xxvi.]	Normal Ramp down (generated basis) Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(c)xxvi. Deleted:
Emergency upwards ramp rate [Appendix 1(c)xxvii.]	Emergency Ramp up (generated basis), If Emergency Ramp up is not applicable, provide the normal ramp up (generated basis) Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(c)xxvii. Deleted: (c) Deleted: R Deleted: amp
Emergency downwards ramp rate [Appendix 1(c)xxviii.]	Emergency Ramp down (generated basis) If Emergency Ramp down is not applicable, provide the normal ramp down (generated basis) Where applicable, the ramp rate should align with the Facility's Generator Performance Standard (GPS).	Text Box	Numeric Value must be positive	MW/min	Appendix 1(c)xxviii. Deleted: x 1(c) Deleted: Ramp
The overload Injection capacity of the Facility, if any, expressed in MW [Appendix 1(c)xxix.]	This is the maximum sent-out capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS. This represents the maximum physical capacity available for Injection to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the declared sent-out capacity for the Facility's connection point(s). If your Facility does not have an overload Injection capacity, provide the maximum sent-out capacity at optimal operating conditions for the Facility.	Text Box	Numeric Value must be positive	MW	App 1(c)xxix. Deleted: The overload Injection capacity of the generator, if any, expressed in MW. Typically, any quantity above the specified nameplate value.¶ Deleted: is not applicable Deleted: Maximum Deleted: (for Non-Synergy facilities) or generated capacity (for Synergy facilities) when operating Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<u>This field sets the maximum absolute value that may be submitted for Injection in Real-Time Market Submissions.</u>				
The overload Withdrawal capacity of the Facility, if any, expressed in MW [Appendix 1(c)xxx.]	<p><u>This is the maximum Withdrawal capacity at optimal operating conditions for the Facility, that AEMO may use during an Emergency Operating State in the SWIS.</u></p> <p><u>This represents the maximum physical capacity available for Withdrawal to AEMO under an Emergency Operating State for the SWIS. This value does not need to match the contracted maximum demand for the Facility's connection point(s).</u></p> <p><u>If your Facility does not have an overload withdrawal capacity, provide the maximum Withdrawal capacity of the Facility under optimal conditions.</u></p> <p><u>This field sets the maximum absolute value that may be submitted for Withdrawal in Real-Time Market Submissions.</u></p>	Text Box	Numeric Value must be positive	MW	App 1(c)xxx.
The short circuit capability of Facility equipment [Appendix 1(c)xxxi.]	<p>Details the circuit fault devices and ratings.</p> <p>The circuit fault devices identity information should match those identified on the Single Line Diagram (Appendix 1.(b).xxi)</p> <p>Typically, short circuit ratings of primary plant such as circuit breakers are provided at the point of connection and downstream busbar.</p>	File Upload	<p>Data required in kiloamps for each circuit making/breaking device in the generator connection circuit.</p> <p>File format should be .csv with the following fields on each line</p> <ul style="list-style-type: none"> • sequence_number (integer 3), • facility_identity (character 24), • circuit_fault_make_break_device_identity (character 24), • fault_make_rating (real 8:5 with exponent), • fault_break_rating (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p>	N/A	App 1(c)xxxi.
Evidence that the communication and control systems required by section	This field is redundant, instead participants should have uploaded this information in a document called the "Communication Protocol" in the Facility General Information Change Request under the field of "Details	File Upload	<u>As this field is mandatory in WEMS MPI please attach a document with the following wording:</u>	N/A	App 1(c)xxx.

Deleted: The

Deleted: generator, if any, expressed in MW. Typically, any quantity above the specified nameplate value

Deleted: If overload Withdrawal capacity is not applicable, provide the maximum capacity withdrawn from the SWIS at the connection point, withdrawn is at optimal conditions.

Deleted: and

Deleted: ,

Deleted: Word document with the below text, as the field is mandatory in WEMS MPI:!

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
2.35 are in place and operational [Appendix 1(c)xxxii]	of the operational control over the Facility”, refer to Section 3.1 of this Technical Guide.		“The Communication Protocol will or has been submitted in the Facility General Information Change Request under the field of Details of the operational control over the Facility.”		
The single line diagram for the Facility, including the locations of transformers, switches, operational and settlement meters [Appendix 1(c)xxxiii.]	<p>Details the locations of transformers, switches, operational and settlement meters.</p> <p>Same information and format required as for network topology.</p> <p>Any other related data should include generator winding configuration (e.g. connection delta, star, other).</p> <p>Operations data is also required to allow AEMO to model the connecting network and its equipment capabilities.</p> <p>Data required includes:</p> <ul style="list-style-type: none"> • circuit ratings in amps calculated as the rating of the lowest rated series connected item of plant in a circuit • circuit high and low voltage limits in kilovolts (kV) – determined from the rating of the equipment comprising the circuit components (e.g. voltage and current transformers, surge diverters, transformers, insulation, etc.). • Fault make/fault break capability for each circuit making/breaking device in a circuit. 	File Upload	<p>AEMO requires clearly labelled single line diagrams in Adobe Acrobat format (.dxf, .dgn or .pdf files).</p> <p>Diagrams must include the location of transformers, switches, operation and interval meters (which are to be maintained in the Meter Registry)</p> <p>Diagrams must illustrate the following.</p> <p>Circuit rating:</p> <ul style="list-style-type: none"> • circuit_identity • circuit_rating_amps (real 8:3), • circuit_high_kvolt_limit (real 8:3), • circuit_low_kvolt_limit (real 8:3) <p>Circuit fault make and break capability:</p> <ul style="list-style-type: none"> • circuit_identity (character 24), • circuit_fault_make_break_device_identity (character 24), • fault_make_rating (real 8:5 with exponent), • fault_break_rating (real 8:5 with exponent) <p>Diagrams must be kept up to date and revised diagrams with amendments clearly indicated to AEMO in accordance with the WEM Rules.</p>	N/A	Appendix 1(c)xxxiii.
The network node or nodes at which the Facility can connect [Appendix 1(c)xxxiv.]	<p>The network nodes at which the facility can connect (if more than one).</p> <p>If the facility can be connected at more than one connection point, the alternate connection points should be detailed.</p>	File Upload	<p>The name of the network node at which the facility is connected.</p> <p>If <u>the</u> facility can connect at more than one node a circuit single line diagram in similar format as the facility single line diagram showing each network connection node and the circuit elements in each</p>	N/A	Appendix 1(c)xxxiv.

October 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	Note that the primary connection point is entered in the field "Connection Point". For a facility without an alternate connection point, please submit a file with the message "Only 1 connection point for this facility."		connection node. The connection node should include the busbar name, number and section of that busbar if there is more than one section. The description must be completely unambiguous.		
The Transmission Node Identifier [Appendix 1(c)xxxv.]	The Transmission Node Identifier for the Facility.	Text Box	<u>4-digit</u> alphanumeric TNI value. <u>The TNI value can be confirmed by the meter data agent (i.e. Western Power).</u>	N/A	Appendix 1(c)xxxv.
National Meter Identifier (NMI) of each metering point for the Facility, where applicable [Appendix 1(c)xxxvi]	The National Meter Identifier (NMI) of each metering point for the Facility.	Text Box	<u>10-digit</u> NMI value. If multiple NMIs are applicable then use commas to separate, with a single space. <u>The NMI value can be confirmed by the meter data agent (i.e. Western Power).</u>	N/A	Appendix 1(c)xxxvi.
The Metering Data Agent for the Facility [Appendix 1(c)xxxvii.]	The Metering Data Agent for the facility. One Meter Data Agent must be selected.	Drop down list	Only one option may be selected. <u>(i.e. WPNTWK)</u>	N/A	Appendix 1(c)xxxvii.
FCESS & ROCOF Ride-Through Capability					
Frequency Co-optimised Essential System Service Accreditation Parameters [Appendix 1(h).]	Frequency Co-optimised Essential System Service Accreditation Parameters approved by AEMO. If this field is not applicable, please leave <u>the</u> field blank	File Upload	<u>If this field is not applicable, please leave field blank.</u> <u>The template FCESS Accreditation Form is available here and the form must be approved by AEMO prior to submitting in WEMS.</u> <u>This must be in excel format and must be the same version AEMO approved.</u> <u>Further information on FCESS Accreditation process is available here.</u>	N/A	Appendix 1(h).
RoCoF Ride-Through Capability of the Facility as determined by AEMO [Appendix 1(i).]	RoCoF Ride-Through Capability of the Facility as determined by AEMO. <u>If AEMO has not made a separate determination under paragraph 11.2.6 of the FCESS Accreditation WEM Procedure (link here) then the value of 0.25 Hz over 500ms (RoCoF Safe Limit) must be submitted.</u>	Text Box	Numeric Value must be positive <u>If you intend to apply for a separate determination for RoCoF Ride-Through Capability then information on the process is available here.</u> <u>Facilities with a RoCoF Ride-Through capability value above the RoCoF Ride-Through Cost</u>	<u>Hz over 500ms</u> 500ms	Appendix 1(i).

Deleted: If multiple TNIs are applicable then use commas to separate, with a single space.

Deleted: ,

Deleted: The FCESS [Accreditation Form](#) which has been reviewed and approved by AEMO.† This must be in excel format and must be the same version AEMO approved.

Deleted: MWs

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<u>Published RoCoF Ride-Through Capability values are also available in the link (here) under the sheet "Current RoCoF Ride-Through Values".</u>		<u>Recovery Limit will not be deemed causers of the RoCoF Control Service and will be excluded from recovery of the costs of the control service.</u>		
WEMDE and Operational Planning Data					
Normally-on Load	<p><u>A Facility, for which the forecast quantity of Withdrawal is already accounted for in the Forecast Operational Demand.</u></p> <p><u>By having normally-on load ticked, the following applies:</u></p> <p><u>1. The Withdrawal quantity for the Facility is already forecasted by AEMO and accounted for in the Forecast Unscheduled Operational Demand; and</u></p> <p><u>2. The Market Participant for this Facility must still bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status) as it does not change a Market Participant rule obligation to submit a market Withdrawal quantity.</u></p> <p><u>By having normally-on load unticked, the following applies:</u></p> <p><u>1. The Withdrawal quantity for the Facility is not forecasted by AEMO and will not be accounted for in the Forecast Unscheduled Operational Demand; and</u></p> <p><u>2. The Market Participant for this Facility must bid their Withdrawal quantity in their RTMS (exceptions may apply for Facilities with Intermittent Load status).</u></p> <p><u>If you are unsure, please leave as unticked for "No". AEMO will review your circumstances and notify you if the value should be a "Normally-on Load".</u></p>	Tick Box	Ticked = Yes, Unticked = No	N/A	2.1A.2.(m) and the Market Schedule Proc...
Storage Constraints	<p>Where there are limitations on the Injection or Withdrawal capability of a Registered Facility based on the Charge Level of associated Electric Storage Resources.</p> <p><u>If the Facility does not contain an Electric Storage Resource (battery) it must be left unticked.</u></p>	Tix Box	Ticked = Yes, Unticked = No	N/A	7.5.1 7.5.1

Deleted: will be not be

Deleted: If this field is not applicable, please leave field blank

Deleted: Defines whether AEMO treats this Facility as a normally-on load for the purposes of the Dispatch Algorithm. A...

Deleted: is one which

Deleted: ,

Deleted: therefore needs

Deleted: flagged to avoid double counting.

Formatted: Font: Font color: Black, (Asian) Korean

Formatted: Font: (Default) +Body (Segoe UI Semilight), (Asian) Korean

Formatted: Font: Font color: Black, (Asian) Korean

Deleted: ¶

Deleted: ¶

----- 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Inertia	<p>The kinetic energy (at nominal frequency) that is extracted from the rotating mass of a machine coupled to the power system to compensate <u>for</u> an imbalance in the system frequency.</p> <p>Alternatively, the 'synthetic inertia' provided by non-rotating machines which can be programmed to provide inertia to the system. An example is inverter-based technology.</p> <p><u>If the Facility does not provide inertia then enter a value of zero (e.g. wind farms and solar farms typically do not provide inertia).</u></p> <p><u>Otherwise, if you Facility does provide inertia, the value should be one of the following:</u></p> <ul style="list-style-type: none"> <u>If the Facility has been accredited for RoCoF control service, the value approved by AEMO;</u> or <u>If the Facility has not been accredited for RoCoF control service then the inertia value submitted must reflect the sum of all inertia values in the manufacturer's data sheets for all the generation systems behind the Facility's connection point(s); or</u> <p><u>If neither of the above information is available then to contact wa.operations@aemo.com.au so AEMO can assist you in deriving an appropriate value.</u></p>	Text Box	Numeric	MWs	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph 2.4.2(a))
Tau Factor	<p><u>The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure; or if it has not undergone the Accreditation process the value must be "999".</u></p>	Text Box	Numeric	N/A	2.1A.2.(m) and the WEM Procedure: FCESS
Unconstrained Forecasts	<p>This determines where the Unconstrained Forecast Source for the Primary Dispatch Interval or Primary Pre-Dispatch Intervals will come from:</p>	Drop Down	<p>Can only select one:</p> <ul style="list-style-type: none"> RTMS 	N/A	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph 7.2.1)

Deleted:

Field Code Changed

Deleted: The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure....

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	<p><u>AEMO recommends the following forecast types for the respective Facility Classes:</u></p> <ul style="list-style-type: none"> <u>Scheduled Facility, Demand Side Programme and Interruptible Load must specify RTMS</u> <u>Semi-Scheduled Facility should specify SCADA</u> <u>Non-Scheduled Facility should specify Persistence</u> <p><u>If you operate a Semi-Scheduled Facility or Non-Scheduled Facility and you would prefer to submit a forecast type other than that outlined above, you must email wa.operations@aemo.com.au to have AEMO assess the suitability of an alternate forecast type.</u></p>		<ul style="list-style-type: none"> SCADA PERSISTENCE		Schedules Procedure.
If the Facility has an Electric Storage Resource, the normal ramp rate upwards whilst withdrawing, expressed as MW/min	<p><u>Normal ramp up</u> (change towards injection) on as generated basis</p> <p><u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u></p>	Text Box	Numeric Value must be positive	MW/min	2.1A
If the Facility has an Electric Storage Resource, the normal ramp rate downwards whilst withdrawing, expressed as MW/min	<p><u>Normal ramp down</u> (change towards withdrawal) on as generated basis</p> <p><u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u></p>	Text Box	Numeric Value must be positive	MW/min	2.1A
If the Facility has an Electric Storage Resource, the emergency ramp rate upwards whilst withdrawing, expressed as MW/min	<p>Emergency Ramp up (change towards injection)</p> <p>If Emergency Ramp up is not applicable, provide the <u>normal ramp up</u> (change towards injection) on as generated basis.</p> <p><u>If your Facility does not have an Electric Storage Resource (battery) leave this field blank.</u></p>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m)
If the Facility has an Electric Storage Resource, the emergency ramp rate downwards whilst withdrawing, expressed as MW/min	<p>Emergency Ramp down (change towards withdrawal)</p> <p>If Emergency Ramp down is not applicable, provide the <u>normal ramp down</u> (change towards withdrawal) on as generated basis.</p>	Text Box	Numeric Value must be positive	MW/min	2.1A.2.(m)

Deleted: different

Deleted: If Facility is a SSF must specify source of RTMS, SCADA or persistence.¹
If a Facility is not a NSF, this can be defaulted to "RTMS".

Deleted: Ramp

Deleted: Ramp

Deleted: R

Deleted: amp

Deleted: Ramp

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	If your Facility does not have an Electric Storage Resource (battery) leave this field blank.				
If the Facility has an Electric Storage Resource, the Minimum State of Charge Capacity, expressed as a percentage (%)	State of Charge (%) should be expressed relative to the total usable (dispatchable) storage quantity of the Facility, at optimal conditions, where the usable quantity may be lower than the Facility's nominal capacity. If your Facility does not have an Electric Storage Resource (battery) leave this field blank.	Text Box	Numeric Value must be positive	%	2.1A.2.(m)
If the Facility has an Electric Storage Resource, the Facility's Electric Storage Resource's total MWh capacity	The usable (dispatchable) storage quantity of the Electric Storage Resource, where the usable quantity may be lower than the Facility's nominal capacity. If your Facility does not have an Electric Storage Resource (battery) leave this field blank.	Text Box	Numeric	MWh	2.1A.2.(m)

4.6 Non-Dispatchable Load

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Non-Dispatchable Load					
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i
Intermittent Load Status	Specify whether the facility is an Intermittent Load. <ul style="list-style-type: none"> Non-Dispatchable Load with Intermittent Load status under clause 1.48.2 ("Grandfathered IML") Non-Dispatchable Load with Intermittent Load status under clause 2.30B.2 ("New IML"); or Non-Dispatchable Load without Intermittent Load 	Drop down	Only one option may be selected	N/A	System Requirement
Intermittent Load Standing Data					

Deleted: 1

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The identity of the metering points measuring the Intermittent Loads [Appendix 1(g)i.]	The National Meter Identifier (NMI) of each metering <u>point</u> measuring the Intermittent Loads.	Text Box	<u>10-digit</u> NMI value. If multiple NMIs are applicable then use commas to separate, with a single space	N/A	[Appendix Deleted: points
For all metering points identified in Appendix 1(g)i, the aggregated maximum allowed level of Intermittent Load, in <u>MWh per Trading Interval</u> [Appendix 1(g)ii.]	The aggregated maximum allowed level of Intermittent Load behind the metering point(s), <u>expressed in MWh per Trading Interval</u> .	Text Box	Numeric	<u>MWh/Trading Interval</u>	[Appendix 1(g)ii.]
For all metering points identified in Appendix 1(g)i, the aggregated maximum level of net consumption at that meter which is not separately metered, and which is not Intermittent Load, in <u>MWh per Trading Interval</u> [Appendix 1(g)iii.]	The aggregated maximum level of net consumption at that meter which is not separately metered, and which is not Intermittent Load, <u>expressed in MWh per Trading Interval</u> .	Text Box	Numeric	<u>MWh/Trading Interval</u>	[Appendix 1(g)iii.] Deleted: in MW
For all metering <u>points</u> identified in Appendix 1(g)i, the separately metered Energy Producing Systems and Loads behind that meter which are not to be included in the definition of that Intermittent Load [Appendix 1(g)iv.]	For all metering points identified in Appendix 1(g)i, a single line diagram for the Facility, that identifies any separately <u>revenue(tariff) metered</u> Energy Producing Systems and Loads behind that meter which are not to be included in the definition of that Intermittent Load. <u>If there are not separately revenue(tariff) metered Energy Producing Systems and Loads behind the metering points identified in Appendix 1(g)i then this field must be left blank.</u>	File Upload	A <u>Word</u> document or pdf.	N/A	Appendix Deleted: point Deleted: word
Where the Load or part of the Load is and continues to be deemed to be an Intermittent Load under clause 1.48.2, provide the following: (Grandfathered IML only)					
Anticipated reduction, measured in MW, in the maximum capacity described in clause 2.30B.3(a) when the ambient temperature is 45 degrees Celsius [MR2.30B.3.(b)i.]	Anticipated reduction in the maximum capacity that the generating system can be guaranteed to have available to supply Intermittent Load when the ambient temperature is 45°C.	Text Box	Numeric	MW	2.30B.3.(b)i.

~~Deleted:~~ 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The method to be used for determining the ambient temperature at the site of the Energy Producing System referred to in clause 2.30B.2(a) for the purpose of determining Intermittent Load Refunds. (where if no method is specified, a constant temperature of 41 degrees Celsius will be assumed) [MR2.30B.3.(b)ii.]	<p>One of the following methods must be chosen:</p> <ul style="list-style-type: none"> • 41 °C • SCADA • BOM <p><u>If the Energy Producing System is not temperature dependent, is comprised of Intermittent Generations Systems; or does not have SCADA nor BOM temperature measurements, then a value of 41 °C must be submitted.</u></p>	Drop Down	Can only select one option	N/A	2.30B.3.(b)ii.
Temperature Location	Location of BOM or SCADA temperature station	Drop Down	<p>Can only select one options.</p> <p>For SCADA one of the following:</p> <ul style="list-style-type: none"> • CKB AMBIENT C • KMP AMBIENT C • MGA AMBIENT C • PJR AMBIENT C <p>For BOM one of the following: Albany Airport, Badgingarra, Bickley, Bunbury, Collie East, Dwellingup, Garden Island HSF, Geraldton Airport 8351, Hopetoun North, Jandakot Aero, Kalgoorlie-Boulder Airport, Mandurah, Pearce RAAF, Perth Airport, Perth Metro, Rottnest Island, Southern Cross Airfield, Swanbourne.</p>	N/A	2.30B.3.(b)ii.
Nominations of capacity requirements for Intermittent Loads, deemed to be Intermittent Loads under clause 1.48.2, expressed in MW, where the nominated quantity cannot exceed the greater of value defined in clause 4.28.8 (c). and 4.28.8 (c)ii. [4.28.8 (c).]	Nominations of capacity requirements for "grandfathered" Intermittent Loads, expressed in MW, where the nominated quantity cannot exceed the greater of value defined in clause 4.28.8 (c). and 4.28.8 (c)ii.	Text Box	Numeric	MW	4.28.8 (c).

Deleted: <#>41 degrees!

Intermittent Load Information to be provided under clause 2.30B.3

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The maximum capacity in MW, excluding capacity for which Capacity Credits are held, that the Energy Producing System referred to in clause 2.30B.2(a) can be guaranteed to have available to supply Intermittent Load, when it is operated normally at an ambient temperature of 41 degrees Celsius [MR 2.30B.3.(a).]	As per the description in the data field.	Text Box	Numeric	MW	2.30B.3.(a)
Details of primary and any alternative fuels, including details and evidence of both firm and non-firm fuel supplies and the factors that determine restrictions on fuel availability that could prevent the Energy Producing System referred to in clause 2.30B.2(a) from operating at its full capacity [MR 2.30B.3.(c).]	As per the description in the data field.	File Upload	A Word document or pdf .	N/A	2.30B.3.(c): Deleted: word
Single line diagram which includes details of the Loads and Energy Producing Systems contained within the Facility and any other information AEMO requires to determine whether the Load meets the conditions specified in clause 2.30B2 [MR 2.30B.3.(d).]	As per the description in the data field.	File Upload	A Word document or pdf .	N/A	2.30B.3.(d): Deleted: w
The Nominated Excess Capacity [MR 2.30B.3.(e).]	In respect of a Facility containing an Intermittent Load, the maximum quantity of Injection (in MW) that the Market Participant intends the Facility to make in any Dispatch Interval, which must not be exceeded in more than 120 Dispatch Intervals within any continuous 12-month period.	Text Box	Numeric	MW	2.30B.3.(e).
Declared Sent Out Capacity and any other information AEMO requires to determine the System Size of the Facility [MR 2.30B.3.(f).]	The declared sent-out capacity is s the maximum amount of power that the generator has contracted with the Network Operator to export to the network.	File Upload	A Word document or pdf .	MW	2.30B.3.(f): Deleted: w

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Optional - Information regarding protection schemes at the Facility, including whether the Facility is configured to automatically adjust load or generation where a Contingency Event, or an event behind the relevant connection point, affects the Energy Producing System, and evidence to support that configuration as required in the WEM Procedure referred to in clause 2.29.4N [MR 2.30B.3(g).]	Where a protection scheme has been implemented downstream for an Energy Producing System to manage its net injection/withdrawal, details of how the scheme operates and for which specific conditions <u>are</u> required. Details of contingencies triggering the scheme, <u>operation</u> times, and impact on net output should be specified.	File Upload	A <u>document, e.g. Word, Excel, or pdf.</u> Including relevant Single Line Diagrams and protection scheme settings.	N/A	2.30B.3(g). Deleted: Wword Deleted: Deleted: is Deleted: operate
If applicable, I have provided AEMO the instantaneous output or consumption of the Energy Producing System referred to in clause 2.30B.2(a), with separate measurements for each separate electricity producing unit in the Energy Producing System [MR 2.30B.3(h).]	<u>As per the description in the data field.</u>	Tick box	Ticked = Yes, Unticked = No	N/A	2.30B.3(h).
Contract Maximum Demand associated with the Facility [MR 2.30B.3(j).]	For a contracted point, means the maximum energy (MW) at which a user is permitted to transfer electricity <u>from</u> the network.	Text Box	Numeric	MW	2.30B.3(j). Deleted: out of
FCESS & ROCOF Ride-Through Capability					
RoCoF Ride-Through Capability of the Facility as determined by AEMO [Appendix 1(i).]	RoCoF Ride-Through Capability of the Facility as determined by AEMO. <u>If AEMO has not made a separate determination under paragraph 11.2.6 of the FCESS Accreditation WEM Procedure (link here) then the value of 0.25 Hz over 500ms (RoCoF Safe Limit) must be submitted.</u> <u>Published RoCoF Ride-Through Capability values are also available in the link (here) under the sheet "Current RoCoF Ride-Through Values"</u>	Text Box	Numeric Value must be positive <u>If you intend to apply for a separate determination for RoCoF Ride-Through Capability then information on the process is available here.</u> <u>Facilities with a RoCoF Ride-Through capability value above the RoCoF Ride-Through Cost Recovery Limit, will not be deemed causers of the RoCoF Control Service and will be excluded from recovery of the costs of the control service.</u>	<u>Hz over 500ms</u>	Appendix Deleted: MWs Deleted: will be not be

Deleted: 2023

4.7 Interruptible Load

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Interruptible Load					
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i.
Evidence that the communication and control systems required by section 2.35 are in place and operational [Appendix 1(e)i.]	This field is redundant and instead, participants should have uploaded this information in a document called the "Communication Protocol" in the Facility General Information Change Request under the field of "Details of the operational control over the Facility", refer to Section 3.1 of this Technical Guide.	File Upload	<p><u>As this field is mandatory in WEMS MPI please attach a document with the following wording:</u></p> <p>"The Communication Protocol will or has been submitted in the Facility General Information Change Request under the field of Details of the operational control over the Facility."</p>	N/A	Appendix 1(e)i.
Details of the real-time telemetry capabilities [Appendix 1(e)ii.]	Details of telemetry system, including band width, polling frequency etc.	File Upload	A word document or pdf	N/A	Appendix 1(e)ii.
The short circuit capability of Facility equipment [Appendix 1(e)iii.]	<p>Details the circuit fault devices and ratings.</p> <p>The circuit fault <u>devices'</u> identity information should match those identified on the Single Line Diagram (Appendix 1.(b).xxi)</p> <p>Typically, short circuit ratings of primary <u>plants</u> such as circuit breakers are provided at the point of connection and downstream busbar.</p>	File Upload	<p>Data required in kiloamps for each circuit making/breaking device in the generator connection circuit.</p> <p>File format should be .csv with the following fields on each line</p> <ul style="list-style-type: none"> • sequence_number (integer 3), • facility_identity (character 24), • circuit_fault_make_break_device_identity (character 24), • fault_make_rating (real 8:5 with exponent), • fault_break_rating (real 8:5 with exponent) <p>The first line is to indicate the field names as above.</p> <p>File template can be found on the following link (here)</p>	N/A	Appendix 1(e)iii.

Deleted: ¶

Deleted: ¶

Deleted: Word document with the below text, as the field is mandatory in WEMS MPI: ¶

Deleted: devices

Deleted: plant

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The single line diagram for the Facility, including the locations of transformers, switches, operational and settlement meters, if applicable [Appendix 1(e)iv.]	<p>Details the locations of transformers, switches, operational and settlement meters.</p> <p>Same information and format required as for network topology.</p> <p>Any other related data should include generator winding configuration (e.g. connection delta, star, other).</p> <p>Operations data is also required to allow AEMO to model the connecting network and its equipment capabilities.</p> <p>Data required includes:</p> <ul style="list-style-type: none"> • circuit ratings in amps calculated as the rating of the lowest rated series connected item of plant in a circuit • circuit high and low voltage limits in kilovolts (kvolt) – determined from the rating of the equipment comprising the circuit components (e.g. voltage and current transformers, surge diverters, transformers, insulation, etc.). • Fault make/ fault break capability for each circuit making/breaking device in a circuit. 	File Upload	<p>AEMO requires clearly labelled single line diagrams in Adobe Acrobat format (.dxf, .dgn or .pdf files).</p> <p>Diagrams must include the location of transformers, switches, operation and interval meters (which are to be maintained in the Meter Registry)</p> <p>Diagrams must illustrate the following.</p> <p>Circuit rating:</p> <ul style="list-style-type: none"> • circuit_identity • circuit_rating_amps (real 8:3), • circuit_high_kvolt_limit (real 8:3), • circuit_low_kvolt_limit (real 8:3) <p>Circuit fault make and break capability:</p> <ul style="list-style-type: none"> • circuit_identity (character 24), • circuit_fault_make_break_device_identity (character 24), • fault_make_rating (real 8:5 with exponent), • fault_break_rating (real 8:5 with exponent) <p>Diagrams must be kept up to date and revised diagrams with amendments clearly indicated to AEMO in accordance with the WEM Rules.</p>	N/A	Appendix 1(e)iv.
The network nodes at which the Associated Loads of the Facility can connect [Appendix 1(e)v.]	<p>The network nodes at which the facility can connect (if more than one).</p> <p>If the facility can be connected at more than one connection point, the alternate connection points should be detailed.</p> <p>Note that the primary connection point is entered in the field "Connection Point". For a facility without an alternate connection point, please submit a file with the message "Only 1 connection point for this facility."</p>	File Upload	<p>The name of the network node at which the facility is connected.</p> <p>If facility can connect at more than one node a circuit single line diagram in similar format as the facility single line diagram showing each network connection node and the circuit elements in each connection node.</p> <p>The connection node should include the busbar name, number, and section of that busbar if there is more than one section. The description must be completely unambiguous.</p>	N/A	Appendix 1(e)v.

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The Transmission Node Identifier [Appendix 1(e)vi.]	The Transmission Node Identifier for the Facility	Text Box	4-digit alphanumeric TNI value. The TNI value can be confirmed by the meter data agent (i.e. Western Power).	N/A	Appendix 1(e)vi.
WEMDE & Operational Planning Data					
Normally-on Load	For an Interruptible Load this must be unticked.	Tick Box	Ticked = Yes, Unticked = No	N/A	2.1A.2.(m) and Market Scheduling Procedure.
Storage Constraints	Where there are limitations on the Injection or Withdrawal capability of a Registered Facility based on the Charge Level of associated Electric Storage Resources. For an Interruptible Load, this must be unticked.	Tick Box	Ticked = Yes, Unticked = No	N/A	7.5.10 and
Inertia	The kinetic energy (at nominal frequency) that is extracted from the rotating mass of a machine coupled to the power system to compensate for an imbalance in the system frequency. Alternatively, the 'synthetic inertia' provided by non-rotating machines which can be programmed to provide inertia to the system. An example is inverter-based technology. For an Interruptible Load, this must be zero.	Text Box	Numeric	MWs	2.1A.2.(m) and WEM Procedure: FCESS Accreditation (paragraph 2.4.2(a))
Tau Factor	The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure; or if it has not undergone the Accreditation process the value must be "999" .	Text Box	Numeric	N/A	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph
Unconstrained Forecasts	This determines where the Unconstrained Forecast Source for the Primary Dispatch Interval or Primary Pre-Dispatch Intervals will come from: For an Interruptible Load, this must be RTMS.	Drop Down	Can only select one: <ul style="list-style-type: none"> RTMS SCADA PERSISTENCE 	N/A	2.1A.2.(m) and the Market Scheduling Procedure.

Deleted: If multiple TNIs are applicable then use commas to separate, with a single space.

Deleted: Defines whether AEMO treats this Facility as a normally-on load for the purposes of the Dispatch Algorithm. A normally-on load is one which is already accounted for in the Forecast Unscheduled Operational Demand, and therefore needs to be flagged to avoid double counting.

Deleted: ¶

Deleted: ¶

Deleted: ¶
For an Interruptible Load this

Deleted: If Facility is a SSF must specify source of RTMS, SCADA or persistence. ¶
If a Facility is not a NSF, this can be defaulted to "RTMS".

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Frequency Co-optimised Essential System Service Accreditation Parameters [Appendix 1(h).]	Frequency Co-optimised Essential System Service Accreditation Parameters approved by AEMO.	File Upload	<p><u>If this field is not applicable, please leave field blank.</u></p> <p><u>The template FCESS Accreditation Form is available here and the form must be approved by AEMO prior to submitting in WEMS.</u></p> <p><u>This must be in excel format and must be the same version AEMO approved.</u></p> <p><u>Further information on FCESS Accreditation process is available here.</u></p>	N/A	Appendix 1(h).
NDL Association information for clause 2.29.5					
NDL Association form for <u>an</u> Interruptible Load [2.29.5B.]	<u>Complete and attach the NDL association from the following website (here)</u>	File Upload	Excel	N/A	2.29.5B.
Evidence that the Market Participant owns the Non-Dispatchable Load or has entered into a contract with the person who owns, operates or controls the Non-Dispatchable Load [2.29.5B(a).]	<u>As per the description in the data field.</u>	File Upload	<p>Zip folder attachment. That will contain multiple PDFs (<u>1</u> per Non-Dispatchable Load) in the zipped attachment.</p> <p>For each PDF name it after 10-digit NMI of the Non-Dispatchable Load.</p>	N/A	2.29.5B(a).

Deleted: The FCESS [Accreditation Form](#) which has been reviewed and approved by AEMO.¹ This must be in excel format and must be the same version AEMO approved.

Deleted: 2023

4.8 Demand Side Programme

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Demand Side Programme					
Facility Name	The WEMS Facility Code. This field is pre-populated.	Pre-populated	Text	N/A	2.33.3(c)i.
The maximum number of hours per day that the Facility will be available to provide Reserve Capacity if issued a Dispatch Instruction [Appendix 1(f)i.]	As per the data field description.	Text Box	Numeric between 0 and 24 Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.	Hours	Appendix 1(f)i.
For Business Days, the start interval of availability for dispatch (Appendix 1.(f).ii)	For Business Days, the start of the interval time the DSP is available for dispatch, recorded as 24HH:MM.	Input Stepper	Hour, Minute Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.	Minutes	Appendix 1.(h).ix
For Business Days, the end interval of availability for dispatch (Appendix 1.(f).ii)	For Business Days, the end of the interval time the DSP is available for dispatch, recorded as 24HH:MM.	Input Stepper	Hour, Minute Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.	Minutes	Appendix 1.(h).ix
For Non-Business Days, the start interval of availability for dispatch (Appendix 1.(f).ii)	For Non-Business Days, the start of the interval time the DSP is available for dispatch, recorded as 24HH:MM.	Input Stepper	Hour, Minute Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.	Minutes	Appendix 1.(h).ix
For Non-Business Days, the end interval of availability for dispatch (Appendix 1.(f).ii)	For Non-Business Days, the end of the interval time the DSP is available for dispatch, recorded as 24HH:MM.	Input Stepper	Hour, Minute Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.	Minutes	Appendix 1.(h).ix
Any restrictions on the availability of the Demand Side Programme (Appendix 1.(f).iii)	Details of any restrictions of the facility. Only information not already recorded in Appendix 1(h) should be included. This information must match any restrictions recorded during Reserve Capacity certification.	File Upload	A word document or pdf.	N/A	Appendix 1.(h).x

Deleted: ,

Deleted: ,

Deleted: ,

Deleted: ,

Deleted: RC

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The minimum notice period (in minutes) required for dispatch under clause 7.6.15 of the Facility [Appendix 1(f)iv.]	The minimum response time before the Demand Side Programme can begin to respond to an instruction from AEMO to change its output.	Text Box	Numeric between 0 and 120 <u>minutes</u> . <u>Please note minimum requirements are specified in clause 4.10.1(f) of WEM Rules.</u>	Minutes	Appendix 1(f)iv.
Evidence that the communication and control systems required by clause 2.35 are in place and operational [Appendix 1(f)v.]	This field is redundant, instead, participants should have uploaded this information in a document called the "Communication Protocol" in the Facility General Information Change Request under the field of "Details of the operational control over the Facility", refer to Section 3.1 of this Technical Guide.	File Upload	<u>As this field is mandatory in WEMS MPI please attach a document with the following wording:</u> "The Communication Protocol will or has been submitted in the Facility General Information Change Request under the field of Details of the operational control over the Facility."	N/A	Appendix 1(f)v.
Details of the real-time telemetry capabilities of the Facility [Appendix 1(f)vi.]	The details of the real-time telemetry capabilities of the Facility.	File Upload	A word document or pdf.	N/A	Appendix 1,(h).viii
The Transmission Node Identifier [Appendix 1 (f)vii.]	The Transmission Node Identifier for the Facility.	Text Box	4-digit alphanumeric TNI value. <u>The TNI value can be confirmed by the meter data agent (i.e. Western Power).</u>	N/A	Appendix 1 (f)vii.
WEMDE & Operational Planning Data					
Normally-on Load	<u>For a Demand Side Programme this must be unticked.</u>	Tick Box	Ticked = Yes, Unticked = No	N/A	2.1A.2.(m) and the Market Schedule Procedure.
Storage Constraints	Where there are limitations on the Injection or Withdrawal capability of a Registered Facility based on the Charge Level of associated Electric Storage Resources. <u>For a Demand Side Programme, this must be unticked.</u>	Tick Box	Ticked = Yes, Unticked = No	N/A	7.5.10 and 7.5.10A

Deleted: and

Deleted: Word document with the below text, as the field is mandatory in WEMS MPI: ¶

Deleted: If multiple TNIs are applicable then use commas to separate, with a single space.

Deleted: Defines whether AEMO treats this Facility as a normally-on load for the purposes of the Dispatch Algorithm. A normally-on load is one which is already accounted for in the Forecast Unscheduled Operational Demand, and therefore needs to be flagged to avoid double counting.¶

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Inertia	<p>The kinetic energy (at nominal frequency) that is extracted from the rotating mass of a machine coupled to the power system to compensate <u>for</u> an imbalance in the system frequency.</p> <p>Alternatively, the 'synthetic inertia' provided by non-rotating machines which can be programmed to provide inertia to the system. An example is inverter-based technology.</p> <p><u>For a Demand Side Programme this must be zero.</u></p>	Text Box	Numeric	MWs	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph 2.4.2(a))
Tau Factor	<p>The Facility Speed Factor for a Facility, as determined in accordance with the Frequency Co-optimised Essential System Services Accreditation WEM Procedure.</p> <p><u>For a Demand Side Programme this must be "999"</u></p>	Text Box	Numeric	N/A	2.1A.2.(m) and the WEM Procedure: FCESS Accreditation (paragraph 7.2.1)
Unconstrained Forecasts	<p>This determines where the Unconstrained Forecast Source for the Primary Dispatch Interval or Primary Pre-Dispatch Intervals will come from:</p> <p><u>For a Demand Side Programme this must be RTMS.</u></p>	Drop Down	<p>Can only select one:</p> <ul style="list-style-type: none"> • RTMS • SCADA • PERSISTENCE 	N/A	2.1A.2.(m) and the Market Schedules Procedure.

Deleted: If Facility is a SSF must specify source of RTMS, SCADA or persistence.¹
If a Facility is not a NSF, this can be defaulted to "RTMS".

Deleted: 2023

5. Reserve Capacity

5.1 Reserve Capacity Status

Data Field	Description	Field type	Format	Units	WEM Rule Requirement	Deleted: 1
Reserve Capacity Status						
Reserve Capacity Facility Status	<p>This field determines the status of the facility for the purposes of the Reserve Capacity Mechanism.</p> <p>By default, this box is set to "Proposed" when a facility is created.</p>	Drop down list	Only one option may be selected	N/A	Appendix 1 - Market Procedure for Declaration of Bilateral Trades	

5.2 Current Effective and Future Approved Facility Reserve Capacity Temperature Information

Data Field	Description	Field type	Format	Units	WEM Rule Requirement	Deleted: 1
Current Effective and Future Approved Facility Reserve Capacity Temperature Information						
Reference Number	<p>Internal reference for each Reserve Capacity Temperature Information Application / Change Request.</p> <p>This field is set and cannot be changed.</p>	Set field	Numeric	N/A	System Requirement	
Date Submitted	<p>Date and time reference for each Reserve Capacity Temperature Information Application / Change Request.</p> <p>This field is set and cannot be changed.</p>	Set field	Numeric	DD/MM/YYYY	System Requirement	
Application / Change Request Type	<p>Information on the type of Application / Change Request submitted by participant.</p> <p>This field is set and cannot be changed.</p>	Set field	Text	N/A	System Requirement	
Effective Date	<p>Date each respective Reserve Capacity Temperature Information Application / Change Request is to become effective.</p> <p>This field is set and cannot be changed.</p>	Set field	Numeric	DD/MM/YYYY	System Requirement	

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Status	Status of each Reserve Capacity Temperature Information Application / Change Request. This field is set and cannot be changed.	Set field	Text	N/A	System Requirement

5.3 Facility Reserve Capacity Temperature Information

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Facility Reserve Capacity Temperature Information					
Reserve Capacity Temperature Method	Displays the Reserve Capacity Temperature Method to be used in Reserve Capacity Obligation Quantity calculations and for Reserve Capacity Testing. This field is compulsory and one option must be selected: - BOM - SCADA - 41°C If the Energy Producing System is not temperature dependent or does not have SCADA nor BOM temperature measurements, then a value of 41 °C must be submitted.	Drop down list	Only one option may be selected	N/A	Clause of the WEM Rules 4.12.5.
RCOQ Temperature Location	Displays the Reserve Capacity Obligation Quantity (RCOQ) Temperature Location for the Facility. This field is available only if SCADA or BOM are selected as the Facility's Reserve Capacity Temperature Method. Participants must select one location from the menu.	Drop down list	Only one option may be selected	N/A	Clause of the WEM Rules 4.12.5.

Deleted: 2023

6. Facility Technology Type

6.1 Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Facility Technology Type Standing Data					
<p>The nameplate capacity of each Facility Technology Type in the Facility, excluding Loads.</p> <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	<p>Nameplate capacity of <u>each Facility Technology Type in the Facility</u>, as per the output subject to ratings of any primary plant or equipment.</p> <p>For synchronous generators this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters.</p> <p>Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves.</p>	Text Box	Numeric	MW	Appendix 1(b)vA. Deleted: 1
<p>The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network for the following Facility Technology Types in the Facility under optimal conditions, expressed in MW:</p> <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	<p>Maximum sent-out capacity for each of the specified Facility Technology Types <u>in the Facility</u>.</p> <p><u>If the Facility Technology Type field is not applicable please leave value as blank, do not enter zero.</u></p>	Text Box	Numeric	MW	Appendix 1(b)vA. Deleted: . Appendix 1(b)vC.
<p>The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply across the Electric Storage Resource Obligation Duration to the relevant Network from Electric Storage Resources in the Facility under optimal conditions, expressed in MW. [Appendix 1(b)vD.]</p>	<p><u>Only applicable if the Facility has an Electric Storage Resource (battery).</u></p> <p><u>Noting degradation of Electric Storage Resource capacity can occur, participants are recommended to update this value at least annually.</u></p> <p><u>If this field is not applicable please leave value as blank, do not enter zero.</u></p>	Text Box	Numeric	MW	Appendix 1(b)vD. Deleted: As per

Deleted: the data field description.¹
If this field is not applicable please leave field blank.

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Details of the fuel or fuels that each Non-Intermittent Generating System in the Facility can use, including dual fuel capabilities and the process for changing fuels. [Appendix 1(b)xiv.]	<p>If the facility is multi-fuel, list fuels and provide information for AEMO to understand limitations and direct the facility under emergency conditions, e.g:</p> <ul style="list-style-type: none"> lead time requirements, change over duration, requirement for the facility to de-synchronise, maintain certain output level, limit operation (duration) under alternative fuel type approach to initiating a change over. <p>If the facility is a single fuel Facility then a file with commentary such as "No dual fuel capability or relevant changeover processes"</p>	File Upload	A word document or pdf.	N/A	Appendix 1(b)xiv
The dependence of capacity on the type of fuel used by each Non-Intermittent Generating System in the Facility for each fuel described in Appendix 1(b)(xiv). [Appendix 1(b)xv.]	AEMO advises to leave this field blank, as we can refer to data provided under the dependence of sent out capacity on temperature at the location of the Facility [Appendix 1(b)vii.]	File upload	N/A	MW	Appendix 1(b)xv
<p>The minimum time before each Facility Technology Type in the Facility can be restarted after it is shut down, excluding Loads. (Minimum Restart Time).</p> <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	<p>As per description in the data field.</p> <p>If this field is not applicable, please leave field as zero.</p>	Input Stepper	Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(b)xvi

Deleted: a

Deleted: As per description in the data field. If this field is not applicable please leave field blank.

Deleted: Where multiple fuel types may be utilised for a single Generating Unit type, the max capacity associated with each fuel type.

Each fuel type is required to be expressed in terms of generated MW and at ambient temperature of 45°C, or higher if specified by the Network Operator based on physical location....

Deleted: A word document or pdf.

Deleted: .

Deleted: a

Deleted: value

6.2 Semi-Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
<p>The nameplate capacity of each Facility Technology Type in the Facility, excluding Loads.</p> <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	<p>Nameplate capacity of each Facility Technology Type in the Facility, as per the output subject to ratings of any primary plant or equipment.</p> <p>For synchronous generators, this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters.</p>	Text Box	Numeric	MW	Appendix 1(b)xvii

Deleted: facility

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves. <u>If the Facility Technology Type field is not applicable please leave value as blank, do not enter zero.</u>				
The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network for the following Facility Technology Types in the Facility under optimal conditions, expressed in MW: <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	Maximum sent-out capacity for each of the specified Facility Technology Types <u>in the Facility</u> . <u>If the Facility Technology Type field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(c)vC. Deleted: 1
The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply across the Electric Storage Resource Obligation Duration to the relevant Network from Electric Storage Resources in the Facility under optimal conditions, expressed in MW. [Appendix 1(c)vD.]	<u>Only applicable if the Facility has an Electric Storage Resource (battery). If not applicable leave blank.</u> <u>Noting degradation of Electric Storage Resource capacity can occur, participants are recommended to update this value at least annually.</u> <u>If this field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(c)vC. Deleted: As per the data field description. Deleted: . [Appendix
Details of the fuel or fuels that each Non-Intermittent Generating System in the Facility can use, including dual fuel capabilities and the process for changing <u>fuels</u> . [Appendix 1(c)xv.]	<u>If the facility is multi-fuel, list fuels and provide information for AEMO to understand limitations and direct the facility under emergency conditions, e.g:</u> <ul style="list-style-type: none"> <u>lead time requirements, change over duration, requirement for the facility to de-synchronise, maintain certain output level, limit operation (duration) under alternative fuel type</u> <u>approach to initiating a change over.</u> <u>If the facility is a single fuel facility then a file with commentary such as "No dual fuel capability or relevant changeover processes"</u> <u>If the facility has no fuel (e.g. solar, wind, hydro, battery) then the field can be left "blank"</u>	File Upload	A word document or <u>PDF</u> .	N/A	Appendix 1(c)xv. Deleted: fuels Deleted: pdf Deleted: a Deleted: is Deleted: As per description in the data field. Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The dependence of capacity on the type of fuel used by each Non-Intermittent Generating System in the Facility for each fuel described in Appendix 1(b)(xiv). [Appendix 1(b)xv.]	<u>AEMO advises to leave this field blank, as we can refer to data provided under the dependence of sent out capacity on the temperature at the location of the Facility [Appendix 1(c)vii].</u>	File upload	<u>N/A</u>	MW	Appendix 1(d)vii.
The minimum time before each Facility Technology Type in the Facility can be restarted after it is shut down, excluding Loads. <u>(Minimum Restart Time).</u> <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	As per description in the data field. <u>If this field is not applicable, please leave field as zero.</u>	Input Stepper	Days, Hours, Minutes, Seconds	Refer to Format	Appendix 1(d)viii.

Deleted: Where multiple fuel types may be utilised for a single Generating Unit type, the max capacity associated with each fuel type.†

Each fuel type is required to be expressed in terms of generated MW and at ambient temperature of 45°C, or higher if specified by the Network Operator based on physical location....

Deleted: A word document or pdf.

Deleted: †

Deleted: .

6.3 Non-Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The nameplate capacity of each Facility Technology Type in the Facility, excluding Loads. <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	Nameplate capacity of <u>each Facility Technology Type in the Facility</u> , as per the output subject to ratings of any primary plant or equipment. For synchronous generators, this is typically the nominal rating of the turbine(s), while non-synchronous is typically the aggregate of downstream plant/inverters. Where ratings are given in apparent power (MVA), this is the real power (MW) equivalent accounting for capability curves. <u>If the Facility Technology Type field is not applicable please leave value as blank, do not enter zero.</u>	Text	Numeric	MW	Appendix 1(d)ii.
The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network for the following Facility Technology Types in the Facility under optimal conditions, expressed in MW: <ul style="list-style-type: none"> Non-Intermittent Generating System Intermittent Generating System Electric Storage Resource 	Maximum sent-out capacity for each of the specified Facility Technology Types <u>in the Facility</u> . <u>If the Facility Technology Type field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(d)vA. Appendix 1(d)vB. Appendix 1(d)vC.

Deleted: facility

Deleted: .

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply across the Electric Storage Resource Obligation Duration to the relevant Network from Electric Storage Resources in the Facility under optimal conditions, expressed in MW. [Appendix 1(d)vD.]	<p><u>Only applicable if the Facility has an Electric Storage Resource (battery). If not applicable leave blank.</u></p> <p><u>Noting degradation of Electric Storage Resource capacity can occur, participants are recommended to update this value at least annually.</u></p> <p><u>If this field is not applicable please leave value as blank, do not enter zero.</u></p>	Text Box	Numeric	MW	Appendix 1(d)vD.
Details of the fuel or fuels that each Non-Intermittent Generating System in the Facility can use, including dual fuel capabilities and the process for changing fuels. [Appendix 1(d)viii.]	<p><u>If the facility is multi-fuel, list fuels and provide information for AEMO to understand limitations and direct the facility under emergency conditions, e.g:</u></p> <ul style="list-style-type: none"> <u>lead time requirements, change over duration, requirement for the facility to de-synchronise, maintain certain output level, limit operation (duration) under alternative fuel type</u> <u>approach to initiating a change over.</u> <p><u>If the facility is a single fuel facility then a file with commentary such as "No dual fuel capability or relevant changeover processes"</u></p> <p><u>If the facility has no fuel (e.g. solar, wind, hydro, battery) then the field can be left "blank"</u></p>	File Upload	A word document or pdf.	N/A	Appendix 1(d)viii.

Deleted: As per

Deleted: the data field description.

Deleted: a

Deleted: is

Deleted: As per description in the data field.

7. Separately Certified Component

7.1 Scheduled Facility

Deleted: 11
11
11
11
11
11

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
If the Facility has a Separately Certified Component that is a Non-Intermittent Generating System, the maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of:	As per <u>the</u> description in the data field.	Tick Box	Ticked = Yes, Unticked = No	N/A	Appendix 1(b)ix.1 Appendix 1(b)ix.2
41 degrees Celsius [Appendix 1(b)ix.1.]	The maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of 41 degrees Celsius <u>If the field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)ix.1 Appendix 1(b)ix.2
45 degrees Celsius [Appendix 1(b)ix.2.]	The maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of 45 degrees Celsius <u>If the field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)ix.1 Appendix 1(b)ix.2
If the Facility has a Separately Certified Component that is a Non-Intermittent Generating System, the maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System under optimal conditions. [Appendix 1(b)x.]	As per <u>the</u> description in the data field. <u>If a field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)x.
If the Facility has a Separately Certified Component that is an Intermittent Generating System, the maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Intermittent Generating System under optimal conditions, expressed in MW. [Appendix 1(b)xA.]	As per <u>the</u> description in the data field. <u>If a field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)xA
If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant	As per <u>the</u> description in the data field. <u>If a field is not applicable please leave value as blank, do not enter zero.</u>	Tick box	Ticked = Yes, Unticked = No	MW	Appendix 1(b)xi.1. Appendix 1(b)xi.2.

Deleted: sent out

Deleted: t

Deleted: sent out

Deleted: t

Deleted: sent out

Deleted: sent out

Deleted: sent out

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
Network from the Electric Storage Resource when it is operated normally at an ambient temperature of:					
*41 degrees Celsius [Appendix 1(b)xi.1.]	If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Electric Storage Resource when it is operated normally at an ambient temperature of 41 degrees Celsius. <u>If a field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)xi.1.
*45 degrees Celsius [Appendix 1(b)xi.2.]	If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum <u>sent-out</u> capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Electric Storage Resource when it is operated normally at an ambient temperature of 45 degrees Celsius. <u>If a field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)xi.2.
*If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply across the Electric Storage Resource Obligation Duration, to the relevant Network from the Electric Storage Resource under optimal conditions, expressed in MW. [Appendix 1(b)xii.]	<u>Only applicable if the Facility has an Electric Storage Resource (battery). If not applicable leave blank.</u> <u>Noting degradation of Electric Storage Resource capacity can occur, participants are recommended to update this value at least annually.</u> <u>If this field is not applicable please leave value as blank, do not enter zero.</u>	Text Box	Numeric	MW	Appendix 1(b)xii.
*If the Facility has a Separately Certified Component that is an Electric Storage Resource, the minimum Charge Level capability of the Electric Storage Resource. [Appendix 1(b)xiii.]	<u>The minimum charge level in MWh is used in the refund calculation in clause 4.26.1F. Please note AEMO expects the value to be consistent with the minimum charge level provided under</u>	Text Box	Numeric	MWh	Appendix 1(b)xiii.

Deleted: sent out

Deleted: sent out

Deleted: As per description in the data

Deleted: field.

Deleted: Minimum Charge Level in MWh

Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
	the respective Reserve Capacity certification process under clause 4.10.1(fA). If this field is not applicable please leave value as blank, do not enter zero.				

7.2 Semi-Scheduled Facility

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
If the Facility has a Separately Certified Component that is a Non-Intermittent Generating System, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of:	As per description in the data field.	Tick Box	Ticked = Yes, Unticked = No	MW	Appendix 1(c)ix.1. Appendix 1(c)ix.2.
*41 degrees Celsius [Appendix 1(c)ix.1.]	The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of 41 degrees Celsius. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)ix.1. Deleted: t
*45 degrees Celsius [Appendix 1(c)ix.2.]	The maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Non-Intermittent Generating System when it is operated normally at an ambient temperature of 45 degrees Celsius. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)ix.2. Deleted: t
If the Facility has a Separately Certified Component that is a Non-Intermittent Generating System, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to	As per description in the data field. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)x. Deleted: 2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
the relevant Network from the Non-Intermittent Generating System under optimal conditions. [Appendix 1(c)x.]					
If the Facility has a Separately Certified Component that is an Intermittent Generating System, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Intermittent Generating System under optimal conditions, expressed in MW. [Appendix 1(c)xA.]	As per description in the data field. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)xA.
If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Electric Storage Resource when it is operated normally at an ambient temperature of:	As per description in the data field. If the field is not applicable please leave value as blank, do not enter zero.	Tick box	Ticked = Yes, Unticked = No	MW	
*41 degrees Celsius [Appendix 1(c)xi.1.]	If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Electric Storage Resource when it is operated normally at an ambient temperature of 41 degrees Celsius. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)xi.1.
*45 degrees Celsius [Appendix 1(c)xi.2.]	If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply to the relevant Network from the Electric Storage Resource when it is operated normally at an ambient temperature of 45 degrees Celsius. If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MW	Appendix 1(c)xi.2.
*If the Facility has a Separately Certified Component that is an Electric Storage Resource, the maximum sent out capacity, net of embedded and Parasitic Loads, that can be available for supply	As per description in the data field.	Text Box	Numeric	MW	Appendix 1(c)xii.

2023

Data Field	Description	Field type	Format	Units	WEM Rule Requirement
across the Electric Storage Resource Obligation Duration, to the relevant Network from the Electric Storage Resource under optimal conditions, expressed in MW. [Appendix 1(c)xii.]	If the field is not applicable please leave value as blank, do not enter zero.				
*If the Facility has a Separately Certified Component that is an Electric Storage Resource, the minimum Charge Level capability of the Electric Storage Resource. [Appendix 1(c)xiii.]	Minimum Charge Level in MWh If the field is not applicable please leave value as blank, do not enter zero.	Text Box	Numeric	MWh	Appendix 1(c)xiii.


Deleted: 2023

8. Appendices

Deleted: 2023

8.1 Appendix 1 - Start-Up Times

Illustration of how minimum restart time, elapsed times and synchronisation times used by AEMO.

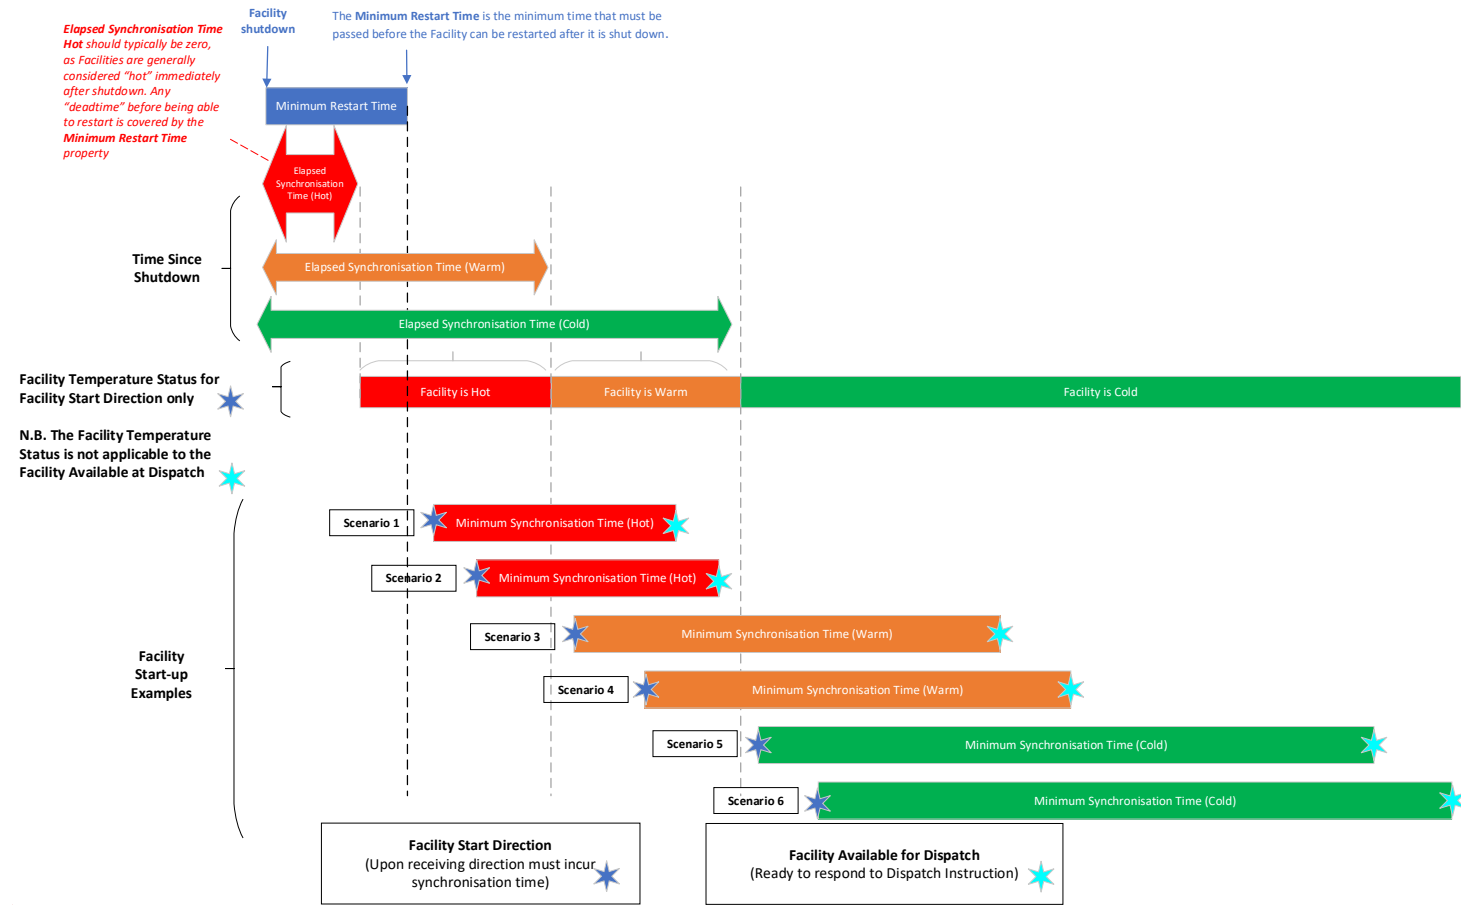

Field Code Changed

Deleted: 2023

8.2 Appendix 1 - Start-Up Times Examples of Scenario 1 to 6

Examples of how minimum restart time, elapsed times and synchronisation times are interpreted and used by AEMO for scenarios 1 to 6 (in section 8.1).

Minimum Restart Time (mins)	<u>15</u>
Elapsed Time Hot (mins)	<u>0</u>
Elapsed Time Warm (mins)	<u>60</u>
Elapsed Time Cold (mins)	<u>120</u>

Facility offline	<u>8:00 AM</u>
Facility is Hot	<u>8:00 AM</u>
Facility is Warm	<u>9:00 AM</u>
Facility is Cold	<u>10:00 AM</u>


Hot Synch Time (mins)	<u>20</u>
Warm Resynch Time (mins)	<u>40</u>
Cold Resynch Time (mins)	<u>60</u>

Scenario	Direction issued at	Description
<u>1</u>	<u>8:20 AM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time warm has not passed, therefore Facility still in the Hot state. Hot Synchronisation time of 20 minutes applies. Direction issued, expect Facility to be ready for dispatch by 08:40 AM.
<u>2</u>	<u>8:50 AM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time warm has not passed, therefore Facility still in the Hot state. Hot Synchronisation time of 20 minutes applies. Direction issued, expect Facility to be ready for dispatch by 09:10 AM.
<u>3</u>	<u>9:30 AM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time warm has passed, therefore Facility in the Warm state. Warm Synchronisation time of 40 minutes applies. Direction issued, expect Facility to be ready for dispatch by 10:10 AM.
<u>4</u>	<u>9:45 AM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time warm has passed, therefore Facility in the Warm state. Warm Synchronisation time of 40 minutes applies. Direction issued, expect Facility to be ready for dispatch by 10:25 AM.
<u>5</u>	<u>10:15 AM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time cold has passed, therefore Facility in the Cold state. Cold Synchronisation time of 60 minutes applies. Direction issued, expect Facility to be ready for dispatch by 11:15 AM.
<u>6</u>	<u>2:30 PM</u>	Minimum re-start time has passed, Facility ready to be directed. Elapsed time cold has passed, therefore Facility in the Cold state. Cold Synchronisation time of 60 minutes applies. Direction issued, expect Facility to be ready for dispatch by 3:30 PM.

Deleted: 2023

8.3 Appendix 2 - Minimum Physical Responses Time to a Dispatch Instruction

The minimum physical response time before the Facility can begin to respond to a Dispatch Instruction, when the Facility is running represents the time lag between the Facility Power Plant Controller (PPC) receiving the desired MW signal from AEMO and responding – i.e. $t_2 - t_1$ in the figure below:

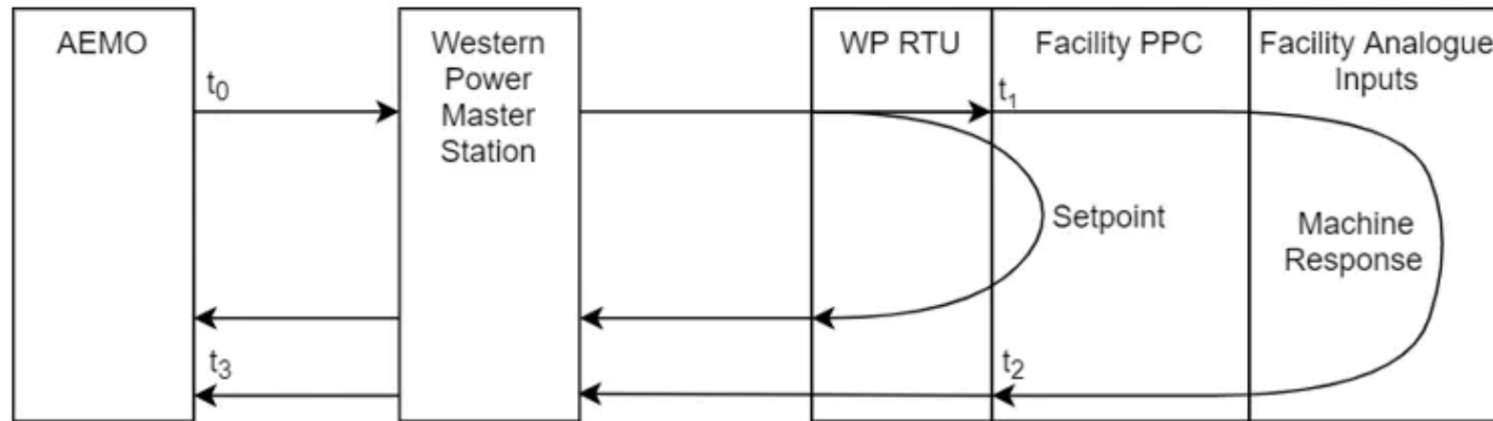

Deleted: 2023