



# 2021 Costs and Technical Parameter Review

**Australian Energy Market Operator**

Reference: P512485

Revision: 3

2022-03-21

**aurecon**

# Document control record

Document prepared by:

**Aurecon Australasia Pty Ltd**

ABN 54 005 139 873

Ground Floor, 25 King Street

Bowen Hills QLD 4006

Locked Bag 331

Brisbane QLD 4001

Australia

**T** +61 7 3173 8000

**F** +61 7 3173 8001



**E** brisbane@aurecongroup.com

**W** aurecongroup.com

A person using Aurecon documents or data accepts the risk of:

- a) Using the documents or data in electronic form without requesting and checking them for accuracy against the original hard copy version.
- b) Using the documents or data for any purpose not agreed to in writing by Aurecon.

Document control							aurecon
<b>Report title</b>		2021 Costs and Technical Parameter Review					
<b>Document code</b>		<b>Project number</b>		P512485			
<b>File path</b>		https://aurecongroup.sharepoint.com/sites/512485/7 Deliver Service/716 - Report/2021/Third draft/2021 Cost and Technical Parameters Review_Rev3 21 March 2022.docx					
<b>Client</b>		Australian Energy Market Operator					
<b>Client contact</b>		Andrew Turley	<b>Client reference</b>				
<b>Rev</b>	<b>Date</b>	<b>Revision details/status</b>	<b>Author</b>	<b>Reviewer</b>	<b>Verifier (if required)</b>	<b>Approver</b>	
0	2021-08-18	Draft issue for review	PKH	KAW	-	PCG	
1	2021-10-27	2 <sup>nd</sup> Draft	PKH	KAW		PCG	
2	2022-03-21	Final	PKH	BCW		PCG	
<b>Current revision</b>		<b>3</b>					

Approval			
Author signature		Approver signature	
Name	Prabir Halder	Name	Paul Godden
Title	Lead Consultant	Title	Energy Leader - Queensland

# Contents

<b>1</b>	<b>Introduction</b>	<b>1</b>
1.1	Background	1
1.2	Scope of Study	1
1.3	Abbreviations	2
<b>2</b>	<b>Limitations</b>	<b>4</b>
2.1	General	4
2.2	ThermoFlow Inc. Software	4
2.3	Costs and budget	4
<b>3</b>	<b>Methodology and Definitions</b>	<b>5</b>
3.1	Methodology	5
3.2	Assumptions and basis	5
3.2.1	General	5
3.2.2	Power generation / storage facility	5
3.2.3	Fuel connection/ transport	7
3.2.4	Natural gas compression and storage	7
3.2.5	Hydrogen-based technologies and storage	8
3.2.6	Ammonia production facility	10
3.2.7	Carbon capture and storage	10
3.2.8	Development and land costs	10
3.2.9	Financial assumptions	11
3.3	Definitions	12
<b>4</b>	<b>Generation Technologies</b>	<b>14</b>
4.1	Overview	14
4.2	Onshore Wind	14
4.2.1	Overview	14
4.2.2	Typical options	14
4.2.3	Recent trends	14
4.2.4	Selected hypothetical project	15
4.2.5	Cost estimate	17
4.3	Offshore Wind	17
4.3.1	Overview	17
4.3.2	Typical options	18
4.3.3	Recent trends	18
4.3.4	Selected hypothetical project	19
4.3.5	Cost estimate	20
4.4	Large-scale solar photovoltaic (PV)	21
4.4.1	Overview	21
4.4.2	Typical options	21
4.4.3	Recent trends	21
4.4.4	Selected hypothetical project	22
4.4.5	Cost estimate	23
4.5	Concentrated Solar Thermal	23
4.5.1	Overview	23
4.5.2	Typical options	24
4.5.3	Recent trends	26
4.5.4	Selected hypothetical project	26

	4.5.5	Cost estimate.....	28
4.6		Reciprocating Engines.....	29
	4.6.1	Overview.....	29
	4.6.2	Typical options.....	29
	4.6.3	Recent trends .....	29
	4.6.4	Selected hypothetical project .....	30
	4.6.5	Cost estimate.....	31
4.7		Open Cycle Gas Turbine.....	31
	4.7.1	Overview.....	31
	4.7.2	Typical options.....	32
	4.7.3	Recent trends .....	32
	4.7.4	Selected hypothetical project .....	33
	4.7.5	Cost estimate.....	34
4.8		Combined Cycle Gas Turbine .....	35
	4.8.1	Overview.....	35
	4.8.2	Typical options.....	35
	4.8.3	Recent trends .....	35
	4.8.4	Selected hypothetical project .....	36
	4.8.5	Cost estimate.....	38
4.9		Advanced Ultra-Supercritical Pulverised Coal .....	39
	4.9.1	Overview.....	39
	4.9.2	Typical options.....	40
	4.9.3	Recent trends .....	40
	4.9.4	Selected hypothetical project .....	40
	4.9.5	Cost estimate.....	42
4.10		Bioenergy .....	43
	4.10.1	Biogas production.....	43
	4.10.2	Biomass generators using wood waste.....	47
	4.10.3	Biodiesel production .....	50
<b>5</b>		<b>Hydrogen Based Technologies and Storage.....</b>	<b>55</b>
	5.1	Overview.....	55
	5.2	Reciprocating engines .....	55
	5.2.1	Overview and typical options.....	55
	5.2.2	Recent trends .....	55
	5.2.3	Selected hypothetical project .....	55
	5.2.4	Cost estimate.....	57
	5.3	Gas turbines, including hydrogen conversion of gas turbines.....	58
	5.3.1	Overview and typical options.....	58
	5.3.2	Recent trends .....	58
	5.3.3	Selected hypothetical project .....	59
	5.3.4	Cost estimate.....	61
	5.4	Electrolysers .....	63
	5.4.1	Overview.....	63
	5.4.2	Typical options.....	63
	5.4.3	Recent trends .....	63
	5.4.4	Selected hypothetical project .....	64
	5.4.5	Cost estimate.....	66
	5.5	Hydrogen Fuel Cells.....	67
	5.5.1	Overview.....	67
	5.5.2	Typical options.....	67
	5.5.3	Recent trends .....	67
	5.5.4	Selected hypothetical project .....	68

	5.5.5	Cost estimate.....	69
5.6		SMR & CCS.....	70
	5.6.1	Overview.....	70
	5.6.2	Current trends.....	70
	5.6.3	Selected hypothetical facility and cost estimate.....	71
5.7		Hydrogen Storage.....	72
	5.7.1	Overview and selected options.....	72
	5.7.2	Recent trends.....	73
	5.7.3	Selected hypothetical project and cost estimate.....	74
	5.7.4	Hydrogen pipelines and associated costs.....	74
5.8		Geological hydrogen storage.....	76
	5.8.1	Overview.....	76
	5.8.2	Recent trends.....	77
	5.8.3	Selected hypothetical project and cost estimate.....	78
<b>6</b>		<b>Ammonia Production Facility.....</b>	<b>80</b>
	6.1	Overview.....	80
	6.2	Recent Trends.....	80
	6.3	Selected Hypothetical Project.....	81
	6.4	Cost Estimate.....	82
<b>7</b>		<b>Desalination and Water Treatment.....</b>	<b>83</b>
	7.1	Desalination Plant.....	83
	7.1.1	Overview.....	83
	7.1.2	SWRO process description.....	83
	7.1.3	Recent trends.....	83
	7.1.4	Selected hypothetical project.....	84
	7.1.5	Cost estimate.....	84
	7.2	Water Treatment (demineralisation) for Hydrogen Production.....	85
	7.2.1	Overview.....	85
	7.2.2	Processing technology.....	85
	7.2.3	Selected hypothetical project.....	86
	7.2.4	Cost estimate.....	86
<b>8</b>		<b>Battery Energy Storage System (BESS).....</b>	<b>88</b>
	8.1	Large-Scale Lithium-Ion Battery Storage.....	88
	8.1.1	Overview.....	88
	8.1.2	Typical options.....	88
	8.1.3	Recent trends.....	88
	8.1.4	Selected hypothetical project.....	90
	8.1.5	Cost estimate.....	91
	8.2	Residential Battery Storage.....	92
	8.2.1	Overview.....	92
	8.2.2	Typical options.....	93
	8.2.3	Recent trends.....	93
	8.2.4	Selected hypothetical project.....	94
	8.2.5	Cost estimate.....	95
	8.3	Large-Scale Vanadium-Redox Flow Battery Storage.....	95
	8.3.1	Overview.....	95
	8.3.2	Typical options.....	96
	8.3.3	Recent trends.....	96
	8.3.4	Selected hypothetical project.....	97
	8.3.5	Cost estimate.....	98

## Appendices

### Appendix A

AEMO GenCost 2021 Excel Spreadsheet

## Figures

- Figure 1: Typical Biogas energy process (Source Biogass Renewables)
- Figure 2: Hydrogen storage tank, Cape Canaveral (picture NASA)
- Figure 3: Salt cavern storage schematic (Ozarslan, 2012)
- Figure 4: Global salt deposit locations (Engie, 2019).
- Figure 5: Capacity Factors for new solar and wind generators over time – NEM wide trend

## Tables

- Table 1-1: Acronyms / Abbreviations
- Table 3-1: Power generation / storage facility key assumptions
- Table 3-2: Power generation / storage facility terminal points
- Table 3-3: Definition of key terms
- Table 4-1: Configuration and performance
- Table 4-2: Technical parameters and project timeline
- Table 4-3: Cost estimates
- Table 4-4: Configuration and performance
- Table 4-5: Technical parameters and project timeline
- Table 4-6: Cost estimates
- Table 4-7: Configuration and performance
- Table 4-8: Technical parameters and project timeline
- Table 4-9: Cost estimates
- Table 4-10: Configuration and performance
- Table 4-11: Technical parameters and project timeline
- Table 4-12: Cost estimates
- Table 4-13: Configuration and performance
- Table 4-14: Technical parameters and project timeline
- Table 4-15: Cost estimates
- Table 4-16: Configuration and performance
- Table 4-17: Technical parameters and project timeline
- Table 4-18: Cost estimates
- Table 4-19: Configuration and performance
- Table 4-20: Technical parameters and project timeline
- Table 4-21: Cost estimates
- Table 4-22: Configuration and performance
- Table 4-23: Technical parameters and project timeline
- Table 4-24: Cost estimates
- Table 4-25: Biogas hypothetical plant configuration and performance
- Table 4-26: Project timeline
- Table 4-27: Cost estimates
- Table 4-28: Configuration and performance
- Table 4-29: Technical parameters and project timeline
- Table 4-30: Cost estimates
- Table 4-31: Biodiesel hypothetical plant configuration and performance
- Table 4-32: Project timeline
- Table 4-33: Cost estimates

Table 5-1: Configuration and performance  
Table 5-2: Technical parameters and project timeline  
Table 5-3: Cost estimates  
Table 5-4: Hydrogen turbine configuration and performance  
Table 5-5: Hydrogen turbine technical parameters  
Table 5-6: Hydrogen turbine cost estimate  
Table 5-7: Electrolyser configuration and performance  
Table 5-8: Technical parameters and project timeline  
Table 5-9: Cost estimates  
Table 5-10: Fuel cell configuration and performance  
Table 5-11: Technical parameters and project timeline  
Table 5-12: Cost estimates  
Table 5-13: SMR plant criteria  
Table 5-14: SMR plant Cost estimate  
Table 5-15: Liquid hydrogen storage hypothetical Technical parameters  
Table 5-16: Liquid hydrogen storage hypothetical project Cost parameters  
Table 5-17: Indicative costs for a new hydrogen distribution network  
Table 5-18: Geological Storage Technology Comparison  
Table 5-19: Geologic hydrogen storage operating sites (Zavir, Kumar, Foroozesh, 2021)  
Table 5-20: Hypothetical Geologic Storage Project Parameters  
Table 5-21: Hypothetical Project CAPEX and OPEX costs  
Table 6-1: Hypothetical ammonia production facility configuration and performance data  
Table 6-2: Hypothetical ammonia production facility technical parameters and project timeline  
Table 6-3: Hypothetical ammonia production facility cost estimate  
Table 7-1: Cost estimate for full-scale desalination for 100,000 ML/year plant to produce potable water  
Table 7-2: Demineralisation process for different water source  
Table 7-3: Process parameter of a demineralised plant for a 10 MW electrolyser plant using potable water.  
Table 7-4: Water treatment plant cost estimate (10 MW electrolyser plant)  
Table 8-1: BESS configuration and performance  
Table 8-2: Technical parameters and project timeline  
Table 8-3: Cost estimates  
Table 8-4: RBESS configuration and performance  
Table 8-5: RBESS technical parameters and project timeline  
Table 8-6: Cost estimates  
Table 8-7: Vanadium-redox BESS configuration and performance  
Table 8-8: Vanadium-redox BESS technical parameters and project timeline  
Table 8-9: Cost estimates  
Table 9-1: Capacity Factors for new solar and wind generators

# 1 Introduction

## 1.1 Background

The Australian Energy Market Operator (AEMO) is responsible for operating the National Electricity Market (NEM) in Eastern and South-Eastern Australia, and the Wholesale Electricity Market (WEM) in Western Australia.

AEMO's forecasting functions can influence the behaviour of existing generation assets and the economics and location of future investment and retirement decisions. These forecasts rely on various input assumptions.

AEMO has engaged Aurecon to review and prepare an updated set of generation and storage technology input data to be used in AEMO forecasting studies and to be published on the AEMO website.

The updated dataset includes current technology costs and technical operating parameters for both existing and emerging generation technologies, including those with minimal current local or international deployment. Hydrogen production, ammonia production, and sea water desalination technologies are also included.

The dataset is intended to be used by AEMO, and shared with industry, to conduct market simulation studies for medium and long-term forecasting purposes. This data will be then used in various AEMO forecasting publications.

## 1.2 Scope of Study

The scope of this study was to prepare an updated set of costs and technical parameters for a concise list of generation (and storage) technologies, including the following:

- Onshore wind
- Offshore wind
- Large-scale solar photovoltaic (PV)
- Concentrated solar thermal (with 12 hours energy storage)
- Hydrogen-based reciprocating engines and gas turbines
- Reciprocating engines
- Open-cycle gas turbine (OCGT)
- Combined-cycle gas turbine (CCGT) (with and without carbon capture and storage (CCS))
- Advanced Ultra Supercritical Pulverised Coal (with and without CCS)
- Biomass (biogas digesters, biomass generators using wood waste and biodiesel production)
- Electrolysers (PEM & Alkaline) – hydrogen production
- Fuel cells
- Battery Energy Storage Systems (BESS) with 1 to 8 hours storage
- Alternative battery technology such as flow batteries
- Estimated cost for large scale hydrogen storage
- SMR and SMR plus CCS (hydrogen production)
- Ammonia production
- Desalination plant

The parameters to be updated or developed include the following:

- Performance – such as output, efficiencies, production rate and capacity factors
- Timeframes – such as for development and operational life
- Technical and operational parameters – such as configuration, ramp rates, and minimum generation
- Costs – including for development, capital costs and O&M costs (both fixed and variable)



The updated dataset is provided in the accompanying Microsoft Excel spreadsheet (see Appendix A), the template for which was developed by AEMO. This report provides supporting information for the dataset and an overview of the scope, methodology, assumptions, and definition of terms used in the dataset and its development.

The intention is for the updated dataset to form a key input to the long-term capital cost curves in the 2021 GenCost publication to be prepared by CSIRO in conjunction with AEMO as well as other various AEMO forecasting publications such as the Integrated System Plan (ISP).

## 1.3 Abbreviations

Table 1-1: Acronyms / Abbreviations

Acronym	Definition
AD	Anaerobic Digestion
AEMO	Australian Energy Market Operator
AFC	Alkaline fuel cell
AUD	Australian Dollar
BESS	Battery Energy Storage System
C&I	Commercial and Industrial
CAPEX	Capital Expenditure
CCGT	Combined-Cycle Gas Turbine
CCS	Carbon capture and storage
CHP	Combined Heat and Power
COD	Commercial Operation Date
DMFC	Direct methanol fuel cell
DNI	Direct Normal Irradiance
EPC	Engineer Procure and Construct
FAME	Fatty Acid Methyl Ester
FCAS	Frequency control ancillary services
FFA	Free fatty acid
FFR	Fast Frequency Response
FGD	Flue gas desulfurization
GHS	Geologic hydrogen storage
GJ	Gigajoule
GPS	Generator performance standards
GST	Goods and Services Tax
GT	Gas turbine
HDPE	High density polyethylene
HHV	Higher Heating Value
HTL	Hydrothermal liquefaction
ISP	Integrated system plan
KHI	Kawasaki heavy industry
LCOE	Levelised Cost of Electricity
LFP	Lithium iron phosphate
LHV	Lower Heating Value
MCR	Maximum Continuous Rating

Acronym	Definition
MW	Megawatt
MWh	Megawatt-hour
NEG	National electricity grid
NEM	National Electricity Market
NTP	Notice to Proceed
OCGT	Open Cycle Gas Turbine
OEM	Original Equipment Manufacturer
OPEX	Operational Expenditure
O&M	Operations and Maintenance
PAFC	Phosphoric acid fuel cell
PEM	Proton Exchange Membrane
PEMFC	Proton exchange membrane fuel cell
PV	Photovoltaic
PVC	Polyvinyl chloride
RBESS	Residential battery energy storage system
RDF	Refuse-derived fuel
RR	Recovery ratio
SAT	Single-axis Tracking
SCR	Selective catalytic reduction
SIPS	Special integrated protection scheme
SMR	Steam methane reforming
SOC	State of charge
SOFC	Solid oxide fuel cell
STATCOM	Static synchronous compensator
SWRO	Seawater reverse osmosis
TRL	Technology readiness level
UCO	Used cooking oil
VNI	Victoria to NSW interconnector
VPP	Virtual power plant
WCE	Wet combustion system
WEM	Wholesale Electricity Market
WWTP	Wastewater treatment plant

## 2 Limitations

### 2.1 General

This report has been prepared by Aurecon on behalf of, and for the exclusive use of, AEMO. It is subject to and issued in connection with the provisions of the agreement between Aurecon and AEMO.

Power generation, hydrogen and ammonia production conceptual design is not an exact science, and there are several variables that may affect the results. Bearing this in mind, the results provide general guidance as to the ability of the power generation facility or production facility to perform adequately, rather than an exact analysis of all the parameters involved.

This report is not a certification, warranty, or guarantee. It is a report scoped in accordance with the instructions given by AEMO and limited by the agreed time allowed.

The findings, observations, and conclusions expressed by Aurecon in this report are not and should not be considered an opinion concerning the commercial feasibility of such a project.

This report is partly based on information provided to Aurecon by AEMO. This report is provided strictly on the basis that the information provided to Aurecon is accurate, complete and adequate, unless stated otherwise.

If AEMO or a third party should become aware of any inaccuracy in, or change to, any of the facts, findings or assumptions made either in this report or elsewhere, AEMO or a third party should inform Aurecon so that Aurecon can assess its significance and review its comments and recommendations.

### 2.2 Thermoflow Inc. Software

This report relies on outputs generated from Thermoflow Inc. software by personnel in Aurecon experienced in using this software. The provider of this software does not guarantee results obtained using this software, nor accept liability for any claimed damages arising out of use or misuse of its software. Aurecon's report is provided strictly on the basis that the outputs that have been generated are accurate, complete, and adequate. Aurecon takes no responsibility and disclaims all liability whatsoever for any loss or damage that AEMO may suffer resulting from any conclusions based on outputs generated by Aurecon using this software.

### 2.3 Costs and budget

Aurecon has no control over the cost of labour, materials, equipment, or services furnished by others. Aurecon similarly has no control over Contractors' methods of determining prices, or over competitive bidding or market conditions. Any opinion or estimate of costs by Aurecon is made on the basis of Aurecon's experience and qualifications, and represents Aurecon's judgment as an experienced and qualified professional engineering organisation, familiar with the construction industry. However, Aurecon cannot and does not guarantee that proposals, bids, or actual construction costs will not vary from Aurecon's estimates.

# 3 Methodology and Definitions

## 3.1 Methodology

The dataset for the generation and storage technologies, and hydrogen and ammonia production technologies has been developed and updated based on a hypothetical project selected as being representative for each examined technology, and which would or could be typically installed in the NEM as a market participant or energy consumer.

The size and configuration for each hypothetical project has been selected based on Aurecon's current experience with existing and recent / proposed new entrant power generation and storage projects in Australia, particularly in the NEM. For technologies that have not been deployed in Australia to date or only in demonstration applications, we have relied on international experience and published information for our assessment. The intent is that the technical and cost information developed for these hypothetical projects can be used as a basis by others with adjustment as needed for its specific purpose or project (i.e. scale on a \$/MW basis within same order, inflate to account for regional or remote cost factors, etc). There exists uncertainties on technology performance and cost estimates for new/emerging technologies, such as hydrogen and ammonia production.

The performance figures and technical parameters have been based on actual project information where available, or vendor provided information.

The cost estimates have been developed based on collating information from the following sources:

- Aurecon's internal database of projects – recently constructed or under construction
- Recent bid information from EPC competitive tendering processes
- Industry publications, publicly available data, and vendor information
- CCS costs (for both CCGT and coal fired power plant options) were obtained using a recognised reputable commercially available software package

This cost data has been normalised or adjusted to account for differences in battery limits, scope, location factors, technical factors (where relevant), etc.

A representative cost has been selected for the hypothetical project from the data available, and cost certainty qualified based on the spread and quality of data available.

Recent trends for each technology have been reviewed and discussed throughout the report. These have been considered when selecting the hypothetical project, nominating technical parameters, and developing the cost estimates on a 2021 basis.

## 3.2 Assumptions and basis

### 3.2.1 General

This section defines the basis used for the hypothetical projects and for determining the technical parameters and cost estimates.

### 3.2.2 Power generation / storage facility

Power generation or storage facility equipment and installation scope is based on the assumptions described in the following table.

**Table 3-1: Power generation / storage facility key assumptions**

Item	Detail
Site	Greenfield site (clear, flat, no benching required), NEM installation, coastal location (within 200 km of coast)
Base ambient conditions:	<ul style="list-style-type: none"> <li>■ Dry Bulb Temperature: 25 °C</li> <li>■ Elevation above sea level: 110 metres</li> <li>■ Relative Humidity: 60%</li> </ul>
Fuel quality	<ul style="list-style-type: none"> <li>■ Gas: Standard pipeline quality natural gas (HHV to LHV ratio of 1.107)</li> <li>■ Diesel: No.2 diesel fuel</li> <li>■ Coal: Black coal</li> <li>■ Biomass: Woodwaste</li> </ul>
Water quality	<ul style="list-style-type: none"> <li>■ Towns water quality (i.e. potable)</li> <li>■ Demineralised water produced on site if required</li> </ul>
Hydrogen quality	99.99+% v/v in compliance with ISO 14687-2:2014 and SAE J2719. HHV to LHV ratio of 1.183
Grid connection voltage	220 – 275 kV (or lower for small scale options (i.e. electrolyzers, etc))
Grid connection infrastructure	Step-up transformer included; switchyard / substation excluded
Energy Storage	<ul style="list-style-type: none"> <li>■ Concentrated solar thermal – 12 hrs thermal energy storage considered</li> <li>■ Electrolysers / hydrogen power generation (fuel cells / reciprocating engines / turbines) – Hydrogen compression, transport and storage excluded (relative costs provided separately)</li> <li>■ BESS – 1, 2, 4, and 8 hour energy storage options considered</li> </ul>
Project delivery	EPC turn-key basis
O&M approach	<ul style="list-style-type: none"> <li>■ Thermal/hydrogen power generation: Owner operates and maintains, but contracts for scheduled maintenance</li> <li>■ Renewables or storage: Owner appoints a third-party O&amp;M provider</li> </ul>

The assumed terminal points for the power generation or storage facility are described in the following table. Communication links are considered to be generally common across technologies and have not been separately defined.

**Table 3-2: Power generation / storage facility terminal points**

No.	Terminal point	Terminal point location and details
1	Fuel supply (if relevant)	Gas: 30 – 40 bar supply pipeline at site boundary, dry and moisture free Diesel: Truck unloading facility located on site Coal: Train unloading facility located on site Biomass: Truck unloading facility located on site
2	Grid connection	HV side of generator step-up transformer
3	Raw / potable water	Site boundary (Water treatment plant included in project scope if demineralised water required)
4	Wastewater	Site boundary
5	Road access	Site boundary

No.	Terminal point	Terminal point location and details
6	Hydrogen supply (if relevant)	Electrolyser: Outlet of package at delivery pressure (i.e. no additional compression) Fuel cell: 10 bar supply pipeline at package inlet Reciprocating engine: 10 bar supply at package boundary Turbine (small): 30 bar supply at package boundary

### 3.2.3 Fuel connection/ transport

The fuel connection scope and costs are highly dependent on both location and site. As such, a single estimate for each hypothetical project is not practical. An indicative \$/km cost has been nominated based on prior work and publicly available data.

The natural gas fuel connection scope assumptions are as follows:

- Distance from connection point to power station: <50 km
- Pipeline size and class: DN200, Class 600 (AS 2885)
- Scope: hot tap at connection, buried pipeline to power station, and fuel conditioning skid
- Fuel conditioning skid plant and equipment: Filtration, heating, metering, pressure let down, etc (excludes any fuel compression)

The coal fuel connection scope assumptions are as follows:

- Coal transport via rail (i.e. power station not located at the mine mouth)
- Distance from starting point to power station between 50 to 100 km
- Single track rail line dedicated for power station use
- Scope: Track rail line from mine to power station location delivered under a D&C contract. Excluding loading infrastructure at mine.

The biomass fuel connection scope assumptions are as follows:

- Biomass delivered to power station via road transport
- Existing road infrastructure used
- Unloading infrastructure included in power station cost
- No new transport infrastructure required hence no CAPEX associated with fuel supply (i.e. to be captured as an OPEX cost)

### 3.2.4 Natural gas compression and storage

Some natural gas power station projects require fuel gas compression depending on the pipeline pressure available and pressure requirements specified by the gas turbine manufacturer. A separate cost has been provided for natural gas compression.

The natural gas compression scope assumptions are as follows:

- Type: Reciprocating compressor
- Supply pressure: 30 bar. Discharge pressure: 50 bar.
- Capacity: ~50 t/h
- Scope: Complete supply of compressor(s) and enclosures. Includes civil works. Excluding power supply.

Natural gas storage facilities are also used for increased fuel security and supply chain / demand management. A cost has been provided on the following basis:

- Storage: Underground storage facility in a depleted natural gas field
- Scope: Third party contract for storage at the Iona underground storage facility. (Note that this is the only underground facility which is currently provides storage services to third parties in the East Coast Gas Market.)

### 3.2.5 Hydrogen-based technologies and storage

#### Hydrogen production

Hydrogen is produced by two broad categories of technology: electrolysis, where an electric potential is applied to electrodes in water which then breaks the water into hydrogen and oxygen, and thermal decomposition of hydrocarbons, where heat and pressure is applied to hydrocarbons (e.g.: Natural gas) with steam which causes (ultimately) the breakdown to hydrogen and carbon dioxide. In this report, electrolysis and Steam Methane Reformation (SMR) have been considered.

PEM and Alkaline electrolyser technology have been considered. Other electrolyser facility assumptions for hypothetical project considered in this report and associated costs are included in Section 5.4.4 and Section 5.4.5.

#### Electrolyser facility compression, storage and transport

When hydrogen is being produced from renewable sources considerable storage volumes are required to manage their intermittency, particularly where the end user requires a continuous supply or is being transported by road transport or sea going vessel.

The hydrogen compression scope assumptions for electrolyser based hydrogen system are as follows:

- Type: Multi-stage diaphragm type
- Supply pressure: 30 bar (for PEM) or 1 bar (for Alkaline). Discharge pressure: 100 bar
- Capacity: Between 1,850 and 2,000 Nm<sup>3</sup>/h (1 x 100% duty)
- Scope: Complete supply of compressor(s) and enclosures. Includes civil works. Excluding power supply (assumed co-located with the electrolyser plant).

The hydrogen storage scope assumptions for electrolyser based hydrogen system are as follows:

- Type: High pressure steel cylinders (AS 1548 compliant)
- Pressure: 100 bar
- Size: 40ft ISO containers, 350 kgH<sub>2</sub> each (at 100 bar)
- Scope: Full supply and installation of storage tanks under D&C contract. Includes civils. Excludes additional compound infrastructure (assumes co-located with a wider facility).

The hydrogen transport scope assumptions for electrolyser based hydrogen system as follows:

- Type: Buried carbon steel pipeline (API 5L X42)
- Pressure: 100 bar
- Length: 50 to 250 km
- Diameter: DN50 (suitable for up to single 20 MW electrolyser)
- Scope: Full supply and installation of pipeline under D&C contract. Excludes compression and receiving stations at either end. Assumes single pipe run (not networked system).

## Steam methane reforming facility, storage and transport

SMR facility costs are based on information from the International Energy Agency and other sources.

The following points were considered in cost analysis for SMR/CCS:

- Site Location: Close to natural gas supply point and consumer location
- SMR plant capacity: Approximately double the current largest in Australia, matching approximately the capacity of several large international plants
- Fuel quality: Australian Standards compliant natural gas
- Water quality: Raw water quality (typical of potable water)
- Hydrogen quality: 99.99% (refer to Table 3-1)

In addition to hydrogen production, hydrogen needs to be compressed (or liquified) and transported to the end user. The costs associated with compression (or liquification) and transport are considered separately in this report.

Liquefaction, storage and pipeline costs are based on published recent studies from various sources. These studies generally report total system costs (e.g.: compression and storage facilities combined) rather than component costs and, considering the nature of this report, they are considered appropriate.

The costs for hydrogen storage are based upon either a liquefaction and cryogenic storage facility or underground storage. The liquefaction facility is based upon the upper end of a hydrogen liquefaction plants existing today the largest existing is approximately 32 tpd liquid H<sub>2</sub> (Decker 2019). As such a Facility of 27 tpd has been selected as a reasonable plant at the upper end of the existing sizes.

- Type: Cryogenic liquefaction and storage
- Temperature: Approximately - 252°C
- Capacity: 27 tpd (liquefaction)

Costs for a hydrogen pipeline distribution network associated with using hydrogen produced from SMR with CCS are based upon the assumption of a low pressure distribution network within a city. It will also take some time for a hydrogen network to be installed, so a small network has been sized based upon the assumption of limited hydrogen penetration initially, equivalent to the energy content 10% of NSW natural gas consumption.

- Type: Low Pressure Distribution within a city
- Capacity: 83.5 tpd
- Pipe materials: HDPE and Steel
- Pressure: 3 Bar (HDPE), 7 Bar (Steel)

## Hydrogen power generation

Hydrogen end users include power generation using reciprocating engines, turbines, and fuel cells with the following assumptions:

- 100% hydrogen reciprocating engine plant with capacity factor to align with hydrogen production available with storage from a 10 MW electrolyser plant at 80% capacity factor
- 100% hydrogen turbine small scale with capacity factor to align with hydrogen production available with storage from a 10 MW electrolyser plant at 80% capacity factor. Performance derate to be confirmed with OEM.
- Large gas turbine using 5% hydrogen blend in natural gas supplied from gas network
- Small (0.1 MW) and large scale (1 MW) fuel cell of PEM technology type
- Additional NO<sub>x</sub> emission control (e.g. SCR) not included if required for hydrogen/gas turbines



- Other relevant key assumptions as defined in Table 3-1
- Relevant facility terminal points as defined in Table 3-2

### 3.2.6 Ammonia production facility

The ammonia production facility in this report is based on the following assumptions:

- Ammonia synthesis using the Haber-Bosch process
- Nitrogen supply from air separation unit

Other assumptions are as included in Section 6.3 and Section 6.4 for hypothetical project and associated cost assumptions.

### 3.2.7 Carbon capture and storage

Carbon capture and storage (CCS) refers to the process of removing the CO<sub>2</sub> from the flue gas / exhaust gas which is produced from traditional thermal power stations and typically released into the atmosphere. CCS can also be applied to blue hydrogen production by SMR. The most common form of CCS for power station is a post-combustion capture technology using a chemical absorption process with amines as the chemical solvent.

It has been assumed that in addition to the CCS chemical absorption and CO<sub>2</sub> removal and compression process, a coal fired power station with CCS will also require selective catalytic reduction (SCR) for NO<sub>x</sub> removal and a flue-gas desulfurization (FGD) plant for SO<sub>x</sub> control. In Australia, depending on the coal quality and project location there may not be a specific requirement for the inclusion of SCR or FGD with a new coal-fired power station and as such these are not included in the non-CCS plant configuration. The post-combustion carbon capture absorption process typically has low NO<sub>x</sub> and SO<sub>x</sub> tolerances however and so these are included in the CCS plant configurations for coal-fired power station.

For the CCGT with CCS plant configurations it has been assumed that SCR and FGD processes would not be required due to the low sulphur content of Australia's natural gas and with the low NO<sub>x</sub> levels achievable with the latest gas turbine dry low NO<sub>x</sub> burner technology.

The downstream terminal point for the carbon capture process is assumed to be the outlet of the CO<sub>2</sub> compression plant at nominally 150 bar (no temporary storage assumed on site).

CO<sub>2</sub> transport costs are provided separately based on onshore transport via underground pipeline from the power station to the storage location. Costs are provided on a \$/tCO<sub>2</sub>/km basis.

CO<sub>2</sub> storage costs are provided separately and assumed to involve injecting the CO<sub>2</sub> into a depleted natural gas reservoir. Costs are provided on a \$/tCO<sub>2</sub> basis.

CO<sub>2</sub> capture rates of 90% and 50% have been considered.

### 3.2.8 Development and land costs

The development and land costs for a generation or storage project typically include the following components:

- Legal and technical advisory costs
- Financing and insurance
- Project administration, grid connection studies, and agreements
- Permits and licences, approvals (development, environmental, etc)
- Land procurement and applications

The costs for project and land procurement are highly variable and project specific. An indicative estimate has been determined based on a percentage of CAPEX estimate for each technology from recent projects, and experience with development processes.

### 3.2.9 Financial assumptions

The following key assumptions have been made regarding the cost estimates:

- Prices in AUD, 2021 basis for financial close in 2021. The Contractor's prices are fixed at this point for the execution of the project which may take several months or years depending upon the technology
- New plant (no second-hand or refurbished equipment assumed)
- Competitive tender process for the plant and equipment
- Taxes and import / custom duties excluded
- Assumes foreign exchange rates of 0.7 AUD:USD and 0.6 AUD:EUR
- No contingency applied
- No development premium considered

It is important to note that without specific engagement with potential OEMs and/or issuing a detailed EPC specification for tender, it is not possible to obtain a high accuracy estimate of costs. The risk and profit components of EPC contracts can vary considerably from project to project and are dependent upon factors such as:

- Project location
- Site complexity
- Cost of labour
- Cost of materials
- Market conditions
- Exchange rates

The accuracy / certainty of the cost estimates is targeted at +/- 30% based on the spread and quality of data available and our experience with the impact of the above factors.

### 3.3 Definitions

The following table provides definitions for each of the key terms used throughout this document and in the Excel-based dataset.

Table 3-3: Definition of key terms

Term	Definition
Summer rating conditions	DBT: 35°C
Base / design conditions	DBT: 25°C, RH: 60%, 110 m elevation
Not summer rating conditions	DBT: 15°C
Economic life (design life)	Typical design life of major components.
Technical life (operational life)	Typical elapsed time between first commercial operation and decommissioning for that technology (mid-life refurbishment typically required to achieve this Technical Life).
Development time	Time to undertake feasibility studies, procurement and contract negotiations, obtain permits and approvals (DA, EIA), secure land agreements, fuel supply and offtake agreements, secure grid connection, and obtain financing. This period lasts up until financial close.
EPC total programme	Total time from granting of Notice to Proceed (NTP) to the EPC Contractor until Commercial Operation Date (COD).
Total lead time	Time from issue of NTP to the EPC contractor up to the delivery of all major equipment to site.
Construction time	Time from receipt of major equipment to site up to the commercial operation date (COD). <i>Note that for simplicity it has been assumed that the total EPC programme = lead time + construction time. In reality lead time and construction time will overlap which would result in a longer actual construction time to that stated.</i>
Minimum stable generation	The minimum load - as a percentage of the rated gross capacity of that unit - that the generator unit can operate at in a stable manner for an extended period of time without supplementary fuel oil or similar support, and reliably ramp-up to full load while continuing to comply with its emissions licences.
Gross output	Electrical output as measured at the generator terminals.
Auxiliary load	The percentage of rated generation output of each unit - as measured at the generator terminals - that is consumed by the station and not available for export to the grid. This includes cable and transformer losses. The auxiliary load is provided as a percentage of the rated output at full load.
Net output	Electrical output exported to the grid as measured at the HV side of the generator step-up transformer. The net output of the unit can be calculated as the rated gross output at the generator terminals minus the auxiliary load.
Planned maintenance	Where a unit or number of units are offline for schedule maintenance in accordance with the OEM recommendations.
Average planned maintenance downtime	The average annual number of days per year over the Design Life that the power station (or part thereof) is offline for planned maintenance and unavailable to provide electricity generation. For configurations with multiple units the downtime - in number of days per year - has been proportioned in relation to the units' contribution to the overall power station capacity.
Forced maintenance / outage	Full and partial forced outage represent the percent of time within a year the plant is unavailable due to circumstances other than a planned maintenance event. In principle, "forced outages" represent the risk that a unit's capacity will be affected by limitations beyond a generator's control. An outage - including full outage, partial outage or a failed start - is considered "forced" if the outage cannot reasonably be delayed beyond 48 hours.
Equivalent forced outage rate (EFOR)	Equivalent forced outage rate is the sum of all full and partial forced outages/de-ratings by magnitude and duration (MWh) expressed as a percentage of the total possible full load generation (MWh). <i>Note Specific formulas are as defined in IEEE Std. 762.</i>

Term	Definition
Ramp up/down rate	The rate that an online generating unit can increase or decrease its generation output without affecting the stability of the unit i.e. while maintaining acceptable frequency and voltage control.
Heat rate	The ratio of thermal energy consumed in fuel over the electrical energy generated.
Efficiency	Calculated using: Efficiency (%) = 3600 / Heat Rate (kJ/kWh) x 100
Battery storage: Charge efficiency	The efficiency of the battery energy storage system (in %) when the battery is being charged.
Battery storage: Discharge efficiency	The efficiency of the battery energy storage system (in %) when the battery is being discharged.
Battery storage: Allowable maximum state of charge (%)	The maximum charge % of the battery system.
Battery storage: Allowable minimum state of charge (%)	The minimum charge % of the battery system.
Battery storage: Maximum number of cycles	The maximum total number of cycles within a typical battery lifetime.
Battery storage: Depth of discharge (DoD)	The percentage to which the battery can be discharged – i.e. the difference between the maximum allowable charge and minimum allowance charge states.
Total EPC cost	The EPC contract sum (exclusive of taxes).
Equipment cost	The component of the EPC contract sum that is primarily attributed to the supply of the major equipment. <i>Note that the total EPC cost has been split into “equipment cost” and “installation cost” for the purpose of this study, based on a typical proportion for that technology. Other EPC cost factors such as engineering, overhead, risk, profit, etc have been distributed evenly between the two.</i>
Installation cost	The component of the EPC contract sum that is primarily attributed to the site construction, installation, and commissioning works. <i>Note that the total EPC cost has been split into “equipment cost” and “installation cost” for the purpose of this study, based on a typical proportion for that technology. Other EPC cost factors such as engineering, overhead, risk, profit, etc have been distributed evenly between the two.</i>
Carbon Capture cost	The component of the EPC contract sum that is primarily attributed to the supply, construction, installation, and commissioning works for the Carbon Capture equipment and associated components.
Fixed operating cost (\$/MW Net/year)	Fixed costs include; plant O&M staff, insurance, minor contract work, and miscellaneous fixed charges such as service contracts, overheads, and licences. For some technologies where operation and maintenance are holistically covered by O&M and/or LTMA type contracts, all of the Operating Costs have been classed as “fixed” for the purposes of this study.
Variable operating cost (\$/MWh Net)	Variable costs include; spare parts, scheduled maintenance, and consumables (chemicals and oils). Variable costs exclude fuel consumption costs.
Total annual O&M Cost	Annual average O&M cost over the design life.
Energy consumption	Energy required to compress per tonne of hydrogen or to produce per tonne of ammonia (MWh/tonne)
Hydrogen consumption	Based on ammonia synthesis consumption, kg of hydrogen required per tonne of ammonia production, kg (H <sub>2</sub> )/tNH <sub>3</sub>
Water consumption	Water required to produce per tonne of ammonia, m <sup>3</sup> /t(NH <sub>3</sub> ), or required to produce per kg hydrogen (L/kgH <sub>2</sub> )
Hydrogen production rate	Hydrogen produced per day (kg of H <sub>2</sub> per day) for SMR plant, or per hour (kg of H <sub>2</sub> per hour) for electrolyser plant
Mass liquid H <sub>2</sub> stored	Tonnes of liquid H <sub>2</sub> storage
Annual ammonia output	Ammonia produced per year, tonnes per annum (tpa)

## 4 Generation Technologies

### 4.1 Overview

The following sections provide the technical and cost parameters for each of the nominated generation technologies (base load, variable generation, firming generation for variable renewable technologies and bio-energy), along with a brief discussion of typical options and recent trends. The information in the respective tables has been used to populate the AEMO GenCost 2021 Excel spreadsheets, which are included in Appendix A.

### 4.2 Onshore Wind

#### 4.2.1 Overview

Wind energy - *along with solar PV* - is one of the leading types of new renewable power generation technologies installed, both globally and in Australia. The most common technology used is the three-bladed horizontal-axis wind turbines (HAWT), with the blades upwind of the tower. These turbines are typically classified by the design wind speed and turbulence intensity of the wind (i.e. Class IA to IIIC). Grid-connected wind turbines are considered a reliable and mature technology with many years of operational experience.

#### 4.2.2 Typical options

Currently deployed utility-scale wind turbine sizes range from 1 to 5 MW, with the newest around 6 MW, hub heights of 50 to 150 m and rotor diameters of 60 m to 160 m. New models proposed for near future projects are around 6 MW capacity with rotors around 160-170 m in diameter and hub heights up to 170 m.

Onshore wind developments are critically dependent on:

- Access to land
- Planning permissions / development consents
- Nearby grid transmission capacity

Wind resource, while still important, has become less of a critical factor in project viability as increases in turbine height and rotor diameter along with cost reductions and design improvements have improved the economics of onshore wind projects, which has opened up larger areas for development.

Depending on the above, modern onshore wind farms can range from 1 to over 150 turbines. Different OEMs and turbine models have slightly different power curves, with some more suited to a particular site wind resource than others. As such, levelised cost of energy (LCOE) option is highly site-specific.

Modern projects are also increasingly being delivered with a co-located battery and or solar PV plant to reduce intermittency of generation and improve utilisation of connection assets.

#### 4.2.3 Recent trends

The design wind range for wind turbines has changed over the last few decades. Early focus was on very windy sites for best economics e.g. Class I = 8.5m/s to 10m/s. Class I wind turbines now only represents a small fraction of total manufacturing worldwide. Currently, large turbines are being used in medium (Class II) and low wind speed sites (Class III) to achieve net capacity factors around 40%.

Turbine outputs, hub heights, and rotor diameters are continually being increased. These increases are resulting in lower installed costs (\$/MW) and improved annual capacity factors.

For projects that are currently planned and under construction, wind turbine sizes in the 4 – 6 MW range are being used. Projects due for commencement in 2022/2023 are at the upper end of the range.

Wind farm sizes throughout Australia have historically mostly been in the 50 to 150 MW capacity range. However, in recent years new wind farms - *planned and under construction* - are expanding to total capacities in the range of 200 to 1,000 MW.

Typical capacity factors at the connection point range from 30% to 50%. Capacity factors are linked to the wind resource and turbine model used, with the main factor being the size of the rotor relative to the rated power output of the generator. The spacing of turbines within the available land also influences capacity factor due to greater wake losses with tighter turbine spacing. With recent developments in turbine design, capacity factors have been increasing. The most recent onshore wind projects on the NEM have reported capacity factors of approximately 40-45%.

In recent years the development and grid connection of new windfarm projects has become more challenging. Planning applications require that wind turbine maximum tip heights are nominated very early in the approvals process. The rate of new developments in wind turbine technology has been so high that at the time of project execution the planning approvals need to be amended to enable the use of the latest and most economically viable technology. New requirements for grid connection approvals and Generator Performance Standards (GPS) have also been extending the time required for completion of the supporting studies, with more certainty required by investors and lenders prior to starting construction. These factors have been extending the overall development timeframes for new windfarms in Australia.

Design life of an onshore wind farm is typically 25 years based on the certified design life of the turbines. However, in recent years investors have assumed economic life of 30 or 35 years with an associated increase in maintenance costs in later years to address increasing numbers of component failures. It is assumed that structural components such as towers and foundations can operate for this extended period.

#### 4.2.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project upon which costing is based. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021, given the above discussion on typical options and current trends.

Table 4-1: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology / OEM		Siemens Gamesa	Other options include Vestas, GE, Goldwind, etc
Make model		SG 6.0-170	Based on current new installations
Unit size (nominal)	MW	6.0	ISO / nameplate rating
Number of units		50	
<b>Performance</b>			
Total plant size (Gross)	MW	300	
Auxiliary power consumption	%	3%	No significant auxiliary power consumption during wind farm operation but there are electrical distribution losses from the turbines to the substation.
Total plant size (Net)	MW	291	
Seasonal rating – Summer (Net)	MW	291	Derating above 30°C based on OEM datasheet. Note derating only occurs in high generation (i.e. high wind) and high temperatures.
Seasonal rating – Not Summer (Net)	MW	291	Accounting for temperature related factors only.
<b>Annual Performance</b>			

Item	Unit	Value	Comment
Average planned maintenance	Days / yr.	-	Included in EFOR below.
Equivalent forced outage rate	%	2%	Majority large wind farms currently being constructed in Australia have contractual warranted availability of 98% (or higher) for wind turbines for up to a 25-year period.
Effective annual capacity factor (year 0)	%	37.5%	Dependent on wake losses, wind resource, and electrical losses. Based on gross capacity.
Annual generation	MWh / yr.	985,500	Provided for reference.
Annual degradation over design life	%	0.1%	Assuming straight line degradation.

**Table 4-2: Technical parameters and project timeline**

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp up rate	MW/min	Resource dependent	
Ramp down rate	MW/min	Resource dependent	
Start-up time	Min	N/A	Always on. < 5 min after maintenance shutdown.
Min stable generation	% of installed capacity	Near 0	
<b>Project timeline</b>			
Time for development	Years	3 – 5	Includes pre-feasibility, design, approvals etc. For wind a key factor is the availability of wind resource data. Installing wind masts at the nominated hub height can add 12 months to detailed feasibility assessments, pushing the timeframe to the upper end of the scale. Obtaining development approvals and consents can also add considerable time to the overall development schedule. Conversely, if there are already long-term consents in place development time could be in the order of 2 years.
First year assumed commercially viable for construction	Year	2021	
EPC programme	Years	2	For NTP to COD.
■ Total lead time	Years	1	Time from NTP to first turbine on site.
■ Construction time	Weeks	52	Time from first turbine on site to last turbine commissioned.
Economic life (design life)	Years	20 – 25	Varies between manufactures.
Technical life (operational life)	Years	25 – 35	Includes life extension but not repowering.

## 4.2.5 Cost estimate

Table 4-3: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX Construction</b>			
Relative cost	\$ / kW	1,850	Based on Aurecon internal benchmarks. There is an ongoing general downwards trend for onshore wind plant costs, although there are current possibilities of some short term price hikes due to issues that are temporary in nature.
Total cost	\$	555,000,000	
■ Equipment cost	\$	388,500,000	70% of EPC cost – typical.
■ Installation cost	\$	166,500,000	30% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	15,300,000	Assuming 3% of CAPEX. Note land for wind farms is typically leased.
Fuel connection costs	\$	N/A	
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	25,000	Average annual cost over the design life. O&M costs typically increase steadily over the project life.
Variable O&M Cost	\$ / MWh (Net)	-	Included in the fixed component.
Total annual O&M Cost	\$	7,500,000	Annual average cost over the design life.

## 4.3 Offshore Wind

### 4.3.1 Overview

Offshore wind turbines are fundamentally the same as onshore wind turbines, however they have been designed to survive in the aggressive offshore environment and involve very different foundations.

Offshore wind developments can offer some advantages over onshore projects:

- Access to offshore wind resources which when compared to onshore resources are generally:
  - stronger
  - less turbulent
  - can have better temporal alignment with generic demand profiles (i.e. windier in the late afternoon than onshore)
- Reduced visual and noise pollution concerns, due to being out at sea
- An offshore development adjacent to a large demand centre (city) can avoid expensive overland transmission compared to some onshore projects
- Turbines are typically manufactured near canals or ports and barged to site

A combination of the above factors permits the use of much larger wind turbines offshore which can improve project economics. Commonly cited challenges include:

- Proximity to onshore transmission infrastructure and associated costs
- Harsh conditions from marine operating environment
- Expensive operation and maintenance costs of offshore sites



- High balance of plant costs (foundations and electrical connections) which are the major cost for offshore sites whereas for onshore projects the major costs are the turbines

It is also worth noting that development of an offshore project - *especially given the non-existent offshore wind market in Australia compared to Europe* - would be significantly more complicated and involved than an onshore project, which would impact project development timelines accordingly. This is being experienced by the most advanced currently proposed offshore wind farms in Australia.

### 4.3.2 Typical options

Existing offshore wind turbines range in nameplate capacity from 3 MW to 9.5 MW, with correspondingly large rotor diameters but hub-heights in similar or slightly larger ranges than onshore equivalents. Aurecon notes however, that the market is trending towards much larger turbines (see Section 4.3.3 below).

Offshore wind farms are typically larger in both turbine number and total output due to the following:

- Significant capital expenditure associated with the challenging nature of offshore construction and maintenance combined with expensive subsea grid connection requires larger builds to drive down normalised capital and operational costs
- Reduced limitations arising from land parcel boundaries and associated complications

As such it is not uncommon to have offshore projects in development with 50-150 turbines and 400 MW+ capacity. Aurecon notes that globally there are multiple projects in the development pipeline with capacities in excess of 1,000 MW.

Contrary to the use of the term 'offshore' in the oil and gas industry, offshore wind turbines are currently limited to fjords, lakes and continental shelves with a depth upper limit of 50 – 60 m. Note that:

- Traditionally mounted wind turbines are mounted on a single monopile in water depths <30 m
- More recently complex structures have been developed to reach deeper waters, including tripod style piled structures, which are suitable for depths of up to 60 – 80 m

For depths over 60 – 80 m, floating structures are proposed with a number of demonstration turbines installed or in planning. The first commercially operating wind farm using floating type structure, Hywind Scotland, was commissioned in late 2017<sup>1</sup> and so this is still considered to be in the early commercialisation stage.

### 4.3.3 Recent trends

In Europe the cost of offshore wind has been falling dramatically since 2015, from about 5000 USD / kW down to 3185 USD / kW in 2020.<sup>2</sup> This reduction has been attributed to the following factors:

- Increased market efficiency through increased constructor competition and competitive auction processes for new projects
- Development of current generation of large turbines (6 – 10 MW)
- Increases in total installed capacity

Further investment efficiency gains are expected to be realised in the European market with the announcement of even larger turbines (such as Vestas 15 MW, 236 m rotor diameter platform due for serial production in 2024).

It should be noted that these cost reductions have been realised off the back of a maturing European development and delivery market. Given that the current offshore development and delivery capability in Australia is virtually non-existent, Aurecon would recommend caution in assuming efficient translation of

<sup>1</sup> <https://www.windpowerengineering.com/business-news-projects/worlds-first-floating-wind-farm-delivers-promising-results/>

<sup>2</sup> IRENA (2021), Renewable Power Generation Costs in 2020, International Renewable Energy Agency, Abu Dhabi

European costs to Australian projects. Australian projects will need to factor in costs of shipping turbines and specialist installation equipment (for instance jack up cranes).

In Australia, there are no existing offshore wind projects, and only one which has secured a resource exploration licence (the Star of the South off the coast of Gippsland in Victoria). As such, costs for offshore wind in Australia are expected to be above the international average until experience is gained and supply chains established. However, there exists a general ongoing downwards trend for offshore wind plant costs.

#### 4.3.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 given the above discussion on typical options and current trends.

Table 4-4: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology / OEM		Vestas	
Make model		V164-9.5	
Unit size (nominal)	MW	9.5	Modern offshore turbines are very large compared to onshore variants.
Number of units		100	
<b>Performance</b>			
Total plant size (Gross)	MW	950	
Auxiliary power consumption	%	4%	No significant auxiliary power consumption during wind farm operation but there are electrical distribution losses from the turbines to the substation. Nominal allowance only. Dependant on distance from shore.
Total plant size (Net)	MW	912	
Seasonal Rating – Summer (Net)	MW	912	Derating occurs above 35°C based on OEM datasheet. Note derating only occurs in high generation (i.e. high wind) and high temperatures.
Seasonal Rating – Not Summer (Net)	MW	912	
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	-	Included in EFOR below.
Equivalent forced outage rate	%	5%	Based on international benchmarks.
Effective annual capacity factor	%	45%	Based on international benchmarks.
Annual generation	MWh / yr.	3,747,465	Provided for reference.
Annual degradation over design life	%	0.1%	Assuming straight line degradation.

Table 4-5: Technical parameters and project timeline

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp up rate	MW/min	Resource dependent	

Item	Unit	Value	Comment
Ramp down rate	MW/min	Resource dependent	
Start-up time	Min	N/A	Always on. < 5 min after maintenance shutdown.
Min stable generation	% of installed capacity	Near 0	
Project timeline			
Time for development	Years	4 – 5	Typical for Europe.
First year assumed commercially viable for construction	Year	2021	
EPC programme	Years	5	For NTP to COD.
■ Total lead time	Years	2	Time from NTP to first turbine on site.
■ Construction time	Weeks	156	Time from first turbine foundation on site to last turbine commissioned.
Economic life (design life)	Years	25	
Technical life (operational life)	Years	35	

### 4.3.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-6: Cost estimates

Item	Unit	Value	Comment
CAPEX – EPC cost			
Relative cost	\$ / kW	4,330	Based on US\$3,185 / kW which was the 2020 global weighted-average installed costs for offshore wind <sup>3</sup> . Capital cost includes a certain percent of grid connection cost, typically 8-24%. It is country specific, and in some countries (e.g. China, Denmark and the Netherlands) developers are not responsible for electrical interconnection.
Total EPC cost	\$	4,113,500,000	
■ Equipment cost	\$	2,879,450,000	70% of EPC cost – typical.
■ Installation cost	\$	1,234,050,000	30% of EPC cost – typical.
Other costs			
Cost of land and development	\$	82,270,000	Assuming 2% of CAPEX due to large project scale.
Fuel connection costs	\$	N/A	
OPEX – Annual			
Fixed O&M Cost	\$ / MW (Net)	149,900	Based on an indicative average of 25 Euro/MWh <sup>4</sup> .
Variable O&M Cost	\$ / MWh (Net)	-	Included in the fixed component.
Total annual O&M Cost	\$	142,405,000	Annual average cost over the design life

<sup>3</sup> IRENA (2021), Renewable Power Generation Costs in 2020, International Renewable Energy Agency, Abu Dhabi

<sup>4</sup> P.E. Morthorst, L. Kitzing, "Economics of building and operating offshore wind farms", Technical University of Denmark, Roskilde, 2016

## 4.4 Large-scale solar photovoltaic (PV)

### 4.4.1 Overview

Over the last decade, solar PV generation has emerged as a significant growth technology globally. Improvements in solar PV technology and reduction in costs have led to the widespread uptake and increasing sizes of utility-scale solar PV systems.

In large-scale solar PV systems, tens to hundreds of thousands of solar PV modules are connected to inverters, which converts the electricity generated from DC to AC. The outputs from each of the inverters in the solar farm are aggregated and exported to the network through the connection point.

The output of solar PV systems is highly dependent on the availability of solar resource. Generally, the solar resource in Australia is excellent, although slightly less in the south and along the eastern coast. Large-scale solar PV systems usually located in close proximity to a major transmission line to minimise grid connection costs.

### 4.4.2 Typical options

At the utility-scale, solar PV plants typically fall into two categories: fixed-tilt or single-axis tracking. Other configurations such as dual-axis tracking, high density ground mount etc may be used, but are uncommon and typically used for smaller installations. In fixed-tilt systems, modules are mounted on a static frame, which is generally tilted towards the north. In single-axis tracking systems, modules are mounted on a torque tube, which rotates around a north-south axis, allowing the modules to track the sun's movement from east to west throughout the day. Single-axis tracking systems have a higher capital cost than fixed-tilt systems. However, they generally have a lower LCOE, as they produce more energy throughout the day.

Solar PV panel (or module) design is another key area which affects overall plant capacity. Historically, mono-facial panels (i.e. generation on one side of the panel) have been implemented at solar farms. However, bi-facial panels, which also generate electricity on the rear of the panel by capturing reflected irradiance, have become a viable option. In Australia most new solar farm projects being constructed are using bi-facial panels.

### 4.4.3 Recent trends

The widespread deployment of solar PV systems globally has led to significant reduction in the cost of solar panels in recent years. Although the rate of solar panel cost reduction is slowing, investment in the sector is growing, with several large-scale (i.e. >200 MW) solar farms under development in Australia.

Solar farm sizes are also on the upward trend with some projects reaching financial close in 2020 and 2021 being in the 200 to 400 MWac range. This relates primarily to their connection at higher grid voltages and the spreading of fixed project costs across a larger system.

Due to the relatively low cost of the solar PV modules, solar developers are increasingly installing more solar panel capacity than grid connection capacity (i.e. higher DC:AC ratio). Though some power generation is curtailed in the middle of the day in the early years of the project life, this allows a more consistent, flatter generation profile, with increased generation in the early morning and late afternoon. The output of the solar modules typically degrades steadily over the project life, which reduces the level of inverter clipping. Developers are also installing more inverter capacity than grid connection capacity to improve reactive power capabilities and meet NER requirements.

Single-axis tracking systems are becoming widely deployed, due to the increased energy capacity they offer over fixed-tilt systems in the early morning and late afternoon. This results in improved project economics. Single-axis tracking systems that mount two modules in a portrait configuration (known as "2P trackers") are also growing in popularity, allowing for reduced installation costs and increased bifacial uplift for modules that are higher off the ground and spaced further apart if the tracker design can accommodate the increased wind loadings of such configurations.

Solar module capacities have been rising over recent years, with modules on utility-scale solar farms under construction typically around 500 W. Bi-facial modules are now offered as standard for utility projects, allowing greater power generation for the same overall footprint.

Many solar farms have experienced delays in the grid connection process. In order to meet power quality restrictions enforced under the Generator Performance Standards harmonic filters are generally required.

#### 4.4.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021, given the above discussion on typical options and current trends.

Table 4-7: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology		Single Axis Tracking (SAT)	Based on recent trends.
<b>Performance</b>			
Plant DC Capacity	MW	240	
Plant Ac Inverter Capacity	MVA	240	Additional reactive power allowance for NER compliance
Plant AC Grid connection	MW	200	Active power at point of connection
DC:AC Ratio		1.2	Typical range from 1.1 to 1.3
Auxiliary power consumption	%	2.9%	Very little auxiliary power consumption during operation but there are electrical distribution losses
Total plant size (Net)	MW (AC)	194.2	
Seasonal Rating – Summer (Net)	MW (AC)	194.2	Degradation expected above 35°C. Expect approximately 10% de-rate at 50°C.
Seasonal Rating – Not Summer (Net)	MW (AC)	194.2	
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	-	Included in EFOR below.
Equivalent forced outage rate (EFOR)	%	1.50%	Based on 98.5% O&M availability.
Effective annual capacity factor	%	29%	AC MW basis, Highly dependent on location. Number based on a system installed in regional NSW.
Annual generation	MWh / yr.	493,345.7	Calculated from capacity factor above.
Annual degradation over design life	%	0.4%	On AC basis.

Table 4-8: Technical parameters and project timeline

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp Up Rate	MW/min	Resource dependant	
Ramp Down Rate	MW/min	Resource and system dependant	
Start-up time	Min	N/A	

Item	Unit	Value	Comment
Min Stable Generation	% of installed capacity	Near 0	
<b>Project timeline</b>			
Time for development	Years	2 – 3	
First Year Assumed Commercially Viable for construction	Year	2021	
EPC Programme	Years	1.5	18 months for NTP to COD.
1 Total lead time	Years	1	Time from NTP to first inverter on site.
2 Construction time	Weeks	26	Time from first inverter on site to COD.
Economic Life (Design Life)	Years	30	Typical given current PV module warranties
Technical Life (Operational Life)	Years	30	+40 if piles don't corrode and the spare parts remain available.

#### 4.4.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

**Table 4-9: Cost estimates**

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / W (DC)	1.10	
Total EPC cost	\$	264,000,000	
3 Equipment cost	\$	158,400,000	60% of EPC cost – typical.
4 Installation cost	\$	105,600,000	40% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	15,840,000	Assuming 10% of CAPEX.
Fuel connection costs	\$	N/A	
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	17,000	Includes allowance for general spare parts and scheduled replacement capex
Variable O&M Cost	\$ / MWh (Net)	-	Included in the fixed component.
Total annual O&M Cost	\$	3,400,000	Annual average cost over the design life

## 4.5 Concentrated Solar Thermal

### 4.5.1 Overview

Concentrated solar thermal technology in power generation applications generally refers to using mirrors to collect solar energy over a wide area and then concentrating the reflected energy onto a central receiver. The energy is then captured by a thermal fluid which is cycled through the receiver and either stored or used directly for power generation.

There are four primary types of concentrated solar thermal power plants available in the current market. These include:

- Solar Tower – Solar tower technologies use a ground-based field of sun-tracking mirrors or heliostats to focus sunlight onto a receiver mounted on top of a central tower. A heat transfer fluid is heated in the receiver, which is then used to generate steam. This steam is used in a conventional steam turbine generator to produce electricity. The heliostats use two-axis tracking systems to follow the sun.
- Parabolic Trough Collectors – Parabolic Trough systems consist of parabolic, trough-shaped solar collectors which concentrate the sun rays onto a tubular heat receiver placed at the focal line of the solar collector. A single-axis tracking system is used to orient both solar collectors and heat receivers toward the sun.
- Linear Fresnel Collectors – This technology uses long flat, or slightly curved, mirrors placed at different angles. These move independently on a single axis, to concentrate the sunlight on either side of a fixed receiver. The fixed receivers are mounted above the mirrors on towers.
- Parabolic Dish – This technology consists of a parabolic dish-shaped concentrator that reflects the solar direct radiation on to a receiver placed at the focal point of the dish. The dish-shaped concentrators are mounted on structures with two-axis tracking systems that follow the sun. The collected heat is used directly by a heat engine mounted on the receiver. Typical heat engine cycles deployed are Stirling or Brayton cycle (micro-turbine).

Parabolic trough collectors are by far the most mature technology and account for the largest number of installations globally. Solar tower projects are currently transitioning from pilot plants to commercial plants, with a number of large-scale solar tower commercial plants under construction or operation globally. Linear Fresnel and Parabolic dish systems are still in pilot or demonstration phase.

The key advantage of concentrated solar thermal, in comparison to solar PV and wind technologies, is its ability to incorporate thermal energy storage which increases its capacity factor, shifts generation to the evening peak period, and allows the plant to be dispatched. Solar tower projects typically generate power by using the stored energy to raise steam which is then passed through a steam turbine in a conventional Rankine cycle. In this way, they can provide system inertia which is critical to grid operation in areas with increasing penetration of variable renewable energy generation from solar PV and wind.

Solar thermal plants are however capital intensive, with cost drivers including storage volumes, the solar multiple, and the DNI of the location.

The O&M requirements of solar thermal plants are lower in comparison to fossil fuel plants but still significant, much of which relates to fixed labour costs. Key O&M costs include replacement of receiver elements and mirrors due to breakage, cost of field mirror cleaning (including water consumption), and plant insurance. O&M costs for the steam cycle and BOP (i.e. steam turbine, cooling system, electrical systems, etc) are similar to traditional thermal plant O&M costs.

## 4.5.2 Typical options

As mentioned above, the key differentiation of the concentrated solar thermal technologies as against solar PV or wind is the ability to integrate thermal energy storage. Although inclusion of thermal energy storage increases the installed cost of the plant, current trends show thermal energy storage is being included on most projects under construction and all projects under development<sup>5</sup>.

Typical plant configurations are generally split between parabolic trough and solar tower with thermal storage. Utility-scale plants currently under construction globally range from 50 MW to 700 MW with storage between 9 hours and 17.5 hours<sup>5</sup>. As with many technologies, increases in scale drive reductions in costs and levelised cost of energy, both in manufacturing efficiencies for the heliostats and other components, and in the steam turbine efficiency which is highly dependent on size. Increasing the size of centralised solar tower projects also creates engineering challenges as the outer heliostats are further from the receiver and

<sup>1</sup> <https://solarpaces.nrel.gov/by-status>

<sup>2</sup> H1 2021 Solar Industry Update, NREL, 22 June 2021

<sup>3</sup> <https://nwqhpp.com/>

must be able to focus accurately over a large distance, typically requiring significant stiffness in structure. The Vast Solar technology developed in Australia is seeking to overcome this challenge through the use of a modular approach with many smaller arrays of heliostats focusing on shorter towers. This configuration also enables the use of molten sodium as the heat transfer fluid, which has a number of advantages over molten salt, the most significant being the lower freezing point (around 90°C compared to around 220°C for solar salts which are typically a mixture of sodium and potassium nitrates). The lower melting point of sodium means the heat transfer fluid can be more easily transported over long distances with trace heating in pipework to maintain the liquid state and to readily melt the sodium if it does freeze.

Due to the nature of the solar tower technology, through concentrating the solar energy to a single focal point, this technology can produce the highest temperatures and hence offers improved steam cycle efficiencies over the parabolic trough alternatives as well as reduced thermal storage requirements. Significant research and development is underway in Australia and globally to develop the next generation of solar thermal technologies with temperatures of 700°C and above in order to improve efficiency and reduce the cost of delivered energy.



### 4.5.3 Recent trends

Solar thermal capacity grew six-fold globally between 2010 and 2020 on the back of incentive schemes in key markets like Spain and the USA. From 2015 to 2020, approximately 2 GW of CSP was installed in other parts of the world, particularly the Middle East, North Africa, and China, and total installed capacity is currently around 7 GW<sup>6</sup>. Development has increased and BNEF currently estimates a pipeline of 8.8 GW including 1.4 GW under construction, 1.2 GW permitted, and 6.2 GW announced.

As mentioned above, the trend is to have thermal storage integrated with the solar thermal plant. Molten salt is the current preferred heat transfer fluid for solar tower technology, while mineral oils continue to be preferred for parabolic trough technology. However, the use of molten salt is also increasing with parabolic troughs. Use of molten salt results in increased steam cycle efficiencies in comparison to mineral oils based on their ability to enable higher steam temperature generation.

The US Department of Energy's Gen3 concentrating solar research programme selected sodium during 2020 as its preferred heat transfer fluid for the next generation of projects. However, a recent selection process between liquid, gas and particle receiver technologies for the ongoing research funding chose particle receivers as the preferred technology.

Plant capacity factors have been increasing over time to above 50% with larger thermal storage capacities of over 8-hour storage.

In Australia, there is currently no utility-scale concentrated solar thermal project in commercial operation. However, Vast Solar is progressing a 50 MW baseload hybrid solar plant in Mt Isa which includes a 56 MW solar tower plant with 14.5 hours thermal energy storage, an 80 MW PV plant, 52 MW/15 MWh BESS, and 57 MW of reciprocating gas engines<sup>7</sup> in order to provide a very high level of reliability for the Mt Isa Network. The project is in late development stage with Stanwell as a partner, and follows Vast Solar's 1.1 MW Pilot Project in NSW.

SolarReserve previously proposed the Aurora Solar Energy Project, a 150 MW solar tower with eight hours molten salt energy storage to be located in Port Augusta, South Australia (SA). The project entered into a power purchase agreement with the South Australia Government in 2017, but that agreement was terminated in early 2019 following the inability to achieve financial close.

Given the lack of projects in Australia, there is very little information on the cost of solar thermal projects for the region.

### 4.5.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2020, given the above discussion on typical options and current trends.

Table 4-10: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology		Solar Tower with Thermal Energy Storage	Based on typical options, recent trends and more specifically the latest proposed CSP projects mentioned in Australia in Section 4.4.3
Power block		1 x Steam Turbine, dry cooling system	

<sup>4</sup> Alinta, 2015. Port Augusta Solar Thermal Generation Feasibility Study

<sup>5</sup> [https://itpthermal.files.wordpress.com/2019/02/itpt\\_csproadmap3.0.pdf](https://itpthermal.files.wordpress.com/2019/02/itpt_csproadmap3.0.pdf)

<sup>6</sup> H1 2021 Solar Industry Update, NREL, 22 June 2021

<sup>7</sup> <https://nwqhpp.com/>

Item	Unit	Value	Comment
Capacity	MW	200	Based on typical options, recent trends, and more specifically the latest commercial CSP project mentioned in Australia in Section 4.5.3 , 200 MW with 12 hours thermal energy storage is selected.
Power cycle efficiency	%	41.2	Typical
Heat transfer fluid		Molten salt	Molten salt is the preferred heat transfer fluid for solar tower technology,
Solar Multiple		2.4	Ratio between solar receiver thermal size vs power block thermal size,
Storage	Hours	12	As mentioned in Section 4.5.3, almost all recent projects have a thermal energy storage component. 12 hours was chosen as representative.
Storage type		2 tank direct	
Storage description		Molten salt	
<b>Performance</b>			
Total plant size (Gross)	MW	200	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	10%	
Total plant size (Net)	MW	180	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	180	
Seasonal Rating – Not Summer (Net)	MW	180	
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	7	Based on published figures <sup>8</sup> .
Equivalent forced outage rate	%	3%	Based on published figures <sup>8</sup> .
Effective annual capacity factor	%	50%	Based on published figures <sup>9</sup> .
Annual generation	MWh / yr.	876,000	Provided for reference.
Annual degradation over design life	%	0.2%	Typical for subcritical steam cycle.

Table 4-11: Technical parameters and project timeline

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp Up Rate	MW/min	6	Based on 4% of turbine maximum output.
Ramp Down Rate	MW/min	6	Based on 4% of turbine maximum output.
Start-up time	Minutes	Hot: 60 - 120 Warm: 120 - 270 Cold: 200 - 480	Standard operation.
Min Stable Generation	% of installed capacity	20%	

<sup>8</sup> Alinta, 2015. Port Augusta Solar Thermal Generation Feasibility Study  
<sup>9</sup> [https://itpthermal.files.wordpress.com/2019/02/itpt\\_csproadmap3.0.pdf](https://itpthermal.files.wordpress.com/2019/02/itpt_csproadmap3.0.pdf)

Item	Unit	Value	Comment
<b>Project timeline</b>			
Time for development	Years	2 – 3	includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	
Total EPC programme	Years	3.5	42 months from NTP to COD.
■ Total Lead Time	Years	1.75	Time from NTP to main equipment on site.
■ Construction time	Weeks	91	Time from main equipment on site to COD.
Economic Life (Design Life)	Years	25	
Technical Life (Operational Life)	Years	40	

#### 4.5.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-12 Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / kW (net)	6,000	Very little project information in Australia relating to build cost for CSP plant. Estimate based on ITP report T0036, "Informing a CSP Roadmap for Australia." Table 20 <sup>10</sup> and recent international construction costs, with a small allowance for higher cost of first projects in Australia
Total EPC cost	\$	1,200,000,000	
■ Equipment cost	\$	900,000,000	75% of EPC cost – typical.
■ Construction cost	\$	300,000,000	25% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	4,800,000	Assuming 4% of CAPEX.
Fuel connection costs		N/A	
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW	120,000	2% of CAPEX (based on ITP report T0036, "Informing a CSP Roadmap for Australia." <sup>10</sup> ).
Variable O&M Cost	\$ / MWh	-	Included in fixed component.
Total annual O&M Cost	\$	24,000,000	Annual average cost over the design life

<sup>10</sup> [https://itpthermal.files.wordpress.com/2019/02/itpt\\_csproadmap3.0.pdf](https://itpthermal.files.wordpress.com/2019/02/itpt_csproadmap3.0.pdf)

## 4.6 Reciprocating Engines

### 4.6.1 Overview

Reciprocating engines are a widespread and well-known technology used in a variety of applications. They are typically categorised by speed, stroke, configuration, and ignition/fuel type.

For power generation applications, reciprocating engines are coupled to a generator on the same base frame. For grid scale applications, centralised installations are typically installed in a common powerhouse structure in a multi-unit configuration with separate cooling systems, air intake/filter, exhaust silencer, stack structure, etc.

Reciprocating engines utilise synchronous generators, which provide high fault current contribution and support the NEM system strength.

### 4.6.2 Typical options

For power generation applications, there are two general classifications of reciprocating engine - medium-speed and high-speed. Medium-speed engines operate at 500 – 750 rpm and typically range in output from 4 to 18 MW. High-speed engines operate at 1,000 – 1,500 rpm with a typical output below 4 MW.

Additionally, there are three general fuel classes for reciprocating engines. These are gaseous fuel, liquid fuel, and dual fuel. Gaseous fuel engines - *also known as spark ignition engines* - operate on the thermodynamic Otto cycle, and typically use natural gas as the fuel source. Liquid fuel engines operate based on the thermodynamic Diesel cycle, and typically use no. 2 diesel (or heavy fuel oil) as the fuel source. Dual fuel engines can operate on either gaseous or liquid fuel, however always rely on a small consumption of diesel as a pilot fuel.

### 4.6.3 Recent trends

Traditionally multi-unit reciprocating engine installations on the NEM have consisted of high-speed spark-ignition engines, fuelled from coal seam methane or waste gas where the fuel gas is not suited to gas turbines. Installed capacities of these power stations are in the <50 MW range. Historically, capacity factors have been dependant on fuel gas availability.

Given the high degree of uncertainty around medium to long-term market conditions, large-scale medium-speed reciprocating engine power stations are increasing in popularity for firming applications. This is driven by their favourable fuel efficiency merits, and high degree of flexibility in start times and turn-down. This provides a strong business case for a wide range of capacity factors.

AGL's Barker Inlet Power Station is currently the only large-scale medium-speed reciprocating engine power station in operation on the NEM which commenced commercial operation in 2019. Pacific Energy has also entered into an agreement to supply a similar power station to supply power to FMG's Solomon mine in Western Australia's Pilbara region<sup>11</sup>.

Other large-scale medium-speed installations for the NEM which are in the planning phase include the following. These however are yet to be progressed further:

- AGL's Barker Inlet Power Station (Stage 2 – 210 MW)
- APA's Dandenong Power Project (Stage 1 – 220 MW, Stage 2 – 110 MW)

Equipment pricing is not expected to decrease materially in the near future. Marginal performance improvements are also expected over time with ongoing technology developments.

<sup>11</sup> <https://www.australianmining.com.au/news/fortescue-hands-solomon-energy-contract-to-pacific-energy/>

## 4.6.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 given the above discussion on typical options and current trends.

Table 4-13: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology / OEM		Wartsila	MAN Diesel and Rolls Royce Bergen (RRB) also offer comparable engine options.
Make model		18V50DF	Including SCR for NO <sub>x</sub> emission control
Unit size (nominal)	MW	17.6	ISO / nameplate rating at generator terminals.
Number of units		12	
<b>Performance</b>			
Total plant size (Gross)	MW	211.2	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	1%	Excludes intermittent auxiliary loads. Overall average consumption could be closer to 2.5%.
Total plant size (Net)	MW	209.1	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	209.1	Derating does not typically occur until temperatures over 38 – 40°C.
Seasonal Rating – Not Summer (Net)	MW	209.1	
Heat rate at minimum operation	(GJ/MWh) LHV Net	10.259	25°C, 110 metres, 60%RH. Assuming minimum operation on gaseous fuel.
Heat rate at maximum operation	(GJ/MWh) LHV Net	7.940	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, LHV Net	45.3%	25°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) HHV Net	11,356	25°C, 110 metres, 60%RH
Heat rate at maximum operation	(GJ/MWh) HHV Net	8,790	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, HHV Net	40.9%	25°C, 110 metres, 60%RH
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	2.7	Based on each engine only running 2190 hours per year.
Equivalent forced outage rate	%	2%	
Annual capacity factor	%	25%	Typical for current planned firming generation dispatch.
Annual generation	MWh / yr.	457,903	Provided for reference based on assumed capacity factor.
Annual degradation over design life - output	%	0%	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.05%	Assuming straight line degradation.

Table 4-14: Technical parameters and project timeline

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp Up Rate	MW/min	36	Station ramp rate (all units) under standard operation. Based on OEM data.
Ramp Down Rate	MW/min	36	Station ramp rate (all units) under standard operation. Based on OEM data.
Start-up time	Min	10	Standard operation. Based on OEM data. 5-minute fast start is available.

Item	Unit	Value	Comment
Min Stable Generation	% of installed capacity	40%	Can turn down to 10% on diesel operation. Based on OEM data.
<b>Project timeline</b>			
Time for development	Years	2	includes pre/feasibility, design, approvals, procurement, etc.
First Year Assumed Commercially Viable for construction	Year	2021	
EPC programme	Years	2	For NTP to COD.
■ Total Lead Time	Years	1	12 months typical to engines on site.
■ Construction time	Weeks	52	12 months assumed from engines to site to COD.
Economic Life (Design Life)	Years	25	Can be capacity factor dependant
Technical Life (Operational Life)	Years	40	

## 4.6.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-15: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / kW	1,500	Net basis
Total EPC cost	\$	313,650,000	
■ Equipment cost	\$	188,190,000	60% of EPC cost – typical.
■ Installation cost	\$	125,460,000	40% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	28,228,500	Assuming 9% of CAPEX.
Fuel connection costs	\$M	\$20M +\$1.5M/km	
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	24,100	Based on Aurecon internal database.
Variable O&M Cost	\$ / MWh (Net)	7.6	Based on Aurecon internal database.
Total annual O&M Cost	\$	8,520,000	Annual average cost over the design life

## 4.7 Open Cycle Gas Turbine

### 4.7.1 Overview

Gas turbines are one of the most widely-used power generation technologies today. The technology is well proven and is used in both open-cycle gas turbine (OCGT) and combined-cycle gas turbine (CCGT) configurations. Gas turbines are classified into two main categories - aero-derivatives and industrial turbines. Both find application in the power generation industry, although for baseload applications, industrial gas turbines are preferred. Conversely, for peaking applications, the aero-derivative is more suitable primarily due to its faster start up time. Within the industrial turbines class, gas turbines are further classified as E - class, F - class and H (G/J) - class turbines.

This classification depends on their development generation and the associated advancement in size and efficiencies. Gas turbines can operate on both natural gas and liquid fuel.

Gas turbines utilise synchronous generators, which provide relatively high fault current contribution in comparison to other technologies and support the NEM network strength.

Gas turbines currently provide high rotating inertia to the NEM. The rotating inertia is a valuable feature that increases the NEM frequency stability.

#### 4.7.2 Typical options

An OCGT plant consists of a gas turbine connected to an electrical generator via a shaft. A gearbox may be required depending on the rpm of the gas turbine and the grid frequency. The number of gas turbines deployed in an OCGT plant will depend mainly on the output and redundancy levels required. OCGT plants are typically used to meet peak demand. Both industrial and aero-derivative gas turbines can be used for peaking applications. However, aero-derivatives have some advantages that make them more suitable for peaking applications, including:

- Better start-up time
- Operational flexibility i.e. quick ramp up and load change capability
- No penalties on O&M for number of starts

Irrespective of the benefits of aero-gas turbines, industrial gas turbines have also been widely used in OCGT mode. Traditionally, E or D class machines are used in OCGT mode. Rarely are F or H class machines used in OCGT applications. There are however instances where F class machines used in OCGT configuration in Australia (i.e. Mortlake Power Station (operational) and Tallawarra B Power Station (under construction)). Ultimately, the choice of gas turbine will depend on the many factors including the operating regimes of the plant, size, and more importantly, life cycle cost.

#### 4.7.3 Recent trends

The increased installation of renewables has created opportunities for capacity firming solutions, that are currently largely met by gas-fired power generation options. OCGT and reciprocating engines compete in this market.

With the exception of the recent 276 MW emergency power generation plant in South Australia, which included deployment of nine TM2500 aero-derivative gas turbines last year, the most recent OCGT installation on the NEM was Mortlake Power Station in 2011. This included two 283 MW F-Class gas turbines supplied by Siemens.

Recent gas turbine power projects proposed for deployment on the NEM are summarised below:

- 250 MW peaking/mid-merit OCGT in Newcastle. This project is currently under development. It is likely that if an OCGT solution, it would be multiple units of aero-derivative machines.
- 200 to 280 MW Mortlake Power Station Expansion (VIC). This project is currently in planning phase with multiple aero-derivative units being considered.
- 300 MW Reeves Plains OCGT plant (South Australia). This project is currently in planning phase also with multiple aero-derivative units being considered.
- 320 MW single unit F class OCGT plant in Tallawarra (NSW) under construction, with future possibility to convert the unit to combined-cycle mode.
- 660 MW peaking OCGT plant near Kurri Kurri (NSW) comprising two F class gas turbine units. This project is currently under development.

Overall, demand for gas turbines has been declining globally over the past few years, with a corresponding drop in prices.

Although global MW orders for gas turbines increased by over 20% in the last year, the market in terms of number of units sold decreased by almost the same amount due to larger utility plants being sold. Gas turbine prices (supply only, ex-Works) for larger utility-scale power generating units are expected to decline by as much as 10% in the 2020-2021 timeframe relative to those seen in 2019<sup>12</sup>.

#### 4.7.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical projects (one considering multiple smaller aero-derivative units and one considering a single large industrial unit) on natural gas fuel. The hypothetical projects have been selected based on what is envisaged as a plausible project for installation in the NEM in 2021, given the above discussion on typical options and current trends.

**Table 4-16: Configuration and performance**

Item	Unit	Small GTs	Large GT	Comment
<b>Configuration</b>				
Technology		Aero-derivative	Industrial (F-Class)	
Make model		LM 6000 PF SPRINT	GE 9F.03	Small GTs – Typical model used in Australia Large GT – Smallest F-Class unit available
Unit size (nominal)	MW	49	265	ISO / nameplate rating, GT Pro.
Number of units		5	1	
<b>Performance</b>				
Total plant size (Gross)	MW	257.2	244.3	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	1.7%	1.1%	Small GTs – Includes fuel compressor auxiliary power consumption Large GT – Assumes no fuel compression required
Total plant size (Net)	MW	252.9	241.7	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	235.3	226.4	35°C, 110 metres, 60%RH
Seasonal Rating – Not Summer (Net)	MW	267.2	258.2	15°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) LHV Net	11.458	14.735	25°C, 110 metres, 60%RH. Assuming a Minimum Stable Generation as stated below.
Heat rate at maximum operation	(GJ/MWh) LHV Net	9.049	9.766	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, LHV Net	39.79%	36.86%	25°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) HHV Net	12.684	16.312	Assuming LHV to HHV conversion ratio of 1.107.
Heat rate at maximum operation	(GJ/MWh) HHV Net	10.017	10.811	Assuming LHV to HHV conversion ratio of 1.107.
Thermal Efficiency at MCR	%, HHV Net	35.94%	33.30%	Assuming LHV to HHV conversion ratio of 1.107.
<b>Annual Performance</b>				
Average Planned Maintenance	Days / yr.	3	5	Assuming maintenance on all units completed concurrently

<sup>12</sup> Gas Turbine World 2020 GTW Handbook



Item	Unit	Small GTs	Large GT	Comment
Equivalent forced outage rate	%	2%	2%	
Effective annual capacity factor (year 0)	%	20%	20%	Average capacity factor for similar GTs on the NEM. This can start from approximately 5%
Annual generation	MWh / yr.	443,117	423,502	
Annual degradation over design life - output	%	0.24%	0.24%	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.16%	0.16%	Assuming straight line degradation.

Table 4-17: Technical parameters and project timeline

Item	Unit	Small GTs	Large GT	Comment
<b>Technical parameters</b>				
Ramp Up Rate	MW/min	Up to 250	22	Station ramp rate (all units simultaneously) under standard operation. Based on OEM data.
Ramp Down Rate	MW/min	Up to 250	22	Station ramp rate (all units simultaneously) under standard operation. Based on OEM data.
Start-up time	Min	5	30	Standard operation.
Min Stable Generation	% of installed capacity	50%	50%	Assuming Dry Low NO <sub>x</sub> burner technology.
<b>Project timeline</b>				
Time for development	Years	2	2	includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	2021	
EPC programme	Years	2	2	For NTP to COD.
■ Total Lead Time	Years	0.75	1	Time from NTP to gas turbine on site.
■ Construction time	Weeks	65	58	Time from gas turbine on site to COD.
Economic Life (Design Life)	Years	25	25	Can be capacity factor dependant
Technical Life (Operational Life)	Years	40	40	

#### 4.7.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-18: Cost estimates

Item	Unit	Small GTs	Large GT	Comment
<b>CAPEX – EPC cost</b>				
Relative cost	\$ / kW	1,250	750	Net basis
Total EPC cost	\$	316,151,000	181,294,000	
■ Equipment cost	\$	221,306,000	126,906,000	70% of EPC cost – typical.
■ Construction cost	\$	94,845,000	54,388,000	30% of EPC cost – typical.

Item	Unit	Small GTs	Large GT	Comment
<b>Other costs</b>				
Cost of land and development	\$	28,454,000	16,316,000	Assuming 9% of CAPEX.
Fuel connection costs	\$M	\$20M +\$1.5M/km	\$20M +\$1.5M/km	Gas Transport (i.e. pipes/lines)
Gas compressors	\$	\$2,500,000	Not required	
Gas storage <sup>13</sup>		Fixed: \$0.015 - \$0.025 /GJ/Day Variable (injection): \$0.014 - \$0.093 /GJ Variable (withdraw): \$0.041 - \$0.093 /GJ		Gas storage refers to underground storage facility in a depleted natural gas field. Costs based on published prizes for Iona underground gas facility.
First Year Assumed Commercially Viable for construction		2021	2021	
<b>OPEX – Annual</b>				
Fixed O&M Cost	\$ / MW (Net)	12,600	10,200	Based on Aurecon internal database.
Variable O&M Cost	\$ / MWh (Net)	12	7.3	Based on Aurecon internal database.
Total annual O&M Cost	\$	8,503,944	5,556,904	Annual average cost over the design life

## 4.8 Combined Cycle Gas Turbine

### 4.8.1 Overview

Over time, combined-cycle gas turbines (CCGT) have become the technology of choice for gas-fired base load and intermediate load power generation. Typically, they consist of 1 or more gas turbine generator sets (gas turbines plus the electric generator), dedicated heat recovery steam generators (HRSG), and a steam turbine generator set (steam turbine plus the electric generator).

Advancements in gas turbine technology have led to significant increase in CCGT efficiencies, with some gas CCGT plants, namely those with H-class gas turbines, offering efficiencies of above 60%.

### 4.8.2 Typical options

Both aero and industrial gas turbines are widely used for CCGT applications. However, traditionally industrial gas turbines are preferred. Popular CCGT configuration options include:

- 1-on-1 (1 x 1) option consisting of 1 gas turbine generator set, a dedicated HRSG, and a steam turbine generator set
- 2-on-1 (2 x 1) option consisting of 2 gas turbine generator sets, 2 dedicated HRSGs, and a steam turbine generator set

Other options have also been used e.g. 3 x 1 configuration, but they are not a typical offering.

### 4.8.3 Recent trends

The focus of all major gas turbine manufactures over the last couple of decades was to improve the thermal efficiency of the gas turbines. In recent years, OEMs have announced record high efficiencies in CCGT mode (over 60%).

<sup>13</sup> ACCC (2020), "Gas inquiry 2017–2025 Interim report", [www.ACCC.gov.au](http://www.ACCC.gov.au)

This quest for higher efficiencies, which is founded on the traditional operation of baseload power plants, is expected to continue. Although higher efficiencies are important, with the expansion of intermittent renewable energy in all major markets, the need for CCGT to be flexible and operate on a cyclic pattern is becoming equally important. As such, OEMs are now focusing on making improvements to CCGT plant start-up times and ability to ramp-up/down rapidly.

Globally, the gas turbine market has declined in the last couple of years and is expected to continue that downward trend<sup>14</sup>. In addition, there are indications that operators are seeing less value in centralised CCGT plants<sup>15</sup>.

In Australia, there has not been a CCGT plant constructed in the NEM region since the commissioning of Tallawarra in 2009. Recent CCGT projects constructed in Australia include:

- South Hedland Power Plant – 2 x 1 CCGT with LM 6000 PF SPRINT

Whilst there is not much current activity in the development of CCGT plants in Australia, the following CCGT plants under future development in Australia include:

- 660 MW CCGT plant at Port Kembla with intermediate duty using single H class gas turbine, planned to be operational in 2024
- Tallawarra B CCGT plant from conversion using single F class OCGT plant

The choice of gas turbine class would be influenced by the project size. The demand in the NEM may not require a CCGT plant based on advanced high-efficiency gas turbines i.e. F or H class gas turbines. Unless the market demand conditions are known, with very little recent CCGT activities in NEM, selecting the plant configuration or gas turbine class is difficult. However, if a CCGT is to be developed in Australia / the NEM, given the prevalent high gas price, high efficiency gas turbines (F or H class) would probably be the preferred gas turbine class, depending on the project size (MW), cost, etc. Based on this assessment, Aurecon has selected a CCGT with an F class gas turbine, as a H class gas turbine, depending on grid connection location, may be too large based on current NEM market requirements. F class gas turbines range from 265 – 450 MW in open-cycle, and from 400 – 685 MW in 1+1 combined-cycle configuration (at ISO conditions). H Class gas turbines however range from 445 – 595 MW in open-cycle, and from 660 – 840 MW in 1+1 combined-cycle configuration (at ISO conditions).

#### 4.8.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 and beyond, given the above discussion on typical options and current trends.

Table 4-19: Configuration and performance

Item	Unit	CCGT without CCS	CCGT with CCS (90% capture)	CCGT with CCS (50% capture)	Comment
<b>Configuration</b>					
Technology		CCGT	CCGT	CCGT	With mechanical draft cooling tower.
Carbon capture and storage		No	Yes	Yes	
Make model		GE 9F.03	GE 9F.03	GE 9F.03	Smallest model available selected.
Unit size (nominal)	MW	409			ISO / nameplate rating.

<sup>14</sup> <https://www.power-technology.com/comment/global-gas-turbines-market-decline-6-83bn-2022/>

<sup>15</sup> <https://www.ge.com/power/transform/article.transform.articles.2018.jan.evolution-of-combined-cycle-pe#>

Item	Unit	CCGT without CCS	CCGT with CCS (90% capture)	CCGT with CCS (50% capture)	Comment
Number of units		1 GT + 1 ST	1 GT + 1 ST	1 GT + 1 ST	HP pressure – 165 bar HP temperature – 582°C Reheat temperature – 567°C
<b>Performance</b>					
Total plant size (Gross)	MW	380	351.5	364.7	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	2.5%	9.2%	7.3%	
Total plant size (Net)	MW	371	319.3	338.1	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	348	301.5	318.8	35°C, 110 metres, 60%RH
Seasonal Rating – Not Summer (Net)	MW	389	334.5	354.0	15°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) LHV Net	7.472	8.290	7.764	25°C, 110 metres, 60%RH. Assuming a Minimum Stable Generation of 46% on gaseous fuel.
Heat rate at maximum operation	(GJ/MWh) LHV Net	6.385	7.415	7.004	
Thermal Efficiency at MCR	%, LHV Net	56.4%	53.4%	51.4%	
Heat rate at minimum operation	(GJ/MWh) HHV Net	8.271	9.177	8.595	Assuming LHV to HHV conversion of 1.107.
Heat rate at maximum operation	(GJ/MWh) HHV Net	7.068	8.208	7.753	Assuming LHV to HHV conversion of 1.107.
Thermal Efficiency at MCR	%, HHV Net	50.9%	43.9%	46.4%	Assuming LHV to HHV conversion of 1.107.
<b>Annual Performance</b>					
Average Planned Maintenance	Days / yr.	12.8	12.8	12.8	Based on 3.5% average planned outage rate over a full maintenance cycle.
Equivalent forced outage rate	%	3.5%	3.5%	3.5%	
Effective annual capacity factor	%	60%	60%	60%	
Annual generation	MWh / yr.	1,949,135	1,678,240	1,777,054	Provided for reference.
Annual degradation over design life - output	%	0.20%	0.20%	0.20%	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.12%	0.12%	0.12%	Assuming straight line degradation.

Table 4-20: Technical parameters and project timeline

Item	Unit	CCGT without CCS	CCGT with CCS	CCGT with CCS (50% capture)	Comment
<b>Technical parameters</b>					
Ramp Up Rate	MW/min	22	22	22	Standard operation.
Ramp Down Rate	MW/min	22	22	22	Standard operation.
Start-up time	Min	Cold: 145 Warm: 115 Hot: 30	Cold: 145 Warm: 115 Hot: 30	Cold: 145 Warm: 115 Hot: 30	Standard operation.
Min Stable Generation	% of installed capacity	46%	46%	46%	Differs between GT models. Equates to 35% GT load.
<b>Project timeline</b>					
Time for development	Years	2	3	3	includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	2021	2021	
EPC programme	Years	2.5	2.5	2.5	For NTP to COD.
■ Total Lead Time	Years	1	1	1	Time from NTP to gas turbine on site.
■ Construction time	Weeks	78	78	78	Time from gas turbine on site to COD.
Economic Life (Design Life)	Years	25	25	25	
Technical Life (Operational Life)	Years	40	40	40	

## 4.8.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-21: Cost estimates

Item	Unit	CCGT without CCS	CCGT with CCS (90% capture)	CCGT with CCS (50% capture)	Comment
<b>CAPEX – EPC cost</b>					
Relative cost	\$ / kW	1,500	3,855	2,833	Net basis
Total EPC cost	\$	556,500,000	1,230,900,000	957,840,000	
■ Equipment cost	\$	389,550,000	389,550,000	389,550,000	70% of EPC cost (without CCS)
■ Construction cost	\$	166,950,000	166,950,000	166,950,000	30% of EPC cost (without CCS)
■ Carbon Capture cost	\$	N/A	674,400,000	401,430,000	Equipment and installation
<b>Other costs</b>					
Cost of land and development		50,085,000	110,781,000	86,205,600	Assuming 9% of CAPEX.

Item	Unit	CCGT without CCS	CCGT with CCS (90% capture)	CCGT with CCS (50% capture)	Comment
Fuel connection costs (CAPEX)	\$M	\$20M +\$1.5M/km	\$20M +\$1.5M/km	\$20M +\$1.5M/km	
Gas compressors		Not required	Not required	Not required	
Gas storage <sup>16</sup>		Fixed: \$0.015 - \$0.025 /GJ/Day Variable (injection): \$0.014 - \$0.093 /GJ Variable (withdraw): \$0.041 - \$0.093 /GJ			Gas storage refers to underground storage facility in a depleted natural gas field. Costs based on published prizes for Iona underground gas facility.
CO <sub>2</sub> storage cost	\$/tCO <sub>2</sub>	N/A	\$12 - 25 /tCO <sub>2</sub>	\$12 - 25 /tCO <sub>2</sub>	Based on Rubin, E.S., et al (2015) <sup>17</sup> and adjusted to match report basis
CO <sub>2</sub> transport	\$/tCO <sub>2</sub> /km	N/A	\$0.1/tCO <sub>2</sub> /km	\$0.1/tCO <sub>2</sub> /km	Based on Rubin, E.S., et al (2015) <sup>17</sup> and adjusted to match report basis
<b>OPEX – Annual</b>					
Fixed O&M Cost	\$ / MW (Net)	10,900	16,350	14,480	Based on Aurecon internal database.
Variable O&M Cost	\$ / MWh (Net)	3.7	7.2	6.0	Based on Aurecon internal database.
Total annual O&M Cost	\$	11,255,700	17,303,880	15,558,012	Annual average cost over the design life

## 4.9 Advanced Ultra-Supercritical Pulverised Coal

### 4.9.1 Overview

Coal fired power plants are currently the dominant source of electricity generation in Australia, providing 68.4% of electricity generation for the NEM in 2019/20<sup>18</sup>. In the NEM there are approximately 48 coal fired units installed across 16 power stations in QLD, NSW and VIC. The unit sizes range from 280 MW to 750 MW and use a range of coal types from low grade brown coal through to export grade black coal.

Coal fired (thermal) power plants operate by burning coal in a large industrial boiler to generate high pressure, high temperature steam. High pressure steam from the boiler is passed through the steam turbine generator where the steam is expanded to produce electricity. This process is based on the thermodynamic Rankine cycle.

Coal fired power plants are typically classified as sub critical and super critical (more recently ultra-super critical and advanced ultra-supercritical) plants depending on the steam temperature and pressure. Over time advancements in the construction materials have permitted higher steam pressures and temperatures leading to increased plant efficiencies and overall unit sizes.

<sup>16</sup> ACCC (2020), "Gas inquiry 2017–2025 Interim report", [www.ACCC.gov.au](http://www.ACCC.gov.au)

<sup>17</sup> Rubin, E.S., et al., The cost of CO<sub>2</sub> capture and storage. Int. J. Greenhouse Gas Control (2015), <http://dx.doi.org/10.1016/j.ijggc.2015.05.018>

<sup>18</sup> <https://www.aemo.com.au/-/media/Files/Electricity/NEM/National-Electricity-Market-Fact-Sheet.pdf>

## 4.9.2 Typical options

The coal fired power stations installed on the NEM utilise either subcritical or supercritical pulverised coal (PC) technology which is an established, well proven technology used for power generation throughout the world for many decades.

The latest supercritical coal fired units installed in Australia can produce supercritical steam conditions in the order of 24 MPa and 566°C and typically used with unit sizes above 400 MW. Internationally, more recent coal fired units have been installed with ever increasing steam temperature and pressure conditions. Current OEMs are offering supercritical units in line with the following:

- Ultra-supercritical (USC), with main steam conditions in the order of 27 MPa and 600°C
- Advanced ultra-supercritical (AUSC), with main steam conditions in the order of 33 MPa and 660°C

Ultra-supercritical coal fired units are typically installed with capacities of 600MW - 1,000 MW each. An advanced ultra-supercritical power station with the above main steam conditions is yet to be constructed however are currently being offered by a number of OEMs.

## 4.9.3 Recent trends

The last coal fired power station to be installed in Australia was Kogan Creek Power Station in Queensland which was commissioned in 2007. Since then there has been limited focus on further coal fired development in Australia until necessitated by existing coal fired unit retirement. More recently, alternative technologies have become more prevalent with a focus on adopting non-coal technologies for replacing lost capacity due to coal fired plant closures.

Internationally, particularly in Asia, there has been extensive development of new large coal fired power stations to provide for the growing demand for electricity. These plants are now commonly being installed utilising ultra-supercritical steam conditions which offer improved plant efficiencies and reduced whole of life costs. However, Government policies in many countries in Asia have recently slowed the growth of coal fired fired stations. Investors are also not showing interest in coal fired power station developments.

In Australia the only coal fired development in progress is understood to be the Collinsville coal fired power station proposed by Shine Energy. This project is in the early feasibility stage. However, no update was publicly available regarding the progress of this feasibility study.

## 4.9.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021, given the above discussion on typical options and current trends.

Table 4-22: Configuration and performance

Item	Unit	AUSC without CCS	AUSC with CCS (90% capture efficiency)	AUSC with CCS (50% capture efficiency)	Comment
<b>Configuration</b>					
Technology		AUSC	AUSC	AUSC	With natural draft cooling tower.
Carbon capture and storage		No	Yes	Yes	90% capture efficiency assumed. SCR and FGD included with CCS option.
Make model		Western OEM	Western OEM	Western OEM	Western includes Japanese or Korean OEMs
Unit size (nominal)	MW	700	700	700	ISO / nameplate rating.
Number of units		1	1	1	

Item	Unit	AUSC without CCS	AUSC with CCS (90% capture efficiency)	AUSC with CCS (50% capture efficiency)	Comment
Steam Pressures (Main / Reheat)	MPa	33 / 6.1	33 / 6.1	33/6.1	
Steam Temperatures (Main / Reheat)	°C	650 / 670	650 / 670	650/670	
Condenser pressure	kPa abs	6	6	6	
<b>Performance</b>					
Total plant size (Gross)	MW	700	700	700	25°C, 110 metres, 60%RH Standard size offered by OEMs. Impact of unit size on NEM not assessed.
Auxiliary power consumption	%	4.1%	17.5%	12.5%	Assumes steam driven Boiler Feed Pump, natural draft cooling tower. Excludes intermittent station loads.
Total plant size (Net)	MW	671.3	577.3	612.3	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	658.6	566.7	599.9	35°C, 110 metres, 60%RH
Seasonal Rating – Not Summer (Net)	MW	673.8	581.7	616.3	15°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) HHV Net	10,172 (Down to 30%)	11,644 (Down to 65%)	10.108 (Down to 65%)	25°C, 110 metres, 60%RH.
Heat rate at maximum operation	(GJ/MWh) HHV Net	8,548	11,986	9,891	25°C, 110 metres, 60%RH.
Thermal Efficiency at MCR	%, HHV Net	42.12%	30.03%	36.39%	25°C, 110 metres, 60%RH.
<b>Annual Performance</b>					
Average Planned Maintenance	Days / yr.	10.5	10.5	10.5	Based on 14-day minor outage every 2 years and 28-day major outage every 4 years.
Equivalent forced outage rate	%	4%	4%	4%	Indicative
Effective annual capacity factor	%	93%	93%	93%	
Annual generation	MWh / yr.	5,468,946	4,703,147	4,988,285	Provided for reference.
Annual degradation over design life - output	%	0	0	0	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.2%	0.2%	0.2%	Assuming straight line degradation.



Table 4-23: Technical parameters and project timeline

Item	Unit	AUSC without CCS	AUSC with CCS (90% capture)	AUSC with CCS (50% capture)	Comment
<b>Technical parameters</b>					
Ramp Up Rate	MW/min	20	20	20	Based on 3%/min standard operation
Ramp Down Rate	MW/min	20	20	20	Based on 3%/min standard operation
Start-up time	Min	Cold: 444 Warm: 264 Hot: 60	Cold: 444 Warm: 264 Hot: 60		Standard operation.
Min Stable Generation	% of installed capacity	30%	30%	30%	Without oil support. Gross basis
<b>Project timeline</b>					
Time for development	Years	3	3	3	includes pre/feasibility, design, approvals etc. (assuming no delay in development approvals)
First Year Assumed Commercially Viable for construction	Year	2021	2021	2021	
EPC programme	Years	4	4	4	For NTP to COD.
Total Lead Time	Years	2	2	2	Time from NTP to steam turbine on site.
Construction time	Weeks	104	104	104	Time from steam turbine on site to COD.
Economic Life (Design Life)	Years	30	30	30	
Technical Life (Operational Life)	Years	50	50	50	

#### 4.9.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-24: Cost estimates

Item	Unit	AUSC without CCS	AUSC with CCS (90% capture)	AUSC with CCS (50% capture)	Comment
<b>CAPEX – EPC cost</b>					
Relative cost	\$ / kW	3,750	7,500	6,000	
Total EPC cost	\$	2,520,000,000	4,400,000,000	3,750,000,000	
5 Equipment cost	\$	1,008,000,000	1,008,000,000	1,008,000,000	40% of EPC cost (without CCS)
6 Construction cost	\$	1,512,000,000	1,512,000,000	1,512,000,000	60% of EPC cost (without CCS)

Item	Unit	AUSC without CCS	AUSC with CCS (90% capture)	AUSC with CCS (50% capture)	Comment
7 Carbon Capture cost	\$	N/A	1,880,000,000	1,230,000,000	Equipment and installation
<b>Other costs</b>					
Cost of land and development	\$	504,000,000	880,000,000	750,000,000	Assuming 20% of CAPEX.
Fuel connection costs	\$/km	2,000,000/km	2,000,000/km	2,000,000/km	Assuming single track rail line fuel supply arrangement in the order of 50 to 100km in length.
CO <sub>2</sub> storage cost	\$/tCO <sub>2</sub>	N/A	\$12 - 25 /tCO <sub>2</sub>	\$12 - 25 /tCO <sub>2</sub>	Based on Rubin, E.S., et al (2015) <sup>19</sup> and adjusted to match report basis
CO <sub>2</sub> transport	\$/tCO <sub>2</sub> /km	N/A	\$0.1/tCO <sub>2</sub> /km	\$0.1/tCO <sub>2</sub> /km	Based on Rubin, E.S., et al (2015) <sup>19</sup> and adjusted to match report basis
<b>OPEX – Annual</b>					
Fixed O&M Cost	\$ / MW (Net)	53,200	77,800	69,500 (Pro-rata basis from 0% and 90% capture)	AEMO costs and technical parameter review, 2018
Variable O&M Cost	\$ / MWh (Net)	4.21	7.95	6.68 (Pro-rata basis from 0% and 90% capture)	AEMO costs and technical parameter review, 2018
Total annual O&M Cost	\$	58,737,422	82,303,958	75,876,593	Annual average cost over the design life

## 4.10 Bioenergy

### 4.10.1 Biogas production

#### 4.10.1.1 Overview

Most biogas production in Australia is associated with municipal wastewater treatment plants (WWTP), process wastewater from red meat processing and rendering plants, waste manure from piggeries, manure slurry from dairies and poultry and landfill gas power units.

The following figure shows a typical Biogas energy process:

<sup>19</sup> Rubin, E.S., et al., The cost of CO<sub>2</sub> capture and storage. Int. J. Greenhouse Gas Control (2015), <http://dx.doi.org/10.1016/j.ijggc.2015.05.018>

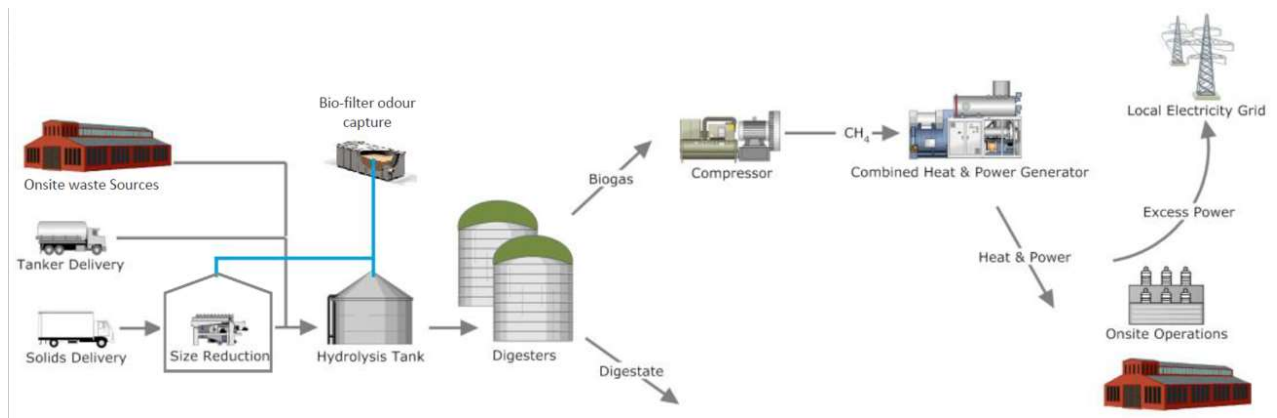


Figure 1: Typical Biogas energy process (Source Biogas Renewables)

#### 4.10.1.2 Typical biogas system options

Many heritage agricultural industries have established value chains, logistics and processing systems that provide a solid platform to develop bio products. Biogas through anaerobic digestion (AD) provides another platform to extract more value out of internal coproduct and waste streams and external feedstocks from the region. The biogas systems in Australia have generally been installed to match the size of the feedstock and range from 0.25 MW to 2 MW of generation capacity. Some recent projects like at the Kilcoy Pastoral Company have installed a total of 4 MW of combined heat and power (CHP) generating units, via 2 x 1.5 MW CHP and 1 x 1.5 MW CHP engines. With a turndown ratio nominally at 50%, Owners will often elect to install multiple smaller units if the biogas production is intermittent and there is insufficient storage to run the biogas power station constantly over a 24-hour period, or across the year.

#### 4.10.1.3 Feedstocks

Typically, transport logistics and associated costs will make or break the business case of utilising external feedstocks. The ability to purchase the feedstock at the 'right' price and have efficient logistics and materials handling is crucial to creating a viable business case for the AD unit. Harvesting, loading and storage methods of feedstocks are critical for achieving efficient logistics and lowering AD unit input costs. The ability to minimise double handling of feedstock streams is critical to contain logistics costs to reasonable levels. Where the feedstock is already collected as a liquid, or as a solid onto a conveyor, storage bin or storage pad, the ability to 'just-in-time' collect and deliver the feedstock will save the producer storage, waste management and disposal costs.

Various feedstock pre-treatment methods are utilised to maximise biogas yields in AD processes. Pre-treatment increases the yield of biogas from feedstocks in anaerobic digestion. Substrates composed of high-density fibre, or not readily biodegradable matter, usually require pre-treatment. Technique used for pre-treatment depends on the type of substrate and utilises a wide degree of methods including thermal, chemical, physical/mechanical, ultrasound, microwave, biological and metal addition methods.

Biogas can be produced from a wide range of feedstocks. AD efficiency relates to biogas yield, which vary across feedstock types and regions. The energy value in the feed will also relate to its input cost.

#### 4.10.1.4 Recent trends

Whilst a large body of information exists for the installation of biogas plants across various Australian industries, there is always a need to ground truth proposed value chains by utilising where possible existing 'tried and proven' technologies from established suppliers in the biogas industry.

The scale of the biogas plant is typically limited by the amount and type of feedstock available and the ability to establish continuous logistics supply of feedstock to match continuous production and steady utilisation of biogas to match the local system demand. As a result of feedstock constraints, the majority of biogas generation projects have power station capacities less than 2 MW. Feedstock assessments are required to mitigate risks in maintaining a continuous supply across the year for seasonal feedstocks and waste streams, according to supply contractual arrangements. Any assumptions on future feedstocks availability will need to include market negotiations of offtake agreements, quality specifications and logistics contracts.

Bio precinct concepts have been discussed in recent times across all states. These aim to shore up the electricity generation by considering a combination of solar/battery/ biogas hybrid generation, rather than just supplying organic feedstocks to a large AD plant and generating power from biogas. These hybrid options also enable the sale of electricity, heat and steam to behind the meter customers in the precinct. Hybrid energy generation options can also optimise collocated biorefineries to operate for 24 hour per day operations.

#### **4.10.1.5 Waste to energy plants**

With the global change in the acceptance of exported wastes, there has been considerable interest to establish waste to energy plants in Australia. In particular the conversion of excess foods, organic wastes and residues into biogas for use in electricity and heat generation have been seen as an important part of establishing beneficial use of waste streams in the circular economy.

#### **4.10.1.7 Selected hypothetical project**

The hypothetical power station capacity has been selected at 2 MW, with nominal 2 x 1,200 kW CHP co-generators.

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 given the above discussion on typical options and current trends.

The assumed biogas project involves an assumed scope of work including:

- Generation type - Anaerobic digestion of organic feedstocks
- Fuel types - Agricultural residues, energy crops, food waste, manures, sewage, MSW
- Capacity of 900 Nm<sup>3</sup>/h biogas
- Annual amount of biogas produced - 7,560,000 Nm<sup>3</sup>/a @ 55% methane and 8400 hours
- Onsite generation equipment – 2 MW net generation using 2 x 1,200 kW CHP co-generators, with exhaust gas heat exchangers, jacket water cooler, oil cooler, hot water heat exchanger, gas treatment, oil tanks and stack
- Logistics receivals area, roads, site office and amenities
- Feedstock storage capacity for 2 days
- Sorting, pre-treatment, feeding systems and pasteurization of feedstock
- Anaerobic digestion tank infrastructure for hydrolysis, digestion, outlet and liquid storage tanks
- Ancillary equipment including pumps, heat exchangers, air dosing, tank mixing and access equipment and balance of plant
- Separation, post processing and digestate equipment
- Gas management and flare infrastructure and equipment
- Pipework, valves, instrumentation and process control equipment
- Site wide electrical and power distribution infrastructure
- Commissioning, testing, critical spares and operational readiness

Table 4-25: Biogas hypothetical plant configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology		Anaerobic digestion with CHP generators	Complete system involves feedstock logistics, pre-treatment of feedstock, digestors, gas management, CHP units, heat recovery, electrical generation equipment and balance of plant
Fuel source		Organic feedstocks	Agricultural residues, energy crops, food waste, manures, sewage, MSW
Make model		Australian biogas consultants, CHP OEM's	Integrated custom systems from Australian biogas system suppliers and OEM's
Unit size (nominal)	MW	2 MW Electrical 2 MW Thermal	Assumed generation using 2 x 1,200 kW CHP co-generators
Number of units		1 biogas system 2 CHP Units	Assume 2 x generator units for reliability
Gas Methane Number	MZ d	135	Biogas from AD plant (Minimum 117)
Gas Fuel LHV	kWh/Nm <sup>3</sup>	4.5	
<b>Performance</b>			
Total plant size (Gross)	MW	2.2 Electrical 2.3 MW Thermal	Anaerobic digestion plant supplying biogas to 2 x 1.2 MW CHP co-generators
Biogas Production	Nm <sup>3</sup> /a	7,560,000	@ 55% Methane and 8400 hours
Methane Production	Nm <sup>3</sup> /a	4,158,000	@ 8400 hours
Electricity Generation	kWh /a	16,700,000	@ 8400 hours
Heat Generation	kWh /a	17,100,000	@ 8400 hours
Digestate	m <sup>3</sup> /a	92,500	Assume 5%
CHP Electrical Efficiency	%	42	
Site Parasitic Electrical Load	%	8	
Site Parasitic Heat (Water) Load	%	25	
Average Planned Maintenance	Days / yr.	15	

Table 4-26: Project timeline

Item	Unit	Value	Comment
<b>Project timeline</b>			
Time for development	Years	2	includes pre/feasibility, design, approvals, procurement, etc.
First Year Assumed Commercially Viable for construction	Year	2021	
EPC programme	Years	2	For NTP to COD.
■ Total Lead Time	Years	1	Time from NTP to long lead items on site.
■ Construction time	Weeks	52	Time from site establishment to COD.
Economic Life (Design Life)	Years	20 - 25	Assuming corrosion resistant materials utilised

Item	Unit	Value	Comment
Technical Life (Operational Life)	Years	30	Assuming overhauls of CHP units at OEM intervals

#### 4.10.1.8 Cost estimate

Costs used in this 2021 Biogas assessment have been aggregated from OEM quotes and a nominal selection of associated infrastructure.

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-27: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / kW	\$12,000	Net basis
Total Capital cost	\$	\$24,000,000	
■ Equipment cost	\$	\$9,600,000	40% of EPC cost – typical.
■ Installation cost	\$	\$14,400,000	60% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	\$2,400,000	Assuming 10% of CAPEX.
Feedstock supply costs	\$M	N/A	Typically, given the scale of the plant, the feedstock would be delivered by road. As such the fuel transport costs become an ongoing OPEX cost.
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	\$380,000	Aggregated for scope listed above
Variable O&M Cost	\$ / MWh (Net)	65	Assuming AD plant and CHP systems
Total annual O&M Cost	\$	\$1,850,000	

### 4.10.2 Biomass generators using wood waste

#### 4.10.2.1 Overview

The use of biomass for electricity generation can take many different forms and cover a variety of technologies, some well proven and others still in the pilot phase. Broadly speaking biomass is considered to cover any organic matter or biological material that can be considered available on a renewable basis. This includes materials derived from animals and/or plants as well as waste streams from municipal or industrial sources.

#### 4.10.2.2 Typical options

Producing electricity from biomass can be completed via the following process:

- Incineration: This involves the combustion of solid biomass in a steam generation boiler, typically grate or circulating fluidised bed (CFB) type. The steam is then used in a traditional steam turbine to generate electricity. The solid biomass can typically be; forestry products (i.e. wood chips, sawdust, etc), harvest residues (i.e. sugar cane, bagasse, etc), municipal solid waste, or refuse-derived fuel (RDF).
- Anaerobic digestion: This is a biological process where biomass is feed into a reactor where microorganisms assist in the decomposition process. The off gas that is produced, called biogas, is a mixture of methane and carbon dioxide which can be combusted, with some clean up, in either a reciprocating engine or gas turbine to produce electricity.

- Gasification: This is a thermochemical process that transforms any carbon-based biomass into a gas by creating a chemical reaction without burning the material. This reaction combines those carbon-based materials with small amounts of air or oxygen to produce primarily a mixture of carbon monoxide and hydrogen. Additional treatment is required to remove any pollutants and or impurities. The gas produced is called “synthesis gas” or “syn gas”. This gas is the consumed in either a reciprocating engine or gas turbine to produce electricity
- Biofuels: This is the process of refining liquid fuels from renewable biomass such as ethanol and biodiesel. Although possible to use in power generation, liquid biofuels are most commonly used in the transport industry.

#### 4.10.2.3 Recent trends

Internationally there has been a recent uptake of electricity generation using wood pellet produced from sustainably managed working forests. Examples of such plants include conversion of four 660MW coal fired units of Drax Power Station in the UK, Atikokan Unit (205MW), Canada and Thunder Bay Generating Station in Ontario, Canada (163MW). Japan is currently undergoing a biomass-to-energy boom since the introduction of a feed-in-tariff (FIT) policy in 2012. In Australia the most common form of power generation from biomass is incineration / combustion in subcritical steam boilers. The biomass used as the primary feedstock is typically a bi product from the forestry industry such as wood waste from sawmills or harvest residues such as bagasse from the sugar cane industry. More recently municipal solid waste and RDF feedstocks are also being considered with two plants now operational in WA and a number considered in the NEM.

Currently the feedstocks used in power generation are bi products from other industries. This generally has the advantage of a low-cost fuel source however the quantities available are limited by the primary harvesting or manufacturing process. Harvesting a feedstock for the sole purpose of power generation has not yet been implemented for a project on the NEM.

The input cost structures are significantly different for other feedstocks, particularly in the harvesting, collection, storage and logistics. Woodchip is used to provide a comparable energy cost for this exercise, since it can be defined as a tradeable commodity that can be used and priced locally, or for export. Other lower cost feedstocks are difficult to price and quantify energy content unless quality is consistent and supply is from consistently available locations across the seasonality spread.

Biomass power plants using incineration or combustion technologies are typically deployed with unit sizes in the range of 20 to 40 MW. Higher plant sizes are typical not viable due to the limitations in available feedstock within a practical transport distance from the plant.

#### 4.10.2.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 given the above discussion on typical options and current trends.

Table 4-28: Configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology		Sub-critical boiler	With mechanical draft cooling tower.
Fuel source		Woodchips	
Make model		Western OEM	
Unit size (nominal)	MW	30	
Number of units		1	
Steam Pressure	MPa	7	
Steam Temperature	°C	470	
Condenser pressure	kPa abs	7.5	

Item	Unit	Value	Comment
<b>Performance</b>			
Total plant size (Gross)	MW	30	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	8.3%	
Total plant size (Net)	MW	27.5	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	26.8	35°C, 110 metres, 60%RH
Seasonal Rating – Not Summer (Net)	MW	28.0	15°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) HHV Net	15.933	25°C, 110 metres, 60%RH
Heat rate at maximum operation	(GJ/MWh) HHV Net	12.596	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, HHV Net	28.58%	25°C, 110 metres, 60%RH
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	22.8	
Equivalent forced outage rate	%	4%	
Annual capacity factor	%	89.8%	
Annual generation	MWh / yr.	216,208	Provided for reference based on assumed capacity factor.
Annual degradation over design life - output	%	0	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.2%	Assuming straight line degradation.

**Table 4-29: Technical parameters and project timeline**

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp Up Rate	MW/min	1.2	Based on 3%/min standard operation
Ramp Down Rate	MW/min	1.2	Based on 3%/min standard operation
Start-up time	Min	Cold: 420 Warm: 120 Hot: 60	Standard operation.
Min Stable Generation	% of installed capacity	40%	Without oil support
<b>Project timeline</b>			
Time for development	Years	3	includes pre/feasibility, design, approvals, procurement, etc.
First Year Assumed Commercially Viable for construction	Year	2021	
EPC programme	Years	3	For NTP to COD.
8 Total Lead Time	Years	1.75	Time from NTP to steam turbine on site.
9 Construction time	Weeks	65	Time from steam turbine on site to COD.
Economic Life (Design Life)	Years	30	



Item	Unit	Value	Comment
Technical Life (Operational Life)	Years	50	

#### 4.10.2.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-30: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / kW	5,900	Net basis
Total EPC cost	\$	162,250,000	
10 Equipment cost	\$	64,900,000	40% of EPC cost – typical.
11 Installation cost	\$	97,350,000	60% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	32,450,000	Assuming 20% of CAPEX.
Fuel connection costs	\$M	N/A	Typically, given the scale of the plant, the feedstock would be delivered by road. As such the fuel transport costs become an ongoing OPEX cost.
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	131,600	AEMO costs and technical parameter review, 2018
Variable O&M Cost	\$ / MWh (Net)	8.42	AEMO costs and technical parameter review, 2018
Total annual O&M Cost	\$	5,439,469	

### 4.10.3 Biodiesel production

#### 4.10.3.1 Overview

Biodiesel can be manufactured from a number of different feedstocks and processes.

Typical feedstocks for biodiesel are:

- vegetable oils including oilseed such as soybean, canola, cotton, carinata, palm and sunflower.
- oil trees
- algae oils
- tallow from meat works
- used cooking oil (UCO)

Biodiesel can be added to mineral diesel in any number of different blend concentrations. Some examples are B100 -100% biodiesel; B85 -85% biodiesel, B20 -20% biodiesel and B5 -5% biodiesel.

Worldwide it is generally accepted that blends of B20, or less, can be used in normal diesel engines without any adverse effects. However, some engine manufacturers do not extend warranties for engines running biodiesel blends, although a B20 blend provides a fuel quality benefit with improved lubricity and fuel cetane rating improvement.

In Australia, B5 or lower can be used in any engine, but only a small number of engine manufacturers warrant the use of blends with higher biodiesel content. Some individual fleets have had up to B100 in regular use; although these generally have specialist engine maintenance and the fleet operator assumes legal responsibility for the use of these fuels.

### 4.10.3.2 Processing technologies

There are many potential feedstocks and processing technologies for biofuels and biodiesel production. For the hypothetical project, the biodiesel feedstock goes through a process of transesterification; the fatty acid-rich feedstock is reacted with alcohol to form ethyl esters of fatty acids (biodiesel) and glycerol (glycerine). Energy or catalysts are used to drive the reaction and to increase the amount of output.

The following processes can be used to drive the reaction:

- Common batch process uses a catalyst and heat
- Supercritical processes not requiring a catalyst; instead high temperature and pressure is used
- Ultrasonic methods use ultrasonic sound waves to cause the mixture of reactants to produce bubbles which collapse, producing both a heating and mixing effect; this negates the need for catalysts
- Microwave methods involve microwaves that are used to heat and mix the reactants, negating the need for catalysts
- Lipase catalysed methods use Lipase enzymes as a catalyst to the reaction process.
- Hydrothermal liquification (HTL)
- Thermal
- Gasification

### 4.10.3.3 Recent developments and emerging technologies

There have been many recent developments and emerging technologies developed for Biodiesel production. The major challenge facing the biodiesel industry is securing the supply of suitable feedstocks for the production of biodiesel, with the diversion of agricultural production from food or feed to fuel. Therefore, there is continual research into the use of alternative or lower grade feedstocks including marine algae, coffee grounds, pongamia, oiltrees and high oil tobacco.

Research into biodiesel production feedstocks from non-food sources is focussed on inedible oils or waste products which have higher free fatty acid levels (FFA). Generally, biodiesel quality feedstock should be below 2% FFA. If biodiesel production methods were developed so that higher FFA levels were acceptable, there would be potential for more meat or agricultural waste products that have higher FFA to be used in biodiesel production. Current biodiesel research is also focused on developing the most efficient methods of obtaining fatty acids from the anaerobic digestion of organic waste streams, such as domestic and animal waste.

There are also recent innovations into small packaged biodiesel production units, whereby this seemingly complex process is simplified to containerised designs for point of source generation on farm. For example, there are biodiesel production units contained in a shipping container that can produce biodiesel from appropriate feedstock in the location where the feedstocks are produced. This system does not require an external source of energy; it uses the biodiesel it produces to generate its own power. Such a system could be used at a meat processing facility to produce biodiesel on site.

There is potential for 'drop-in' biofuels using emerging second generation processes as alternatives to the traditional FAME biodiesels that have been around for many years. However, real projects are very limited and the cost effectiveness of the second generation methods still have a significant gap in most countries compared to FAME.

#### 4.10.3.4 Biodiesel product quality parameters

Biodiesel must comply to rigid standards to ensure that the use of the fuel will satisfy vehicle warranty conditions. Biodiesel fuel is often produced in batches, with quality control parameters recorded against laboratory analysis for traceable fuel deliveries to the customer.

#### 4.10.3.6 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2021 given the above discussion on typical options and current trends.

The hypothetical project is assumed to utilise the proven process of transesterification, methyl ester purification and glycerol recovery and purification.

The assumed biodiesel project involves an assumed scope of work including:

- Generation type - Renewable Biofuel Production
- Fuel types - Vegetable Oils from soybean, sunflower or safflower, Used Cooking Oil (UCO), Tallow, etc
- Capacity of 50 ML of biofuel
- Annual amount of biodiesel produced - 50 ML of biofuel and 7200 hours
- Assume biodiesel will be sold into local fuel markets
- Site works and land
- Plant includes oilseed processing plant for a nominal 100,000 tonnes oil seeds
- Biodiesel Processing and Refining Facility
- Feedstock, water, process chemicals and biodiesel storage systems
- Utilities, fuel connections and balance of plant
- Oil seed meal handling and processing

Table 4-31: Biodiesel hypothetical plant configuration and performance

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology		FAME biodiesel process	Complete system involves oilseed processing of vegetable oils, pre-treatment, trans-esterification, biodiesel washing, biodiesel distillation, methanol recovery, oil seed meal processing, storage and handling
Feedstock source		Vegetable oils	Vegetable Oils from soybean, sunflower or safflower, Used Cooking Oil (UCO), Tallow, etc
Make model		Biodiesel OEM's	Integrated custom systems from biodiesel system suppliers and OEM's
Unit size (nominal)	ML	50 ML Biodiesel	Biodiesel processing facility
Number of units		1	Assume single facility
<b>Performance</b>			
Total plant size (Gross)	ML	50	Includes entire facility to make compliant biofuels
Biodiesel Production	ML	50	@ 7200 hours
Oil Seed Processing capacity	Tonnes	100,000	@ 7200 hours

Item	Unit	Value	Comment
Average Planned Maintenance/ Seasonal delays	Days / yr.	65	

Table 4-32: Project timeline

Item	Unit	Value	Comment
<b>Project timeline</b>			
Time for development	Years	2	includes pre/feasibility, design, approvals, procurement, etc.
First Year Assumed Commercially Viable for construction	Year	2021	
EPC programme	Years	2	For NTP to COD.
■ Total Lead Time	Years	1	Time from NTP to long lead items on site.
■ Construction time	Weeks	52	Time from site establishment to COD.
Economic Life (Design Life)	Years	20 - 25	Assuming corrosion resistant materials utilised
Technical Life (Operational Life)	Years	30	Assuming overhauls of CHP units at OEM intervals

#### 4.10.3.7 Cost estimate

Capital costs for biodiesel systems need to be presented with the entire value chain for the feedstocks used when preparing business cases. Where a facility can purchase a liquid feed like used cooking oil (UCO), tallow or vegetable oils, costs are transferred to OPEX and the overall capital cost is reduced to the main biofuel equipment. In regional installations incorporating the agriculture systems for oil seed processing, there is additional capital required for site infrastructure, logistics systems, storage and feedstock sorting and separation. As such the capital costs to install biodiesel production systems will be significantly greater than facilities where the feedstocks can be purchased from a local oils and fats market.

Costs used in this 2021 assessment assume a biodiesel production facility including an oilseed crush facility in the front end to produce vegetable oils. The costs have been aggregated from OEM quotes and a nominal selection of associated infrastructure.

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 4-33: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Total Capital cost	\$	\$48,000,000	
■ Equipment cost	\$	\$19,200,000	40% of EPC cost – typical.
■ Installation cost	\$	\$28,800,000	60% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	\$4,800,000	Assuming 10% of CAPEX.
Feedstock supply costs	\$M	N/A	Typically, given the scale of the plant, the feedstock would be delivered by road. As such the fuel transport costs become an ongoing OPEX cost.

Item	Unit	Value	Comment
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / ML	\$260,000	Aggregated for scope listed above
Variable O&M Cost	\$ / ML	\$600,000	Assuming average feedstock prices
Total annual O&M Cost	\$	\$43,000,000	

# 5 Hydrogen Based Technologies and Storage

## 5.1 Overview

The following sections provide the technical and cost parameters for each of the nominated hydrogen-based technologies and storage, along with a brief discussion of typical options and recent trends. The information in the respective tables has been used to populate the AEMO GenCost 2021 Excel spreadsheets, which are included in Appendix A.

## 5.2 Reciprocating engines

### 5.2.1 Overview and typical options

An overview of reciprocating engines and configuration, speed classifications, and fuel types covering gaseous (typically natural gas), liquid fuel, and dual fuel is discussed in Section 4.6.2 and Section 4.6.3.

With respect to hydrogen fuel, OEMs advise that current reciprocating engines can typically operate with a hydrogen blend of between 5-25% with natural gas. Depending on the hydrogen blend percentage and the OEM, engine modifications to the engine intake manifold, and fuel rail and port injection into cylinder head may be required. One OEM is now offering a 100% hydrogen reciprocating engine product.

### 5.2.2 Recent trends

There are projects in Australia either greenfield or brownfield that are investigating using a hydrogen blended fuel with natural gas for power generation based on current activity in the renewable hydrogen industry. These projects include:

- a renewable energy precinct producing renewable hydrogen from curtailed renewable energy for peaking power generation from a new nominal 12 MW reciprocating engine using a 25% hydrogen blend with natural gas (NEM connected)
- a renewable energy hybrid power system with renewable hydrogen produced from curtailed renewable energy for power generation from existing nominal 4 MW reciprocating engine(s) using a 10% hydrogen blend with natural gas (not NEM connected)

Testing programs by OEMs for higher hydrogen blend percentages with natural gas continues up to 60% and beyond for their reciprocating engine product line. One OEM has undertaken engine testing with 100% hydrogen based on its recent testing program with its one engine type product released in July 2021 to operate on 100% hydrogen, with its other engine types due to be 100% hydrogen ready for release in 2022<sup>20</sup>.

100% hydrogen reciprocating engines are expected to require a hydrogen gas train (instead of natural gas), intake manifold, fuel rail and port injection modifications.

### 5.2.3 Selected hypothetical project

Hydrogen supply will be either via gas network as a blend or could be via dedicated renewable hydrogen supply from an electrolyser plant. Given the current status of hydrogen blending in gas networks planned in Australia based on current projects under development of up to 10% and State government aspirations for 10% hydrogen blending in gas networks by 2030 this is likely to lead to reciprocating engine plants using a blend of hydrogen with natural gas.

<sup>20</sup> <https://www.innio.com/en/news-media/news/press-release/innio-jenbacher-gas-engines-ready-for-hydrogen>

Alternatively, a 100% hydrogen reciprocating engine plant could be supplied from a dedicated 10 MW electrolyser plant using renewable energy supply. This is the basis of the hypothetical project selected with engine size and plant capacity based on a 10 MW electrolyser plant for hydrogen production.

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged maybe a plausible project for development in the NEM in 2021 given the above discussion on typical options and current trends.

**Table 5-1: Configuration and performance**

Item	Unit	Value	Comment
<b>Configuration</b>			
Technology / OEM		INNIO Jenbacher	100% Hydrogen
Make model		JMS 420	
Unit size (nominal)	MW	2.25	Nameplate rating at generator terminals.
Number of units		3	
<b>Performance</b>			
Total plant size (Gross)	MW	6.75	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	4%	
Total plant size (Net)	MW	6.48	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	6.48	Derating does not typically occur until temperatures over 35 – 40°C.
Seasonal Rating – Not Summer (Net)	MW	6.48	
Heat rate at maximum operation	(GJ/MWh) LHV Net	9.494	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, LHV Net	37.9%	25°C, 110 metres, 60%RH
Heat rate at maximum operation	(GJ/MWh) HHV Net	11.235	25°C, 110 metres, 60%RH
Thermal Efficiency at MCR	%, HHV Net	32.0	25°C, 110 metres, 60%RH
Hydrogen consumption at maximum operation	kg/h HHV	534	3 engines at MCR
<b>Annual Performance</b>			
Average Planned Maintenance	Days / yr.	2.7	Based on each engine only running 1752 hours per year.
Equivalent forced outage rate	%	2%	
Annual capacity factor	%	20%	Typical for current planned firming generation dispatch. Hydrogen storage required
Annual generation	MWh / yr.	11,353	Provided for reference based on assumed capacity factor.
Annual degradation over design life - output	%	0%	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.05%	Assuming straight line degradation.

**Table 5-2: Technical parameters and project timeline**

Item	Unit	Value	Comment
<b>Technical parameters</b>			
Ramp Up Rate	MW/min	2	Station ramp rate (all units) under standard operation. Based on OEM data.

Item	Unit	Value	Comment
Ramp Down Rate	MW/min	12.48	Station ramp rate (all units) under standard operation. Based on OEM data.
Start-up time	Min	6-10	Standard operation. Based on OEM data. Depending on whether hot or cold conditions
Min Stable Generation	% of installed capacity	40%	Assumed same as natural gas.
<b>Project timeline</b>			
Time for development	Years	2	includes pre/feasibility, design, approvals, procurement, etc.
First Year Assumed Commercially Viable for construction	Year	2021	
EPC programme	Years	2	For NTP to COD.
■ Total Lead Time	Years	1	12 months typical to engines on site.
■ Construction time	Weeks	52	12 months assumed from engines to site to COD.
Economic Life (Design Life)	Years	25	Can be capacity factor dependant
Technical Life (Operational Life)	Years	40	

## 5.2.4 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 5-3: Cost estimates

Item	Unit	Value	Comment
<b>CAPEX – EPC cost</b>			
Relative cost	\$ / kW	1,825	Net basis. 60% capex premium on engine only component for 100% hydrogen compared to natural gas only engine
Total EPC cost	\$	11,826,000	
■ Equipment cost	\$	7,095,600	60% of EPC cost – typical.
■ Installation cost	\$	4,730,400	40% of EPC cost – typical.
<b>Other costs</b>			
Cost of land and development	\$	1,064,340	Assuming 9% of CAPEX.
Fuel connection costs	\$M	Excluded	Assumes hydrogen storage provided separately
<b>OPEX – Annual</b>			
Fixed O&M Cost	\$ / MW (Net)	33,000	Based on Aurecon internal database.
Variable O&M Cost	\$ / MWh (Net)	-	Included above.
Total annual O&M Cost	\$	213,840	Annual average cost over the design life



## 5.3 Gas turbines, including hydrogen conversion of gas turbines

### 5.3.1 Overview and typical options

An overview of configuration, technologies, and sizes for open cycle gas turbines is discussed in Section 4.7.1 and Section 4.7.3 considering natural gas and liquid fuel operation.

Gas turbine OEMs are also looking at improving the hydrogen fuel capabilities of its offered models. Most gas turbines have the ability to operate with a percentage of hydrogen in the fuel mix.

Some are quite low (i.e. 5 - 15%) whilst others can accept very high percentages of hydrogen in the fuel (95%+). Currently very few gas turbines can operate on 100% hydrogen (mainly limited to small industrial gas turbines). This is expected to change dramatically over the next few years.

The challenges with using hydrogen compared to say natural gas as a fuel for gas turbines include its lower heating value by volume requiring more fuel for same energy input, combustion dynamics due to its high flame speed and temperature, and safety aspects such as flame visibility, small molecular size leading to increased risk of leaks, and wider flammability limit in air.

Gas turbine combustion systems either use a wet combustion system requiring a diluent such as water, or a dry system (Dry Low NOx or DLN/DLE) without the need for diluent to manage NOx gaseous emissions. The benefit of a DLN combustion system is that this avoids the need for water injection and provides for lower NOx emissions.

Single annular combustor (standard diffusion type), or single nozzle or multi nozzle combustors depending on whether aero-derivative or frame gas turbines such as those offered by GE are quoted as being able to handle up to 85% by volume and 90-100% by volume of hydrogen respectively.

Dry Low NOx combustion systems (pre-mix type) such as those offered by GE are capable of operation up to 33% hydrogen by volume with natural gas (DLN1) for B and E class gas turbines, and 15% hydrogen by volume (DLN2.6+) with natural gas for larger F class gas turbines. Further developments with the DLN2.6e type combustion system and preliminary testing have indicated capability to operate up to 50% hydrogen by volume.

Depending on the percentage of hydrogen to be used the changes to the gas turbine for operation on hydrogen could be limited to a turbine controls update and new combustor fuel nozzles (if beyond current hydrogen capability installed), through to a new combustion system including new fuel accessory piping and valves, new fuel skid, and improved safety features such as enclosure and ventilation system modifications, and flame detection and gas detection. Changes to gas turbine controls may impact gas turbine performance including both output and heat rate. Increasing the concentration of hydrogen may lead to significant increases in NOx emissions<sup>21</sup>.

Siemens Roadmap to 100% hydrogen turbines set out its ambition for hydrogen capability in its gas turbine models to at least 20% by 2020 and 100% by 2030, with its smaller aeroderivative gas turbine units stated as capable of operation on 100% hydrogen with its wet combustion system (WLE)<sup>22</sup>

Kawasaki Heavy Industry (KHI) has recently undertaken successful combustor testing on its small gas turbine using 100% hydrogen with its standard diffusion flame combustor in Japan. Prototype testing of a hydrogen fuelled micro-mix DLN test burner producing low NOx emissions results has also been achieved<sup>23</sup>.

### 5.3.2 Recent trends

The Tallawarra B OCGT project under construction includes a large 9F gas turbine and has a commitment to the NSW government to generate power using a 5% hydrogen blend with natural gas.

<sup>21</sup> [https://www.ge.com/content/dam/gepower/global/en\\_US/documents/fuel-flexibility/GEA33861%20Power%20to%20Gas%20-%20Hydrogen%20for%20Power%20Generation.pdf](https://www.ge.com/content/dam/gepower/global/en_US/documents/fuel-flexibility/GEA33861%20Power%20to%20Gas%20-%20Hydrogen%20for%20Power%20Generation.pdf)

<sup>22</sup> <https://www.powermag.com/siemens-roadmap-to-100-hydrogen-gas-turbines/>

<sup>23</sup> [https://www.kawasaki-gasturbine.de/files/Hydrogen\\_as\\_fuel\\_for\\_GT.pdf](https://www.kawasaki-gasturbine.de/files/Hydrogen_as_fuel_for_GT.pdf)

There are other projects in Australia that are investigation using a hydrogen blended fuel with natural gas for power generation based on current renewable hydrogen industry developments. These projects include:

- Renewable hydrogen produced for power generation in an existing 35 MW industrial gas turbine using a 5% hydrogen blend in natural gas (not NEM connected)
- H2U Eyre Peninsular Gateway Project, South Australia – 75 MW electrolyser with renewable hydrogen used for ammonia production among other uses including two small 100% hydrogen turbines<sup>24</sup> for peaking power

### 5.3.3 Selected hypothetical project

Hydrogen supply will be either via gas network as a blend or could be via dedicated renewable hydrogen supply from an electrolyser plant. Given the current status of hydrogen blending in gas networks planned in Australia based on current projects under development up to 10% and State government aspirations for 10% hydrogen blending in gas networks by 2030 this is likely to lead to open cycle gas turbine plants using a blend of hydrogen with natural gas. This is likely to suit a larger gas turbine as their current capability for hydrogen operation is still below 100% hydrogen.

Alternatively, a 100% hydrogen gas turbine plant could be supplied from a dedicated 10 MW electrolyser plant using renewable energy supply. This is likely to be a small gas turbine due to hydrogen consumption requirements and the current status of 100% hydrogen capability residing with small gas turbines from OEMs. This is the basis of one of the hypothetical projects with plant capacity based on hydrogen production from a 10 MW electrolyser plant and operated as peaking duty due to matching hydrogen supply and with demand.

The following tables outline the technical parameters for the hypothetical projects (one small gas turbine using a 100% hydrogen and one large gas turbine using a 5% hydrogen blend). The hypothetical project has been selected based on what is envisaged maybe plausible projects for development in the NEM in 2021 given the above discussion on typical options and current trends.

Table 5-4: Hydrogen turbine configuration and performance

Item	Unit	Small GT	Large GT	Comment
<b>Configuration</b>				
Technology		Industrial	Industrial (F-Class)	
Make model		NovaLT16 (Baker Hughes)	GE 9F.03	Small GTs – Typical model planned in Australian project, assumes standard combustor with water injection required for NOx emission control Large GT – Smallest F-Class unit available
Unit size (nominal)	MW	15.9	265	% Output derate for 100% hydrogen to be confirmed with OEM. No derate considered ISO / nameplate rating, GT Pro.
Number of units		1	1	
<b>Performance</b>				
Total plant size (Gross)	MW	14.6	244.3	25°C, 110 metres, 60%RH % Output derate for 100% hydrogen to be confirmed with OEM. No derate considered
Auxiliary power consumption	%	1.5%	1.1%	Small GTs – Assumes no fuel compression required Large GT – Assumes no fuel compression required

<sup>24</sup> <https://www.fuelsandlubes.com/worlds-largest-green-ammonia-plant-in-south-australia-gets-boost/>

Item	Unit	Small GT	Large GT	Comment
Total plant size (Net)	MW	14.32	241.7	25°C, 110 metres, 60%RH % Output derate for 100% hydrogen to be confirmed with OEM. No derate considered
Seasonal Rating – Summer (Net)	MW	13.18	226.4	35°C, 110 metres, 60%RH % Output derate for 100% hydrogen to be confirmed with OEM. No derate considered
Seasonal Rating – Not Summer (Net)	MW	15.62	258.2	15°C, 110 metres, 60%RH % Output derate for 100% hydrogen to be confirmed with OEM. No derate considered
Heat rate at minimum operation	(GJ/MWh) LHV Net	13,696	14.735	25°C, 110 metres, 60%RH. Assuming a Minimum Stable Generation as stated below. % heat rate derate for 100% hydrogen to be confirmed with OEM. No derate considered
Heat rate at maximum operation	(GJ/MWh) LHV Net	10,591	9.766	25°C, 110 metres, 60%RH % heat rate derate for 100% hydrogen to be confirmed with OEM. No derate considered
Thermal Efficiency at MCR	%, LHV Net	34.0%	36.86%	25°C, 110 metres, 60%RH % heat rate derate for 100% hydrogen to be confirmed with OEM. No derate considered
Hydrogen demand at maximum operation	kg/h (HHV)	1,068		
Heat rate at minimum operation	(GJ/MWh) HHV Net	16,202	16.312	Assuming hydrogen LHV to HHV conversion ratio of 1.183.
Heat rate at maximum operation	(GJ/MWh) HHV Net	12,529	10.811	Assuming hydrogen LHV to HHV conversion ratio of 1.183.
Thermal Efficiency at MCR	%, HHV Net	28.7%	33.30%	Assuming hydrogen LHV to HHV conversion ratio of 1.183.
<b>Annual Performance</b>				
Average Planned Maintenance	Days / yr.	5	5	
Equivalent forced outage rate	%	2%	2%	
Effective annual capacity factor (year 0)	%	10%	20%	Small GT – based on available hydrogen production. H2 storage required Average capacity factor for similar GTs on the NEM.
Annual generation	MWh / yr.	12,544	423,502	
Annual degradation over design life - output	%	0.24%	0.24%	Assuming straight line degradation.
Annual degradation over design life – heat rate	%	0.16%	0.16%	Assuming straight line degradation.

Table 5-5: Hydrogen turbine technical parameters

Item	Unit	Small GTs	Large GT	Comment
<b>Technical parameters</b>				
Ramp Up Rate	MW/min	10	22	Station normal ramp rate under standard operation. Based on OEM data.
Ramp Down Rate	MW/min	10	22	Station normal ramp rate under standard operation. Based on OEM data.
Start-up time	Min	15	30	Standard normal operation.
Min Stable Generation	% of installed capacity	50%	50%	Small GT – to be confirmed with OEM for NOx emissions limits
<b>Project timeline</b>				
Time for development	Years	2.5	2	Small GTs project – additional time for any product testing Large GT – assumes hydrogen blend is within existing combustion system design capability includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	2021	
EPC programme	Years	2	2	NTP to COD.
■ Total Lead Time	Years	0.75	1	Time from NTP to gas turbine on site.
■ Construction time	Weeks	65	58	Time from gas turbine on site to COD.
Economic Life (Design Life)	Years	25	25	Can be capacity factor dependant
Technical Life (Operational Life)	Years	40	40	

### 5.3.4 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 5-6: Hydrogen turbine cost estimate

Item	Unit	Small GT	Large GT	Comment
<b>CAPEX – EPC cost</b>				
Relative cost	\$ / kW	2,150	750	100% hydrogen for small GT 5% hydrogen blend in natural gas for large GT
Total EPC cost	\$	30,788,000	181,294,000	

Item	Unit	Small GT	Large GT	Comment
■ Equipment cost	\$	21,551,600	126,906,000	70% of EPC cost – typical. 35% premium considered on small GT only cost for 100% hydrogen assumed. This does not include any SCR if NOx emissions limits are not met. NOx emissions with water injection on 100% hydrogen to be confirmed with OEM. No premium applied on large GT only component as assumed within existing capability for hydrogen blend percentage. Some minor costs for safety improvements, etc not included. This does not include any SCR if NOx emissions limits are not met.
■ Construction cost	\$	9,236,400	54,388,000	30% of EPC cost – typical.
<b>Other costs</b>				
Cost of land and development	\$	2,770,920	16,316,000	Assuming 9% of CAPEX.
Fuel connection costs	\$M	Excluded	\$20M +\$1.5M/km	Small GT plant assumed hydrogen supply from electrolyser plant available Large gas turbine plant - Gas Transport (i.e. pipes/lines) – assumes hydrogen blended in gas network. Otherwise blend skid required (not included)
Gas compressors	\$	Not required	Not required	Assume hydrogen storage pressure sufficient; or gas pipeline supply pressure sufficient. Let down station may be required (not included)
Gas storage <sup>25</sup>		cluded	ed: \$0.015 - \$0.025 /GJ/Day riable (injection): \$0.014 - \$0.093 /GJ riable (withdraw): \$0.041 - \$0.093 /GJ	For Small GT plant assumes hydrogen storage cost considered elsewhere Gas storage refers to underground storage facility in a depleted natural gas field. Costs based on published prizes for Iona underground gas facility.
First Year Assumed Commercially Viable for construction		21	21	For % hydrogen capability stated above. 100% hydrogen turbine testing timeline for small gas turbine to be confirmed with OEM for this development timeline.
<b>OPEX – Annual</b>				
Fixed O&M Cost	\$ / MW (Net)	65,000	10,200	Based on Aurecon internal database.
Variable O&M Cost	\$ / MWh (Net)	38	7.3	Based on Aurecon internal database. Small GT water consumption for NOx control not included (rate to be confirmed with OEM for NOx emissions control)
Total annual O&M Cost	\$	1,407,492	5,556,904	Annual average cost over the design life

<sup>25</sup> ACCC (2020), "Gas inquiry 2017–2025 Interim report", www.ACCC.gov.au

## 5.4 Electrolysers

### 5.4.1 Overview

The interest in hydrogen as part of the energy mix has increased dramatically in the past few years, as hydrogen offers a potential pathway to a low carbon future when produced using renewable power generation sources. Once produced, hydrogen can then be stored and/or transported either via pipeline, for domestic use, or ocean-going vessel for international export. Currently hydrogen is seen as a potential zero emission transport fuel, alternative fuel for iron and steel production, or for potential blending with natural gas in existing gas pipelines.

### 5.4.2 Typical options

Hydrogen is typically produced either by electrolysis of water, or by a thermochemical process which uses fossil fuels. Currently, approximately 96% of hydrogen production is by thermochemical process, although renewable hydrogen – *using water electrolysis and electricity generated by renewable sources* - is gaining momentum.

For this report, the focus is the production of hydrogen through a zero-emission electrolysis process. For this there are two primary technology options, being:

- Alkaline electrolysis – a mature electrolyser technology based on submersed electrodes in liquid alkaline electrolyte solution. This technology has long been used in the production of chlorine where hydrogen is produced as a by-product.
- Proton Exchange Membrane (PEM) – a less mature electrolyser technology categorised by its semipermeable polymer electrolyte membrane which separate the electrodes

Designs vary from supplier to supplier but in most cases electrolysers are made up from a number of individual cells or stacks of cells manifolded together for a combined output. The individual cell stacks range in size up to approximately 5 MW, with overall unit capacities currently being marketed up to approximately 20 MW, particularly for Alkaline. Beyond this, electrolyser plants would install multiples of standard units with a degree of utility sharing being applied.

### 5.4.3 Recent trends

The debate continues between the relative benefits of the various technologies and indeed from individual supplier to supplier. Where large industrial scale applications are being proposed the capex cost advantage of low-pressure systems are being maximised and this can be seen from both PEM and Alkaline suppliers.

Several examples of grid services applications are being published globally. The 10 MW PEM electrolyser Shell are installing at their Rhineland Refinery<sup>26</sup>, recently achieving start-up in July 2021 as Europe's largest PEM electrolyser in operation, will provide grid stabilisation services and recent findings from E.ON show alkaline technology has potential for this also<sup>27</sup>.

Globally the trend in electrolysis is to the larger scale with more and more projects planned to be developed in the triple figure MW range. Electrolyser OEMs are either planning to or are building giga-factories for the increased manufacturing production of electrolyser capacity requirements expected globally.

For hydrogen production, PEM electrolysers have been growing in popularity relative to more traditional Alkaline technology for the smaller scale projects. This is primarily due to the improved dynamic operation of the PEM-based technology, with improved responsiveness, and improved current densities.

<sup>26</sup> <https://www.fch.europa.eu/news/launch-refhyne-worlds-largest-electrolysis-plant-rhineland-refinery>

<sup>27</sup> <https://www.eon.com/en/about-us/media/press-release/2020/2020-06-30-e-on-and-thyssenkrupp-bring-hydrogen-production-on-the-electricity-market.html>

PEM typically also produces hydrogen at around 30 bar compared to atmospheric pressures typically achieved with alkaline electrolyzers which reduces the need for costly first stage compression depending on end use transportation and application requirements.

Most proposed and planned hydrogen production projects in Australia are in the 10 – 100 MW range using either PEM or Alkaline electrolyzers, most notably including:

- Neoen Hydrogen Superhub Project in Crystal Brook, South Australia – 50 MW electrolyser
- H2U Eyre Peninsular Gateway Project, South Australia – 75 MW electrolyser with renewable hydrogen used for ammonia production among other uses
- Engie Yara Pilbara Renewable Ammonia Project – 10 MW electrolyser for renewable hydrogen production to be used in existing ammonia plant for ammonia production
- AGIG Hydrogen Park Murray Valley (HyP Murray Valley) Project – 10 MW electrolyser for renewable hydrogen production and use including blending with natural gas in local gas networks
- ATCO Clean Energy Innovation Park – 10 MW electrolyser for renewable hydrogen production and use including blending in gas network
- Larger scale planned developments to be operational in 2025 and beyond include Fortescue Future Industry’s (FFI’s) planned 250 MW green hydrogen plant at Bell Bay in Tasmania and Stanwell’s Central Queensland Hydrogen Project with some 3 GW’s of ultimate electrolyser capacity

It is important to note that the choice made between PEM and Alkaline electrolyser technologies is project specific with both having a role to play in the current market. Generally speaking, Alkaline electrolyser technology is lower in cost compared to PEM with both undergoing dramatic reductions in cost (on a \$/MW basis) as projects and manufacturing is being increased in scale. Electrolyser plant equipment capex from Chinese Alkaline suppliers can be up to 50% cheaper when compared to Western suppliers based on recent market activity on renewable hydrogen development projects in Australia.

Although PEM is seen as more responsive and/or flexible, recent improvements have been made with the latest Alkaline electrolyses which has closed the gap in some areas and offers improved benefits in others (such as reduced water consumption).

#### 5.4.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM, given the above discussion on typical options and current trends.

**Table 5-7: Electrolyser configuration and performance**

Item	Unit	PEM	Alkaline	Comment
<b>Configuration</b>				
Technology		Proton Exchange Membrane	Alkaline	
Unit size (nominal)	MW	10	10	Selected based on the upper range of currently available single stack sizes (or combined as stack modules).
Number of modules		1	1	
<b>Performance</b>				
Total plant size	MW	10	10	Net of auxiliaries
Auxiliary power consumption	%	~5%	~5%	Excludes compression. Depends on manufacturer, cooling system, etc
Seasonal Rating – Summer (Net)	MW	10	10	Derating not expected at 35°C. Will be dependent on cooling system design.

Item	Unit	PEM	Alkaline	Comment
Seasonal Rating – Not Summer (Net)	MW	10	10	
Efficiency	%	65.7%	71.7%	HHV basis
Hydrogen Production	kWh/kg	60	55	Typical (whole package), excluding additional compression (shown below). Varies with OEM
Hydrogen production rate	kg/h	167	181.8	
Output pressure	bar	~ 30 bar	Atmospheric	Siemens SILYZER 300 product (which is PEM) is offered as atmospheric
Additional compression power	kW	125	485	Additional power required to compress hydrogen to 100bar
Life cycle design	hrs	80,000	80,000	Represents typical expected life of cells only. Cells can be refurbished or replaced within the unit to achieve plant life of around 25 years. Some variance across OEMs.
Water consumption	L/kgH <sub>2</sub>	-15-20	15 - 20	Typical raw water consumption volumes, for hydrogen production only (excludes any cooling water make-up). Quantity of rejected water will vary according to original water quality. Typically PEM technology requires a high quality of water to enter the cells and as such more water is rejected in the purification step.
<b>Annual Performance</b>				
Average Planned Maintenance	Days / yr.	<15	15	Includes consideration for mid-life stack replacement on average annual basis.
Equivalent forced outage rate	%	3%	3%	
Annual degradation	%	1	1	Typical published value.

Table 5-8: Technical parameters and project timeline

Item	Unit	PEM	Alkaline	Comment
<b>Technical parameters</b>				
Ramp Up Rate		10-100%/sec	20%/minute	PEM typically 10%-100%/sec. Alkaline typically 20%/minute. Some Alkaline OEMs have faster rates (e.g. 20% per 6 sec)
Ramp Down Rate		10-100%/sec	20%/minute	PEM typically 10-100%/sec. Alkaline typically 20%/minute. Some Alkaline OEMs have faster rates e.g. 20% per 6 sec)
Start-up time	Min	Cold: 5 Warm: 0.5	Cold: 60 Warm: 1	Quoted start up time varies from vendor to vendor, however typically PEM technology advertises faster start-up particular in the cold start-up case
Min Stable Generation	% of installed capacity	10%	10%	Typical
<b>Project timeline</b>				



Item	Unit	PEM	Alkaline	Comment
Time for development	Years	2	2	Includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	2021	Although theoretically viable at this size in 2020 it is questionable that a hydrogen offtake agreement could be secured for this volume and at a price that would result in a commercially viable project.
EPC programme	Years	2	2	For NTP to COD.
■ Total Lead Time	Years	1.5	1.5	Time from NTP to main equipment on site.
■ Construction time	Weeks	26	26	Time from main equipment on site to COD.
Economic Life (Design Life)	Years	10	10	Assumed time to membrane replacement based on 91.3% capacity factor. If powered purely by renewables capacity factors will be lower.
Technical Life (Operational Life)	Years	25	25	Typical value.

#### 5.4.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above, however the costs are representative of the technology type rather than the specific vendors and models as per above.

Table 5-9: Cost estimates

Item	Unit	PEM	Alkaline	Comment
<b>CAPEX – EPC cost</b>				
Relative cost	\$ / kW	2,500	1,500	Full EPC turn-key. Alkaline range (\$1,000-\$1,750/kW); PEM range (\$2,000-\$2,750/kW), varies based on Chinese supply vs Western supply and OEM. Chinese supply PEM not included in cost range.
Total EPC cost	\$	25,000,000	15,000,000	
■ Equipment cost	\$	17,500,000	10,500,000	70% of EPC cost – typical. Excludes compression and storage
■ Construction cost	\$	7,500,000	4,500,000	30% of EPC cost – typical.
<b>Other costs</b>				
Cost of land and development	\$	2,000,000	1,500,000	Based on 8-10% of CAPEX.
Fuel connection costs	\$	N/A	N/A	
Hydrogen compressor	\$	2,200,000	5,200,000	Single 1 x 100% duty train
Hydrogen transport	\$/km	\$150,000/km	\$150,000/km	DN50 buried pipeline (suitable for 1 x 10 MW unit)
<b>OPEX – Annual</b>				
Fixed O&M Cost	\$ / MW (Net)	75,000	45,000	Based on 3% of CAPEX per annum. Note that this includes allowance for the 10 year stack overhaul. Stack overhaul cost is based on current costs. Excludes power consumption costs

Item	Unit	PEM	Alkaline	Comment
Variable O&M Cost	\$ / MWh (Net)	-		Included in fixed O&M component.
Total annual O&M Cost	\$	750,000	450,000	Annual average cost over the design life. Excludes power and water consumption costs.

## 5.5 Hydrogen Fuel Cells

### 5.5.1 Overview

Hydrogen can be used for a variety of uses including natural gas blending, ammonia production, and mobility applications. Fuel cells for stationary power generation are also being considered to provide a carbon emission free solution continuous electricity generation.

Currently only a small percentage of hydrogen-based projects involve fuel cells for stationary power generation applications and are generally currently applied to small mostly off-grid installations supporting back-up power for homes, businesses, remote communities, universities, data-centres, and hospitals.

### 5.5.2 Typical options

Below are some of the most commonly used fuel cells<sup>28</sup>:

- Proton Exchange Membrane Fuel Cell (PEMFC): PEMFCs use a polymer membrane for their electrolyte and a precious metal, typically platinum, for their catalyst. PEMFCs operate between 40% to 60% efficiency and are capable of handling large and sudden shifts in power output.
- Direct Methanol Fuel Cells (DMFCs): DMFCs also use a polymer membrane as an electrolyte and commonly a platinum catalyst as well. DMFCs draw hydrogen from liquid methanol instead of using hydrogen directly as a fuel.
- Alkaline Fuel Cell (AFC): AFCs use porous electrolytes saturated with an alkaline solution and have an alkaline membrane. AFCs have approximately 60% electrical efficiency.
- Phosphoric Acid Fuel Cell (PAFC): PAFCs use a liquid phosphoric acid and ceramic electrolyte and a platinum catalyst. They have similar efficiencies to those of PEMFCs. PAFCs are often seen in applications with a high energy demand, such as hospitals, schools, and manufacturing and processing centres.
- Solid Oxide Fuel Cell (SOFC): SOFCs operate at high temperatures and use a solid ceramic electrolyte instead of a liquid or membrane. SOFCs are used in large and small stationary power generation and small cogeneration facilities.

Stationery fuel cell stack sizes vary from <1 kW to 3 MW. Fuel cell installations can either be provided as standalone plants or installed in in combination with other power (e.g. Rooftop PV) or energy storage (e.g. Lithium battery) solutions.

### 5.5.3 Recent trends

For stationery fuel cells the uptake has been growing rapidly worldwide, with installed capacity reaching 1.6 GW in 2018. However, only a small portion (approximately 70 MW) is fuelled by hydrogen<sup>29</sup>. Some of the largest technology companies including Apple, Google, IBM, Verizon, AT&T, and Yahoo have all recently installed small scale (kW scale) stationery hydrogen fuel cells as a source of power for their operations. The world's largest fuel cell power plant commenced commercial operation in February 2019 in South Korea<sup>30</sup>.

<sup>28</sup> <http://www.fchea.org/fuelcells>

<sup>29</sup> The Future of Hydrogen, Report prepared by the IEA for the G20, Japan, Seizing today's opportunities

<sup>30</sup> <https://www.powermag.com/worlds-largest-fuel-cell-plant-opens-in-south-korea/>

This 59 MW plant consists of 21 x 2.8 MW hydrogen fuel cells. However, hydrogen for this facility is produced from natural gas.

In Australia, stationary fuel cell plants that use hydrogen as fuel are generally small pilot-scale projects and/or installed in commercial buildings and data centres for both power and CHP applications, for example:

- Griffith University in Brisbane has a building which has been run with a 60 kW hydrogen fuel cell since 2013<sup>31</sup>
- Toyota's Hydrogen Centre of Excellence hydrogen production and refuelling station at Altona, including stationary 30 kW fuel cell for power generation completed in 2021<sup>32</sup>

MW scale fuel cell power generation applications have started to be studied in Australia using renewable hydrogen production and storage for power generation and export during peak times and potential grid stability services.

## 5.5.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM in 2020, given the above discussion on typical options and current trends.

Table 5-10: Fuel cell configuration and performance

Item	Unit	Small	Large	Comment
<b>Configuration</b>				
Technology		PEM-FC	PEM-FC	Technology offer for the demonstration plant in SA.
Make model		Cummins - Hydrogenics HyPM-XR120	Cummins - Hydrogenics HyPM-XR120	Example.
Unit size (nominal)	MW	0.120	0.120	
Number of units		1	12	(4 x XR30 modules), 1-12 units.
<b>Performance</b>				
Total plant size (Gross)	MW	0.120	1.2	25°C, 110 metres, 60%RH
Auxiliary power consumption	%	10%	10%	Assumption
Total plant size (Net)	MW	0.108	1.08	25°C, 110 metres, 60%RH
Seasonal Rating – Summer (Net)	MW	0.108	1.08	35°C, 110 metres, 60%RH
Seasonal Rating – Not Summer (Net)	MW	0.108	1.08	15°C, 110 metres, 60%RH
Heat rate at minimum operation	(GJ/MWh) HHV Net	11.36	11.36	Based on a fuel consumption of 0.08 kg/kWh (net)
Heat rate at maximum operation	(GJ/MWh) HHV Net	9.94	9.94	Based on a fuel consumption of 0.07 kg/kWh (net)
Thermal Efficiency at MCR	%, HHV Net	36.2%	36.2%	25°C, 110 metres, 60%RH
Hydrogen consumption at MCR	kg/h	7.56	75.6	
<b>Annual Performance</b>				
Average Planned Maintenance	Days / yr.	-	-	Included in EFOR below.

<sup>31</sup> <https://new.gbca.org.au/showcase/projects/sir-samuel-griffith-centre/>

<sup>32</sup> <https://energys.com.au/green-hydrogen-news/toyota-launches-victorian-hydrogen-production-and-re-fuelling-facility-powered-by-energys-australia>

Item	Unit	Small	Large	Comment
Equivalent forced outage rate	%	2%	2%	

Table 5-11: Technical parameters and project timeline

Item	Unit	Small	Large	Comment
<b>Technical parameters</b>				
Ramp Up Rate	MW/min	0.926	9.25	Based on 0% to 100% in 7 secs as per OEM datasheet.
Ramp Down Rate	MW/min	0.926	9.25	Based on 100% to 0% in 7 secs as per OEM datasheet.
Start-up time	Min	Cold: 5 Warm: 0.5	Cold: 5 Warm: 0.5	Typical
Min Stable Generation	% of installed capacity	10%	10%	Typical Continuous Minimum turndown
<b>Project timeline</b>				
Time for development	Years	< 1	<1	includes pre/feasibility, design, approvals etc.
First Year Assumed Commercially Viable for construction	Year	2021	2021	
EPC programme	Years	< 1	<1	For NTP to COD.
■ Total Lead Time	Years	0.75	0.75	Time from NTP to Fuel cell delivery to site.
■ Construction time	Weeks	13	20	Time from fuel cell on site to COD.
Economic Life (Design Life)	Years	8	8	Based on a capacity factor of 38% with a typical stack replacement frequency of 25,000 operating hours
Technical Life (Operational Life)	Years	20	20	

### 5.5.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 5-12: Cost estimates

Item	Unit	Small	Large	Comment
<b>CAPEX – EPC cost</b>				
Relative cost	\$ / kW	13,300	6,100	Aurecon in-house database. Includes full turn-key EPC for standalone installation including cooling systems and connection to electrical system LV.
Total EPC cost	\$	1,596,000	7,320,000	
■ Equipment cost	\$	1,276,000	5,856,000	80% of EPC cost – typical.
■ Construction cost	\$	320,000	1,464,000	20% of EPC cost – typical.
<b>Other costs</b>				
Cost of land and development		320,000	732,000	Assuming 10-20% of CAPEX due to overall small footprint.

Item	Unit	Small	Large	Comment
Fuel connection costs	\$	Excluded		Pressure let-down equipment may be required depending on hydrogen supply pressure.
<b>OPEX – Annual</b>				
Fixed O&M Cost	\$ / MW (Net)	532,000	244,000	Based on 5% of equipment CAPEX per year. <sup>33</sup>
Variable O&M Cost	\$ / MWh (Net)	-	-	Included in the fixed O&M component.
Total annual O&M Cost	\$	63,800	292,800	Annual average cost over the design life. Dependant of annual capacity factor. Excludes stack replacement. Includes scheduled maintenance and operator allowance.


## 5.6 SMR & CCS

### 5.6.1 Overview


Steam Methane Reforming (SMR) is a method for producing grey or blue hydrogen by passing methane and steam over a catalyst at high temperature at moderate pressure.

The process follows the two following reactions:

Reforming:



CO formed in the reforming reaction is then converted by water-gas shift (WGS):



Following reforming and purification, the produced hydrogen can be stored, transported or consumed by a variety of methods. This includes compression and liquefaction for transport by cylinder, pipeline transport and conversion to ammonia for use as chemical feed stock or export. SMR plants are typically installed for production of hydrogen as a chemical feed stock and often produce steam for other plant demands as a byproduct. SMR plants currently produce 95% of the world's hydrogen.<sup>34</sup>

Blue hydrogen production is achieved here by implementing Carbon Capture and Storage (CCS) to the waste streams from the plant. Without CCS, it is referred to as grey hydrogen.

The SMR process produces hydrogen and carbon dioxide, typically in ratios of approximately 1kg H<sub>2</sub> to 7-10 kg CO<sub>2</sub> (including combustion products from the plant process burners). With CCS implemented, this can be reduced to 1 kg CO<sub>2</sub> per kg H<sub>2</sub>.

Carbon Capture is generally performed by passing the hydrogen/carbon dioxide gas stream through an absorption column with one of many commercially available absorbent solution products (usually amine based), and then removing the carbon dioxide from the absorbent in an adjacent stripper column. The carbon dioxide is then usually compressed and transported by pipeline to a well field for injection underground or stored for usage as a product. Carbon capture installations will reduce the efficiency of the SMR, with additional energy requirements for pumping and heat for stripping.

### 5.6.2 Current trends

Plants currently operating in Australia produce Hydrogen by reforming natural gas or gasification of coal without CCS, and have capacities between 40 and 400 t H<sub>2</sub>/day (between 18.5 and 141 ktpa).<sup>35</sup>

<sup>33</sup> Eichman J, Townsend A, Melaina M (2016), "Economic Assessment of Hydrogen Technologies Participating in California Electricity Markets", National Renewable Energy Laboratory, NREL/TP-5400-65856

<sup>34</sup> Rapier 2020, Estimating The Carbon Footprint Of Hydrogen Production, <https://www.forbes.com/sites/irrapier/2020/06/06/estimating-the-carbon-footprint-of-hydrogen-production>

<sup>35</sup> De Vos 2021, Australian hydrogen market study, <https://www.cefc.com.au/media/nhnhwxu/australian-hydrogen-market-study.pdf>

Reformer technologies have been mature and stable for some years now and are unlikely to improve significantly (Reactor design technologies offered over the last twenty years claim an improvement of approximately 20 % over traditional reformers,<sup>36</sup> though this efficiency should already be incorporated into any new plant). Opportunities may exist for retrofitting CCS equipment to SMR plants with the location of storage operations of primary consideration in determining costs. Recent studies have claimed that CO<sub>2</sub> emissions from SMR with CCS are approximately 2-3 kg CO<sub>2</sub>/kg H<sub>2</sub> (Zapantis, 2020).

Studies have shown that carbon dioxide transport and storage infrastructure would cost in the order of \$5 - \$14 /t CO<sub>2</sub> for short transport distances to a high value of \$70/t CO<sub>2</sub> for long transport distances.<sup>37</sup>

Depending on the intended hydrogen consumers, current SMR plant designs are capable of generating more than enough gas to meet demand. For example, the CCS institute report estimates that, in order to blend hydrogen into the New South Wales' natural supply at a concentration of 10%, approximately 30,490 Tonnes per annum is required.

This production rate is achievable by the smallest of currently operating SMR plants in Australia. Other consumers are expected to have significantly greater demands (including those current consumers) and would benefit from larger SMR facilities.

### 5.6.3 Selected hypothetical facility and cost estimate

For this study, production of hydrogen by SMR is assumed to be produced at large scale, with the intent of serving local consumers as well as an export facility.

Table 5-13: SMR plant criteria

Item	Low	High	Comment
Hydrogen production rate	200,000 kg/day	900,000 kg/day	Based upon North American plants. Given expected future demand, plant size expected to increase above current Australian sizes to typical large international plants.
CO <sub>2</sub> production rate	7 kg CO <sub>2</sub> /kg H <sub>2</sub>	9 kg CO <sub>2</sub> /kg H <sub>2</sub>	Prior to CCS
CO <sub>2</sub> emission rate after CCS		2 kg CO <sub>2</sub> / kg H <sub>2</sub>	assumed
Water required	6.3 kg/kg H <sub>2</sub>	6.3 kg/kg H <sub>2</sub>	reported in Zapantis 2020
Land Area	3 Ha for plant, 500 Ha for 500 km CO <sub>2</sub> pipeline easement.		Reported in Zapantis 2020 for 80 T/d plant, includes CCS and excludes gas supply pipeline and infrastructure.

A mid-range cost has been assigned for CO<sub>2</sub> transport and storage. It is assumed here that a SMR plant would be of larger capacity and at a location near hydrogen users, rather than near CO<sub>2</sub> storage sites. The larger capacity plant would have a higher CO<sub>2</sub> generation rate, enabling improved per-tonne pipeline transport costs, though the location would require a longer pipeline to the storage facility. Thus, CO<sub>2</sub> transport and storage costs are assumed to be \$30/t CO<sub>2</sub>.<sup>38</sup>

Table 5-14: SMR plant Cost estimate

Item	Low	High	Comment
Hydrogen production rate	200 tonne/d	900 tonne/d	
Cost of production	AUD \$2.10/kg H <sub>2</sub>	AUD \$3.10/kg H <sub>2</sub>	reported in Zapantis 2020. <sup>39</sup> Note- the low and high cost figures refer to range of costs not plant size, larger plants are normally more efficient

<sup>36</sup> <https://www.topsoe.com/products/equipment/convection-reformer-htcr?hsLang=en>

<sup>37</sup> Electric Power Research Institute, 2015 Australian Power Generation Technology report

<sup>38</sup> Electric Power Research Institute, 2015 Australian Power Generation Technology report fig 138

<sup>39</sup> Zapantis 2020- Replacing 10% of NSW Natural Gas Supply with Clean Hydrogen: Comparison of Hydrogen Production Options

Item	Low	High	Comment
CAPEX	AUD \$1,300/kW H <sub>2</sub>		(with no carbon capture)
CAPEX	AUD \$1,820/kW H <sub>2</sub>	AUD 2,400/kW H <sub>2</sub>	(with carbon capture) <sup>40</sup>
Total Capex Cost	600 M AUD	2700 M AUD	Total CAPEX with CCS
OPEX / year	18 M AUD	81 M AUD	

Based on the CAPEX data listed in Table 5-13, an SMR plant of 900 tonne H<sub>2</sub>/day capacity would cost of the order of AUD \$2B without carbon capture and \$2.7B with. These estimates are for the plant only and do not include transport and storage costs for H<sub>2</sub> or CO<sub>2</sub>.

## 5.7 Hydrogen Storage

### 5.7.1 Overview and selected options

Unless the entire output of a hydrogen generation process is used immediately at the point of origin, some form of hydrogen storage is almost always necessary. Bulk hydrogen storage has several difficulties to overcome. Hydrogen is a light gas with low density, with 1kg occupying approximately 11m<sup>3</sup> at ambient conditions. Storing this volume would be impractical, so a storage facility must reduce the volume of hydrogen by some means. The main industrial storage options are the following:

- **Pressurised Tanks:** Hydrogen is compressed to high pressure as a gas. Whilst pressures of up to 700bar are possible, most compressed storage is less than 200 bar, owing to operating and safety concerns.<sup>41</sup> These are of varying size. These may range from a small 49L gas cylinder containing 0.65 kg Hydrogen at 164 Bar to large industrial vessels.<sup>42</sup> Hydrogen pressure are classified by material, with four main types. Type I is all metal construction, typical max pressure of 200 Bar. Type II is mostly metal, with composite overwrap in the hoop direction and typical maximum pressures of 200 Bar. Type III is metal lined with a full composite wrap, typical maximum pressures of 700 Bar. Type IV are all composite construction, typical maximum pressures of 700 Bar. Many new projects are considering type IV pressure vessels to store hydrogen.<sup>43</sup>
- **Cryogenic Liquid Hydrogen Storage:** hydrogen is cooled to approximately -252°C. This is then stored as a liquid in insulated tanks, known colloquially as dewar flasks. This requires a liquefaction plant for cooling to low temperatures, and specially designed insulated tanks, typically with vacuum-sealed double-shell thermal insulation. These tanks are operated at atmospheric pressure, and a small amount of hydrogen is lost in evaporation. Liquid hydrogen is not very dense, with a density of approximately 70 kg/m<sup>3</sup>.<sup>9</sup>
- **Geologic hydrogen storage:** Hydrogen is injected under pressure into an underground gas reservoir such as depleted natural gas well and salt cavern. This is considered in more detail below under section 5.8.

Whilst there are other possible mechanisms such as adsorption onto surfaces and formation of metal hydrides, these methods have yet to be developed industrially and are not considered in this report. Note that hydrogen is an explosive gas and all large storage sites will be considered a Major Hazard Facility (MHF) and will be governed by MHF legislation.

<sup>40</sup> IEA (2019), The Future of Hydrogen, Assumptions annex, IEA, Paris <https://www.iea.org/reports/the-future-of-hydrogen>

<sup>41</sup> Anderson and Gronkvist, 2019. Large-scale storage of hydrogen, International Journal of Hydrogen Energy, (44) pp. 11901-11919

<sup>42</sup> Lee's Loss Prevention in the Process Industries, Chapter 22.14

<sup>43</sup> Rivard et al 2019- Hydrogen Storage for Mobility: A Review Materials, 12, 1973; doi:10.3390/ma12121973

## 5.7.2 Recent trends

The current trend in compressed gas storage tanks is towards higher pressure storage. This is partly driven by the requirements of hydrogen vehicles, which have limited space for an onboard tank. The higher the pressure, the greater the density of hydrogen and thus the mass of hydrogen stored. This is weighed against the greater risk of rupture and explosion at higher pressure, as well as the specialised materials and wall thickness required to store a gas at high pressure with associated higher costs.

The hydrogen automotive vehicle industry has seen the development of high pressure tanks. Commercial fuel cell electric vehicles such as the Toyota Mirai and the Honda Clarity both rely on compressed hydrogen for pressure vessels for onboard hydrogen storage.

The maximum pressure is 700 bar, although industry is aiming to go higher. The pressure is extremely high and demands an extremely robust tank. At these pressures, Type III or IV pressure vessels are used.<sup>44</sup>

There has recently been an increase in the size and number of cryogenic liquid hydrogen storage facilities. Part of this is driven by the desire to make bulk liquid hydrogen into a commodity which may be shipped, requiring large storage facilities at supply and delivery terminals. The largest liquefaction plant is currently 32 tpd liquid Hydrogen.<sup>45</sup> Plans are under way to build a plant with 90 tpd capacity.<sup>46</sup>

Japan has seen heavy development in Hydrogen storage, partly as a means of lowering greenhouse gas emissions. The world's first liquefied hydrogen carrier, the 116 m Suiso Frontier was recently launched by Kawasaki Heavy Industries.<sup>47</sup> The same company has also announced the design of 10,000m<sup>3</sup> storage facility for liquid hydrogen, but this has yet to be built.<sup>48</sup>

Nasa currently operates the largest hydrogen storage tank at Cape Canaveral at the US, for fuelling of spacecraft, with a maximum capacity of 270 t or roughly 3800m<sup>3</sup>.<sup>49</sup>



Figure 2: Hydrogen storage tank, Cape Canaveral (picture NASA)

Whilst traditional cryogenic tanks with venting are dominant, NASA recently announced an attempt to avoid the evaporation losses of traditional liquid hydrogen storage. The proposed method involves cooling tanks via an external heat exchanger.<sup>50</sup>

<sup>44</sup> Rivard et al 2019- Hydrogen Storage for Mobility: A Review Materials, 12, 1973; doi:10.3390/ma12121973

<sup>45</sup> Decker 2019- Latest Global Trend in Liquid Hydrogen Production

<sup>46</sup> [Hydrogen Liquefiers | Air Liquide \(engineering-airliquide.com\)](#)

<sup>47</sup> [Be water: Japan's big, lonely bet on hydrogen - Nikkei Asia](#)

<sup>48</sup> [Kawasaki Completes Basic Design for World's Largest Class \(11,200-cubic-meter\) Spherical Liquefied Hydrogen Storage Tank | Kawasaki Heavy Industries, Ltd.](#)

<sup>49</sup> Anderson and Gronkvist, 2019. Large-scale storage of hydrogen, International Journal of Hydrogen Energy, (44) pp. 11901-11919

<sup>50</sup> [Innovative Liquid Hydrogen Storage to Support Space Launch System | NASA](#)



### 5.7.3 Selected hypothetical project and cost estimate

For the purpose of hydrogen storage from a SMR plant, a cryogenic storage liquid hydrogen storage facility has been selected as a hypothetical project. This would be a facility for bulk storage of hydrogen, such as a marine import or export facility. The hypothetical facility has been sized according to the requirements of 10 days storage for a plant production of 27 t/day.

**Table 5-15: Liquid hydrogen storage hypothetical Technical parameters**

Item	Value	Units	Comment
Hydrogen production rate	27000	kg H <sub>2</sub> / day	Based on a proposed plant for Los Angeles, by Connelly et al. <sup>51</sup>
Electricity Usage	12	kWh / kg H <sub>2</sub>	Medium value from Connelly et al, Connelly recommends 10-20
Energy Usage per day	324,000	kWh /day	
Storage requirement	10	days	Assumed
Mass Liquid H <sub>2</sub> Stored	270	T Liquid H <sub>2</sub>	Note this is similar in size to the largest vessel, multiple small tanks would be better than a single large vessel

**Table 5-16: Liquid hydrogen storage hypothetical project Cost parameters**

Item	Value	Units	Comment
Cost of Liquefaction and storage Plant Capex	183	\$M AUD	From Connelly et al <sup>51</sup>
OPEX costs (\$ / kg H <sub>2</sub> )	1.93	\$ AUD /kg H <sub>2</sub>	OPEX costs with CAPEX Component removed from US Study
OPEX / Year	19	\$M AUD /yr	
Mass Liquid H <sub>2</sub> Stored	270	T Liquid H <sub>2</sub>	Note this is similar in size to the largest vessel, multiple small tanks would be better than a single large vessel

For the purpose of storage of hydrogen from an electrolyser plant pressurised tanks is assumed as the storage type with assumptions as provided in Section 3.2.5.

### 5.7.4 Hydrogen pipelines and associated costs

Transmission and distribution of hydrogen to end users requires a pipeline network. Hydrogen is normally transferred to users in standard piping materials, such as mild steel, stainless steels or HDPE. There are certain issues relevant to hydrogen piping. Durability of some metal pipes may be degrade over time when exposed to hydrogen, particularly with high purity hydrogen at high pressures, a phenomenon known as hydrogen embrittlement. This effect is highly dependent on metals used, but presents an issue adding hydrogen to existing gas networks. For many common piping materials such as HDPE or PVC there are no concerns about hydrogen damage.<sup>52</sup>

Leakage is also an issue with hydrogen, as hydrogen is more mobile than natural gas, particularly in plastic piping. Permeation rates of hydrogen are approximately 4-5 times that of methane in typical HDPE pipes, leading to increased hydrogen losses compared to natural gas. Leakage losses can be minimised with a new network designed for hydrogen.<sup>37</sup>

<sup>51</sup> Connelly et al 2019 - Current Status of Hydrogen Liquefaction Costs

<sup>52</sup> Melaina et al 2013, Blending Hydrogen into Natural Gas Pipeline Networks: A Review of Key Issues <https://www.nrel.gov/docs/fy13osti/51995.pdf>

There has been some blending of hydrogen into existing natural gas networks. Hydrogen is less energy dense than natural gas on a volume basis than natural gas. This can lead to issues for end users with burners not designed for a mixture of natural gas and hydrogen. Hydrogen typically cannot be raised above 10% in existing gas networks before problems occur.

In some cases, an existing natural gas network may be re-purposed as a hydrogen transmission network. APA is planning to convert 43 km of the existing Parmelia Gas Pipeline in Western Australia to hydrogen.<sup>53</sup>

Leakage and embrittlement are however widely understood, and hydrogen pipelines are becoming more common. There are currently approximately 1600 miles of hydrogen pipelines in the United states at time of writing.<sup>54</sup> Whilst some existing gas networks may be repurposed for hydrogen, the likelihood is that new hydrogen distribution networks will be required for Australia's hydrogen targets to be met.

Pipeline costs vary tremendously, depending upon pipeline materials, size capacity, pipeline materials and the terrain being traversed. Costs in flat level, terrain are much cheaper than buried lines in mountain. GIS tools have seen widespread use in hydrogen piping design. To estimate costs in an Australian context, Aurecon has assumed that costs are based on a new low-pressure hydrogen distribution network, separate to existing natural gas networks for the purpose of domestic hydrogen use from SMR plant. Indicative costs are based on the assumption that the network must distribute hydrogen equivalent to 10% of the annual NSW natural gas consumption. This is not assumed to contain all the small bore lines to end users, only the main distribution headers assumed to be DN150.

Two distribution options are presented below, one with a buried HDPE network operating at low pressure (3 Bar) and a buried steel pipe network operating at medium pressure (7 Bar). One factor to consider in network design is that the low density of hydrogen leads to a lower mass flow. This can be partially mitigated by operating at higher pressure, but this is unlikely to be acceptable within an urban area.

Indicative costs for a new hydrogen distribution network using hydrogen produced from a SMR plant are shown below and assume direct injection of hydrogen without storage.

**Table 5-17: Indicative costs for a new hydrogen distribution network**

Item	Value (HDPE)	Value (Steel)	Units	Comment
Design Throughput	83.5	83.5	tonne H <sub>2</sub> / day	10% of NSW Natural Gas Consumption <sup>55</sup>
Design Throughput	1.0	1.0	kg/s	10% of NSW Natural Gas Consumption
Gas Pressure	3	7	Bar	Assumed
Pipeline Velocity	15	15	m/s	Assumed- <sup>56</sup> refer IEA G20 Hydrogen report: Assumptions
Hydrogen Density	0.25	0.59	kg/m <sup>3</sup>	At 3 and 7 Bar, and 15C—calculated
Main Header Size	160	150	mm	Assumed SDR 11 HDPE for Gas service for HDPE. Sch 40 for steel
Maximum Gas Flow / header	0.05	0.15	kg/s	Calculated
Number of Headers required	20	7		Calculated based upon maximum gas flow per pipe
Length of headers	60	60	km	Assumed
Pipeline Cost	400		\$AUD /m	Based upon a South Australian project
Pipeline Cost		75,000	\$AUD /km/inch	Based upon Aurecon in house data
Network Cost	480	189	\$M AUD	

<sup>53</sup>APA set to unlock australia's first hydrogen-ready transmission pipeline <https://www.apa.com.au/news/media-statements/2021/apa-set-to-unlock-australias-first-hydrogen-ready-transmission-pipeline/>

<sup>54</sup> US Department of Energy [Hydrogen Pipelines | Department of Energy](#)

<sup>55</sup> Zapantis 2020- Replacing 10% of NSW Natural Gas Supply with Clean Hydrogen: Comparison of Hydrogen Production Options

<sup>56</sup> IEA G20 Hydrogen report: Assumptions Annex

Transport of hydrogen produced from a hypothetical 10 MW electrolyser plant is assumed to be via a pipeline with assumptions as stated in Section 3.2.5.

## 5.8 Geological hydrogen storage

### 5.8.1 Overview

Commercial scale hydrogen production, like any chemical, requires a storage solution to ensure balance between facility inflow (supply) and outflow (demand). Geologic hydrogen storage (GHS) offers an alternative to pressure vessels for gaseous hydrogen storage. GHS refers to storage of hydrogen molecules in underground stores, primarily:

- Porous rocks (aquifers, depleted gas/oil reservoirs)
- Artificially created underground spaces (salt caverns, lined rock caverns, disused mines).

The only geologic storage technology to be used at commercial scale is salt caverns (TRL 8). All other GHS technologies are currently under development (TRL 5-6), with pilot projects predominately in Europe and the USA (Argonne National Laboratories, 2019). To date, limited research has been conducted in assessing the potential for Australian GHS.

Table 5-18: Geological Storage Technology Comparison

Parameter	Salt cavern	Depleted reservoir	Aquifer
Technology Readiness Level (TRL)	8	6	5
Capital Cost	Middle	Lowest	Highest
Operating Cost	Highest (Up to 10 gas cycles per year)	Lowest (Up to 2 cycles per year)	Lowest (Up to 2 cycles per year)
Technical Considerations	<ul style="list-style-type: none"> <li>■ Large volume of water required for cavern leaching</li> <li>■ Brine disposal following cavern leaching</li> </ul>	<ul style="list-style-type: none"> <li>■ Impurities resulting in production of methane, H<sub>2</sub>S</li> <li>■ Reactivity of hydrogen with liquid remaining liquid hydrocarbons</li> </ul>	<ul style="list-style-type: none"> <li>■ Risk of gas leakage (aquifer tightness)</li> <li>■ Impurities resulting in production of methane, H<sub>2</sub>S</li> </ul>

Geologic storage systems typically operate between 70-200 bar. As pressure increases, the total amount of gas storage increases at the expense of installing additional above ground equipment. All geologic storage systems have an above ground and below ground component. An example schematic for a salt cavern option is provided in Figure 3.

- Above ground equipment includes gas treatment (dehydration and chemical injection), compression (including cooling) and pressure let-down. These systems are common to all GHS projects and account for 10-30% of total project capital depending on storage pressure.

- Below ground equipment consists of the reservoir (including costs to purge), tunnels and associated drilling and completions infrastructure. For lined caverns a below ground cost will also include installation of the reservoir liner. Below ground costs account for 60-90% of total project capital

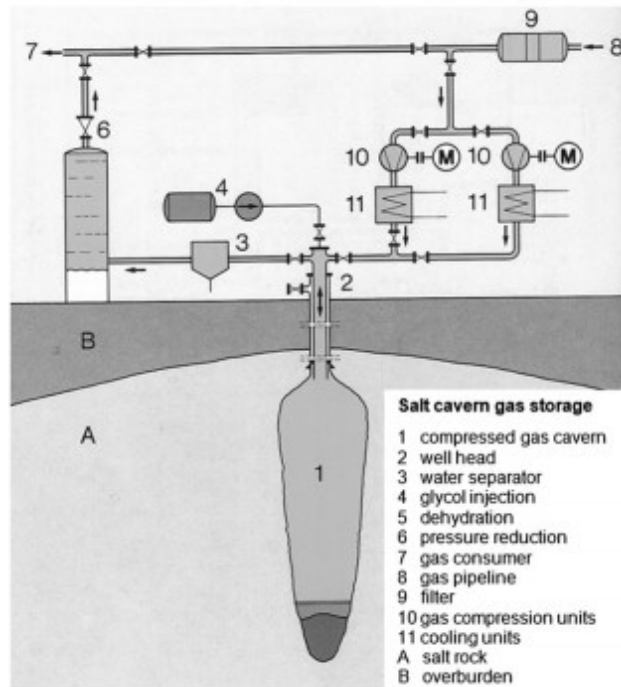


Figure 3: Salt cavern storage schematic (Ozarslan, 2012)

## 5.8.2 Recent trends

There are currently only four locations in the world which operate GHS at >95% purity of hydrogen. Table 5-19 provides a summary of major operating sites.

Table 5-19: Geologic hydrogen storage operating sites (Zavir, Kumar, Foroozesh, 2021)

Project Name	Operator	Hydrogen Purity	GHS Type	Working Pressure (bar)	Mean Depth (m)	Cavern Volume (m <sup>3</sup> )	Max. Storage Mass (tonne)
Teesside (UK)	Sabic Petroleum	>95%	Bedded salt	45	365	210,000	~750
Clemens (USA)	ConocoPhillips	>95%	Salt dome	70-137	1,000	580,000	~5,500
Moss Bluff (USA)	Praxair	>95%	Salt dome	55-152	1,200	566,000	~6,000
Spindletop (USA)	Air Liquide	>95%	Salt dome	68-202	1,340	906,000	~12,500

With increasing focus on commercial scale hydrogen project, several pilot studies across the northern hemisphere have been commissioned. These will assess the viability of storing hydrogen in depleted gas reservoirs. There is potential for increased competition with CCS projects if hydrogen storage in reservoirs is deemed viable in Australia.

Currently the Future Fuels CRC is completing a study to identify potential salt cavern storage locations in Australia. These are limited to areas with large salt deposits, meaning projects will be confined to Western Australia, South Australia and the Northern Territory (as per Figure 4).

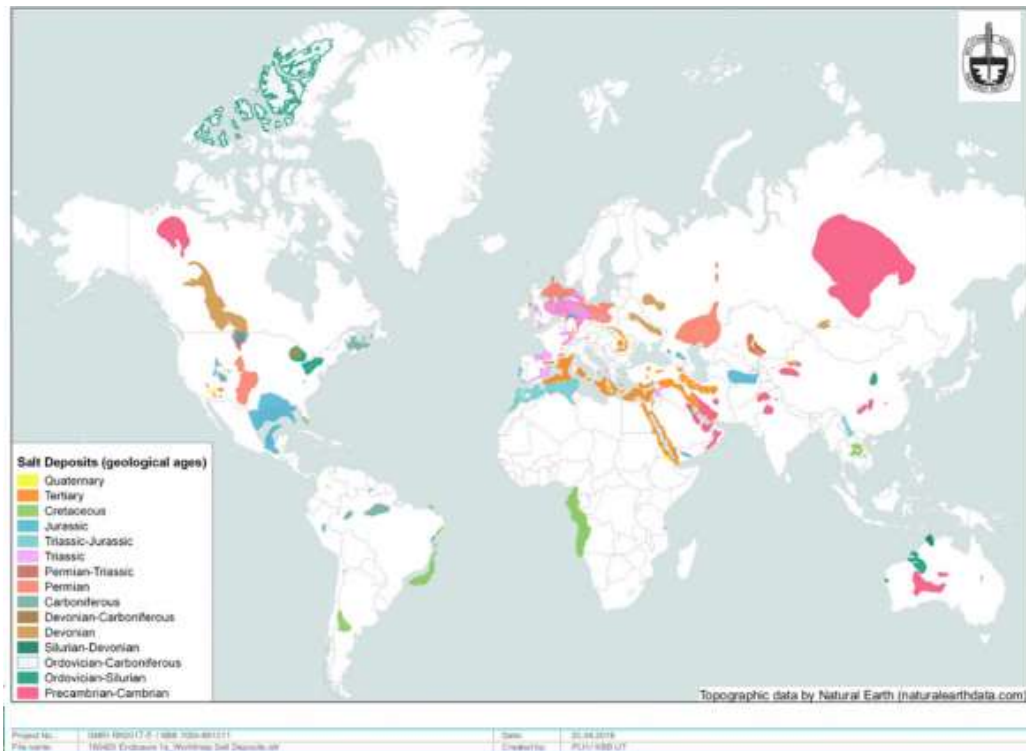


Figure 4: Global salt deposit locations (Engie, 2019).

### 5.8.3 Selected hypothetical project and cost estimate

The selected hypothetical project is a salt cavern that reflects operating conditions of existing projects in the UK and USA. The potential for salt cavern storage at this scale in an Australian context has yet to be explored.

Table 5-20: Hypothetical Geologic Storage Project Parameters

Item	Unit	Value	Comments
<b>Configuration</b>			
Cavern Volume	m <sup>3</sup>	300,000	Average sized cavern, unknown if viable in Australian context
Maximum Storage Capacity	tonne	~2,200	Stored hydrogen mass at operating temperature and pressure
Mean Depth	m	1000	Salt deposits can range from 200-1500m in depth.
Working Capacity	m <sup>3</sup>	210,000	30% cushion gas, required to maintain pressure for withdrawal and injection
<b>Performance</b>			
Hydrogen Purity	%	> 95%	Commercial grade hydrogen
Gas Cycling Requirements	-	10 annual cycles	Impacts operating costs
Operating Pressure	bar	100	

Item	Unit	Value	Comments
Operating Temperature	°C	30-40	
Energy Consumption	MWh/tonne	1.2	Energy for hydrogen compression (assumed from 10 Bar to 100 Bar)
<b>Project Timeline</b>			
Project Development	months	12-18	From concept to FID (engineering only, not approvals which may take longer)
Project Execution	years	5-7	From FID to commissioning
Major Turnaround Cycle	years	3-4	Driven by compressor maintenance requirements

The following table provides the cost parameters (excluding owner's costs) for the hypothetical project as outlined above, noting that costs are reflective of the project in the table above.

**Table 5-21: Hypothetical Project CAPEX and OPEX costs**

Item	Unit	Value	Comments
<b>CAPEX</b>			
Engineering	\$M AUD	7-10	Includes engineering and geotechnical activities
Below Ground Costs	\$M AUD	35-55	Cavern and tunnel excavation, leaching
Leaching and Brine Disposal	\$M AUD	5-10	Assumes \$2 per barrel for brine disposal
Above Ground Costs	\$M AUD	15-35	Includes compression, treatment and let-down kit, as well as piping
<b>OPEX</b>			
Operations and Maintenance	\$M AUD per year	1.1 -1.98	Assumes OPEX is 2.2% of capital costs of above and below ground CAPEX.

# 6 Ammonia Production Facility

## 6.1 Overview

Ammonia production commenced at an industrial scale in the early twentieth century with the development of the Haber-Bosch process, which reacts hydrogen with nitrogen over a metallic catalyst, typically under high pressure and temperature. The synthesis process follows the equation below and the reaction is exothermic.



Traditionally the hydrogen is sourced from a hydrocarbon source such as natural gas or coal and the nitrogen from the atmosphere. While there are a variety of process available the dominant is Steam Methane Reforming (SMR), where natural gas is the feedstock.

Ammonia's dominant use in terms of volume is to manufacture artificial fertilisers and explosives but is commonly used as a refrigerant. The global production of ammonia is in the order of 180 million tonnes per year, of which approximately 1% occurs in Australia. Australia has 2 plants in Western Australia, 4 in Queensland and 1 in New south Wales, all using natural gas as a feedstock. Ammonia production accounts for approximately 1% of global CO<sub>2</sub> emissions.

Ammonia is being re-visioned as a potential 'zero carbon fuel', this being true as no carbon is emitted during consumption, however in the conventional process of SMR CO<sub>2</sub> released in the manufacturing process. Where this CO<sub>2</sub> is captured and stored/used the ammonia is known as 'blue'. Where the process no longer uses hydrocarbons as a hydrogen source, instead renewable energy and water are used the resulting ammonia can be referred to as being 'green'.

Traditional plants range from approximately 250 tonnes per day up to over 3,000 tonnes per day.

## 6.2 Recent Trends

Over the past years and decades the trend in conventional ammonia plants has been towards large plants as they are able to achieve higher efficiencies and have a lower specific capex (cost per annualised unit output). Given the significant emission associated with ammonia production, both producers and technology providers are look at ways to reduce the carbon footprint. Some producers are exploring the potential of blending 'green' hydrogen from an electrolysis process into their existing plants, as a step toward a full replacement of the hydrocarbon-based hydrogen supply. Several global ammonia technology companies are either developing electrolysis technology internally or are forming partnerships with suppliers to be able to offer an integrated plant.

While the ammonia syntheses process in a plant using electrolysis as a hydrogen supply will still rely on the Haber-Bosch process, the process will need to change to cater for the pure hydrogen feed and the possibility of a fluctuating feed, as a result of the variable renewable energy source. While traditionally synthesis plants were operated in a steady state regime, having a plant which is able to turn down to match generation is now advantageous.

While the larger plants will continue to be more efficient and cost effective, as the access to green hydrogen is much more geographically distributed than natural gas, building a plant closer to use is becoming more feasible. As such reduced transport and storage costs can negate and compensate for the efficiency penalties of having a smaller plant. As such the technology providers are again offering smaller plants to suit this emerging market.

## 6.3 Selected Hypothetical Project

For the purposes of this document it has been assumed that the ammonia plant would be used as a means to export renewable energy, in a chemical form, to customers not connected to the NEM. The plant is understood to include the required balance of plant equipment necessary to produce ammonia, and export it in liquid form. It does not include the hydrogen supply equipment, (including storage) or the downstream storage and export infrastructure.

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is viewed as a typical project for development as an export solution in 2021 given the above discussion on typical options and current trends.

Due to its size this plant will be classified as a Major Hazardous Facility (MHF).

**Table 6-1: Hypothetical ammonia production facility configuration and performance data**

Item	Unit	Value	Comments
<b>Configuration</b>			
Ammonia Synthesis		Haber-Bosch Process	
Nitrogen Supply		Air Separation Unit (ASU)	
Cooling		Cooling tower	
Waste Heat Recovery		Steam Turbine Generator	Process will produce excess heat in the form of steam which can be used to generate electricity
<b>Performance</b>			
Daily Ammonia production (rated)	tpd	1,000	
Energy Consumption	MWh/t(NH <sub>3</sub> )	1.5-2.5	
Hydrogen consumption	kg(H <sub>2</sub> )/t(NH <sub>3</sub> )	180	Based on synthesis consumption, not inclusive of fuel demands for heating, etc.
Water Consumption	m <sup>3</sup> /t(NH <sub>3</sub> )	0.2-0.8	Varies depending on cooling method and heat integration
<b>Annual Performance</b>			
Annual Ammonia output (typical)	tpa	350,000	Based on 350 online days per year (approximately 96%)
Stream Days	No.	350	As above

**Table 6-2: Hypothetical ammonia production facility technical parameters and project timeline**

Item	Unit	Value	Comments
<b>Technical Parameters</b>			
Minimum Turndown	% of rated capacity	40-60	Turndown capability varies across technology providers
Synthesis Loop Pressure	bar	150-200	Synthesis pool pressure is unique to the technology providers equipment and catalyst.



Item	Unit	Value	Comments
Catalyst		Iron based	Specifics around catalyst vary from vendor to vendor
Footprint		100m x100m	
Project Timeline			
Project Development	months	12-18	From concept to FID
Project Execution	months	18-30	From FID to commissioning
Economic Life (Design Life)	years	25	
Major Turnaround Cycle	years	3-4	Driven by catalyst change and major rotating equipment overhaul

## 6.4 Cost Estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

**Table 6-3: Hypothetical ammonia production facility cost estimate**

Item	Unit	Value	Comments
CAPEX			
Pre FID Engineering	\$M	4	
Execution Cost (TIC)	\$M	220 – 260	Excludes owner's costs and duties
OPEX			
Operations and Maintenance	\$M per year	3.3-3.9	Assumes 1.5% of CAPEX as operating costs.

# 7 Desalination and Water Treatment

## 7.1 Desalination Plant

### 7.1.1 Overview

Desalination is the process of removing salinity (dissolved salts) from a saltwater source. It has been commonly used for more than 100 years in dry climates such as the Middle East, Spain, Malta, Cyprus and parts of the United States where access to traditional water supplies is limited.

In Australia there are large-scale desalination plants in Sydney, Perth, the Gold Coast and Adelaide, as well as the Wonthaggi in Victoria which are built to produce sustainable drinking water supply from seawater.

### 7.1.2 SWRO process description

Seawater is drawn in from the ocean through specially designed intake structures. A pre-treatment step is required, which involves filtration and chemical dosing for coagulation/flocculation, to remove solids such as sand and sediment. The pre-treated seawater is then subject to a reverse osmosis process where pressure is applied to water to force it to move from an area of higher salt concentration to an area of lower salt concentration. Salt water is pushed against fine membranes under high pressure to impurities, such as salt and other minerals, from water. Water passes through, leaving seawater concentrate (or brine) behind. The brine is safely returned to the ocean via an outfall through a diffuser structure. The filtered water (i.e post SWRO) is called permeate and is similar to distilled water. Permeate is then re-mineralised so it can be blended with other treated water or directly distributed to homes, businesses, and industries in the region.

The amount of filtered water can be determined from recovery ratio (RR) using equation as follow:

$$Q_p = Q_d * (RR)$$

$$Q_b = Q_d * (1 - RR)$$

Whereby  $Q_p$  is volume of permeate produced ( $m^3/day$ ),  $Q_b$  is volume of brine produced ( $m^3/day$ ), and  $Q_d$  is desalination plant treatment capacity ( $m^3/day$ ). RR is typically between 0.3 to 0.55 for seawater desalination<sup>57</sup>.

The membrane used for reverse osmosis requires backwash and chemical cleaning to maintain the process efficiency. Backwash and membrane cleaning water, containing low levels of spent detergent and produced in very small quantities (0.1% or less by volume) compared to concentrate flows, is produced when the membranes are cleaned. Both backwash water and membrane cleaning water are typically treated to remove solids or other contaminants prior to being added to the desalination concentrate for discharge.

The typically energy requirement for reverse process describe is about 9-12 kWh/ $m^3$  feed water. In a multi-pass reverse osmosis process, energy savings can be achieved by reusing the high-pressured brine in the subsequent reverse osmosis step to drive desalination process. As such the energy requirement can be lowered to 2.5-5 kWh/ $m^3$  feed water<sup>58</sup>. However, the energy recovery option has not been included in the CAPEX estimate.

### 7.1.3 Recent trends

Two basic technologies have been widely used to separate salts from ocean water: thermal evaporation and membrane separation.

In the past decade, desalination using semi-permeable seawater reverse osmosis (SWRO) membranes has come to dominate desalination markets because of its advantages of high efficiency, simple equipment, and convenient maintenance.

<sup>57</sup> Metcalf and Eddy 5<sup>th</sup> Edition Table 11-30

Developments in SWRO desalination technology during the past two decades, combined with a transition to large capacity plants, co-location with power plant generation and enhanced competition from the Build-Own-Operate-Transfer (BOOT) method of project delivery, have resulted in a dramatic decrease of the cost of desalinated water.

One of the key factors that contributed to the decreased cost of seawater desalination is the advancement of the SWRO membrane technology. High-productivity membrane elements are designed with features to yield more fresh water per membrane element: a higher surface area and denser membrane packing. Increasing active membrane surface area allows for significant productivity gains using the same diameter membrane element.

No major technology breakthroughs are expected to dramatically lower cost of seawater desalination in the near future. But the steady reduction of production costs, coupled with increasing costs of water treatment driven by more stringent regulatory requirements, are expected to accelerate the current trend of increased reliance on the ocean as a water source. This will further establish ocean water desalination as a reliable, drought-proof alternative for many coastal communities worldwide.

#### 7.1.4 Selected hypothetical project

The selected hypothetical project is a large-scale desalination plant in Australia with design capacity of 100,000 ML/year and located less than 2 km away from feed source with a recovery ratio of 0.4.

#### 7.1.5 Cost estimate

The following table provides the cost parameters for the hypothetical full-scale desalination plant project.

**Table 7-1: Cost estimate for full-scale desalination for 100,000 ML/year plant to produce potable water**

Parameter	Unit	Value	Comment
<b>CAPEX</b>			
CAPEX	\$M	2,200	22,000 \$ / (ML/year seawater) based on Australia Water Association – Desalination Fact Sheets – Summary of Australian Desalination plants <sup>59</sup> The cost has been standardised to 2021 value using Australian Reserve Bank inflation rate. Energy recovery option has not been included in the CAPEX.
CAPEX breakdown			Reference: McGivney and Kawamura (2008) Cost Estimating Manual for Water Treatment Facilities – Reverse Osmosis Treatment Plant Figure 5.8.1
■ Development cost	%	20	
■ Construction cost	%	80	
CAPEX Construction Cost Breakdown (% of construction cost) <sup>60</sup>			
■ Intake and brine discharge structure	%	30	
■ Pre-treatment	%	15	
■ Reverse Osmosis Plant	%	25	
■ Post-treatment (remineralisation)	%	2	

<sup>59</sup> [http://www.awa.asn.au/AWA\\_MBRR/Publications/Fact\\_Sheets/Desalination\\_Fact\\_Sheet.aspx](http://www.awa.asn.au/AWA_MBRR/Publications/Fact_Sheets/Desalination_Fact_Sheet.aspx)

<sup>60</sup> <https://www.advisian.com/en/global-perspectives/the-cost-of-desalination>

Parameter	Unit	Value	Comment
■ Product storage and distribution	%	10	
■ Electrical and instrumentation	%	8	
■ Civil/site and permits	%	10	
<b>OPEX - Annual</b>			
Power	\$M	17	In-house Aurecon database, 350-500 \$ / ML permeate produced, averaged value is used to determine the cost. Not including energy recovery. Cost could be 20-50% lower if energy recovery is implemented. Energy recovery option has not been included in the OPEX.
Chemical	\$M	6	In-house Aurecon database, 100-200 \$ / ML permeate produced, averaged value is used to determine the cost.
Labour	\$M	6	In-house Aurecon database, 100-200 \$ / ML permeate produced, averaged value is used to determine the cost.
Operation and maintenance	\$M	10	In-house Aurecon database. 200 - 300\$ / ML permeate produced, averaged value is used to determine the cost. Average value, including replacement and maintenance of equipment and membranes

Note that the type of intake and outfall selected for a desalination plant is one of the most important technical considerations for a plant's cost-efficient design and optimum operation. Important factors need to be evaluated such as the most suitable intake type (submerged vs. open intake), the distance of the intake relative to the plant, the type of intake screens, the type of intake structure, the type of intake pipeline (buried vs. above ground), and environmental considerations with regards to impingement and entrainment of marine life. Each of these items has a significant cost impact. To illustrate the potential significance of intake and discharge structure costs, SWRO plant discharges located close to marine habitats that are highly sensitive to elevated salinity require elaborate concentrate discharge diffuser systems, with costs that can exceed 30% of the CAPEX<sup>61</sup>. In contrast, the desalination plants with the lowest water production costs have concentrate discharges either located in coastal areas with very high natural mixing or are combined with power plant outfall structures, allowing good initial mixing and better discharge plume dissipation. The intake and discharge facility costs for these plants can be less than 10 % of the CAPEX<sup>62</sup>.

## 7.2 Water Treatment (demineralisation) for Hydrogen Production

### 7.2.1 Overview

Demineralisation is a water purification process to remove salt and mineral from feedwater to produce highly purified water.

### 7.2.2 Processing technology

The water demineralisation process proposed for different water sources is presented in Table 7-2.

<sup>61</sup> The cost of desalination <https://www.advisian.com/en/global-perspectives/the-cost-of-desalination>

<sup>62</sup> The cost of desalination <https://www.advisian.com/en/global-perspectives/the-cost-of-desalination>

**Table 7-2: Demineralisation process for different water source**

Water source	Treatment process to achieve the demineralised quality
Seawater	Ultrafiltration + reverse osmosis with energy recovery+ ion exchange (See section 7.1.2for details)
Surface water, dam, river water	Clarification +ultrafiltration, reverse osmosis+ ion exchange
Recycled water (municipal) - assuming secondary effluent after BNR	Ultrafiltration, reverse osmosis, ion exchange
Underground/ borewater	Low salinity - Ultrafiltration, ion exchange
	High salinity - Ultrafiltration, reverse osmosis, ion exchange
Potable water	Reverse osmosis + Ion exchange

### 7.2.3 Selected hypothetical project

The selected hypothetical project is a demineralised plant (or water treatment plant) to produce highly purified water for a 10 MW electrolyser plant using potable water. Relevant process parameter is presented in Table 7-3. Water balance around the demineralised plant is determined using a recovery ratio (RR) similar to a desalination plant as discussed in Section 7.1.2. Typical RR is around 86% with potable water as feedwater. RR would vary with different feedwater source, depending on the water quality.

A major wastewater source for this type of plant is brine. Wastewater from membrane backwash and cleaning will also be produced but the volume is minimal when compared to brine production.

**Table 7-3: Process parameter of a demineralised plant for a 10 MW electrolyser plant using potable water.**

Item	Unit	Value	Comment
Demineralised water requirement	m <sup>3</sup> /d	60.0	In-house Aurecon database
Potable water requirement	m <sup>3</sup> /d	69.5	In-house Aurecon database
Brine production	m <sup>3</sup> /d	9.5	In-house Aurecon database.
Power consumption	MWh/day	1.36	In-house Aurecon database, 20-30 kWh/m <sup>3</sup> feed water, averaged value is used to determine cost
Recovery ratio	%	86	In-house Aurecon database

### 7.2.4 Cost estimate

The following table provides the cost parameters the demineralised plant (or water treatment plant) to produce highly purified water for a 10 MW electrolyser plant using potable water.

**Table 7-4: Water treatment plant cost estimate (10 MW electrolyser plant)**

Item	Unit	Value	Comment
<b>CAPEX</b>			
CAPEX	\$M	1.2	In-house Aurecon database.
CAPEX breakdown			
■ Development cost (including equipment)	%	10	
■ Construction cost	%	90	
<b>OPEX - Annual</b>			
Power	\$	2,000-5,000	In-house Aurecon database
Chemical	\$	1,000-2,500	In-house Aurecon database
Labour	\$	18,000	In-house Aurecon database, system is fully automated.
Operation and maintenance	\$	15,000 -25,000	In-house Aurecon database. Average value, including replacement and maintenance of equipment and membranes

# 8 Battery Energy Storage System (BESS)

A battery energy storage system (BESS) stores electricity from the network or collocated generation plant, for use as needed at a later point. This section details three BESS types that are relevant to the Australian energy market – large-scale lithium ion battery storage, residential battery storage and large-scale Vanadium redox-flow battery storage.

## 8.1 Large-Scale Lithium-Ion Battery Storage

### 8.1.1 Overview

Large-scale lithium-ion battery systems (Li-ion BESS) convert alternating current power to a low voltage and then convert the power to direct current source through four-quadrant inverters which is stored in the batteries. The power can be regenerated back from the batteries to the high voltage AC network through the reverse path.

A large-scale Li-ion BESS contains several primary components, including the battery system (with cells assembled into modules and racks), battery management system, bi-directional inverters, step-up transformer(s), plant control and monitoring system, HVAC / thermal management systems, and other balance of plant.

Approximately 10 to 20% of the energy supplied to the batteries during the charge operation is lost and not available when the battery discharges. These losses are mainly due to the BESS HVAC load and referred to as the round-trip efficiency losses.

### 8.1.2 Typical options

A large-scale Li-ion BESS can be used for a wide range of network services, including energy market participation, load shifting, a range of market and non-market ancillary services (in particular FCAS services), and cost mitigation to avoid or reduce network upgrades, demand charges, fuel costs, and the FCAS 'causer pays' exposure of intermittent wind and solar generators. A BESS can also be used to protect NEM interconnectors or increase transfer flows, with for example the Hornsdale Power Reserve and Dalrymple BESS systems participating in the Special Integrated Protection Scheme (SIPS) of the SA-VIC Heywood interconnector, and the Victorian Big Battery contracted to provide a SIPS service for the VNI interconnector. The modular nature of a BESS enables it to be sized in both power and energy to meet highly specific project requirements.

Batteries used for bulk energy shifting and arbitrage typically have greater than one hour of energy storage, whereas, batteries used primarily for network support services or renewable integration may have less than one hour of storage.

Lithium ion has become the dominant battery technology in recent years, primarily due to falling costs, developments in the range of cell chemistries for different applications, high power and energy density (small physical size), and high efficiency. Within the lithium ion battery class are a number of sub-categories of cell chemistries. Each of these has different performance, life, and cost characteristics which may be used for different purposes.

BESS units have a range of packaging approaches, including separate or combined battery and inverter enclosures, stand-alone buildings, or outdoor modular cabinet type arrangements.

### 8.1.3 Recent trends

There are currently seven large-scale Li-ion BESS operating within Australia, with the largest being the 150 MW / 194 MWh Hornsdale Power Reserve system in South Australia. These systems are connected to the National Electricity Grid (NEG) with the exception of two smaller batteries located within mine site micro-grids in Western Australia.

A further seven large-scale BESS are currently under construction, ranging in size from the 10 MW / 10 MWh Lincoln Gap battery to the 300 MW / 450 MWh Victoria Big Battery, and many more are in the development pipeline<sup>63</sup>.

Although the current fleet of operating large-scale batteries incorporate an average of 1.2 hours of energy storage (weighted to account for battery power rating), average storage capacity is expected to increase towards 2 hours in the coming years and will include systems with up to 4 hours of storage. This is consistent with expectations associated with falling battery prices.

The large-scale BESS development pipeline also demonstrates an increase in planned battery power capacity, with capacities larger than 100 MW becoming common<sup>64</sup>. Further, based on the AEMO 2020 Integrated System Plan (ISP) and other states specific projects such as the AEMO 2020 Victorian Government SIPS, the size of large BESS installation is likely to increase over the next few years, with projects possibly designed to provide energy storage in excess of 200-300 MW for 2 to 4 hours, to support both NEM system stability and energy market participation.

Battery energy storage systems have been installed by a range of companies, including generators, transmission and distribution operators, renewable energy developers and C&I customers (particularly in the mining industry). Many are being installed next to existing or proposed wind and solar farms, providing opportunities for load shifting of intermittent renewable energy resources and management of constraints. Given the flexibility of operating regimes and modularity of systems, battery systems are being adopted to serve a wide range of challenges and customer bases.

Due to restrictions placed on generators in South Australia by the Office of the Technical Regulator, many generators are increasingly looking to install battery systems with their generation to meet Fast Frequency Response (FFR) requirements.

The large-scale BESS flexibility in controlling the power supply, with their four quadrant inverters, provides a range of capabilities that have not been deployed in large numbers in the NEM, but that have been proven as reliable in other systems. These features include synthetic inertia and Static Synchronous Compensator (STATCOM) type services which tie in with 'grid-forming' capabilities. Grid-forming inverters are able to operate independently from synchronous generation and provide a greater role in supporting grid stability. AEMO has recognised the enormous potential of grid-forming inverters in supporting the energy transition and is looking at ways to encourage uptake of these technologies in the large-scale BESS fleet<sup>65</sup>.

Recent BESS installations on the NEM and those expected to be constructed in 2021 include:

- Agnew Gold Mine (WA) – 13 MW / 4 MWh (constructed)
- Lincoln Gap (SA) – 10 MW / 10 MWh
- Victorian Big Battery (Vic) – 300 MW / 450 MWh
- Bulgana (Vic) – 20 MW / 34 MWh
- Wallgrove (NSW) – 50 MW / 75 MWh
- Wandoan South (Qld) – 100 MW / 150 MWh

Most new BESS development currently require the support of funding or similar support mechanisms to achieve a financially viable project. This is expected to fall away in the near to medium term future with reducing large scale BESS costs and evolving energy market price profiles as synchronous generation retires and the transition to higher penetration of renewables proceeds.

Proponents of large-scale renewable plants (i.e. solar and wind farms) are also increasingly interested in large BESS integration / co-location at the same grid connection point (e.g. Lake Bonney Wind Farm). For these collocated installations the BESS is typically connected at the MV bus (i.e. 33 kV) and shares the same step-up transformer to grid voltage. There are also some development synergies associated with GPS studies and development approvals to develop BESS projects in parallel with VRE projects.

<sup>63</sup> <https://reneweconomy.com.au/big-battery-storage-map-of-australia/>

<sup>64</sup> <https://reneweconomy.com.au/big-battery-storage-map-of-australia/>

<sup>65</sup> "Application of Advanced Grid-scale Inverters in the NEM", AEMO, August 2021



## 8.1.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM, given the above discussion on typical options and current trends.

Table 8-1: BESS configuration and performance

Item	Unit	1 hour	2 hours	4 hours	8 hours	Comment
<b>Configuration</b>						
Technology		Li-ion				
<b>Performance</b>						
Power Capacity (gross)	MW	100				
Energy Capacity	MWh	100	200	400	800	
Auxiliary power consumption (operating)	kW	1,190	1,620	2,510	4,290	Indicative figures (highly variable, dependent on BESS arrangement, cooling systems etc.).
Auxiliary power consumption (standby)	kW	500	940	1,830	3,610	Based on Aurecon internal database of similarly sized projects, Indicative figures (highly dependent on BESS arrangement, cooling systems etc.).
Power Capacity (Net)	MW	98.8	98.3	97.5	95.7	
Seasonal Rating – Summer (Net)	MW	98.8	98.3	97.5	95.7	Dependent on inverter supplier. Potentially no de-rate, or up to approx. 4% at 35°C.
Seasonal Rating – Not Summer (Net)	MW	98.8	98.3	97.5	95.7	
<b>Annual Performance</b>						
Average Planned Maintenance	Days / yr.	-				Included in EFOR.
Equivalent forced outage rate	%	1.5 - 3				Dependent on level of long-term service agreement, retention of strategic spares etc.
Annual number of cycles		365				Typical default assumption is one cycle per day, however this is highly dependent on functional requirements and operating strategy.
Annual degradation over design life	%	1.8				Indicative average annual degradation figure provided for 20-year BESS, assuming LFP battery chemistry. Significant range dependent battery supplier, or approx. 58 – 70% energy retention after 20 years (based on one cycle per day). Degradation dependent on factors such as energy throughput, charge / discharge rates, depth of discharge, and resting state of charge.

Table 8-2: Technical parameters and project timeline

Item	Unit	1 hour	2 hours	4 hours	8 hours	Comment
<b>Technical parameters</b>						
Ramp Up Rate	MW/min	10,000+				0 to 100% rated MW capacity within less than a second (150ms typical however for specific applications higher performance is available).
Ramp Down Rate	MW/min	10,000+				As above.

Item	Unit	1 hour	2 hours	4 hours	8 hours	Comment
Round trip efficiency	%	84	84	85	83	Round trip efficiency, at the point of connection (including auxiliaries), for a full cycle of charge and discharge
■ Charge efficiency	%	92	92	92.5	91.5	Assumed to be half of the round-trip efficiency.
■ Discharge efficiency	%	92	92	92.5	91.5	Assumed to be half of the round-trip efficiency.
Allowable maximum state of charge (SOC)	%	100				Performance and costs presented relate to the useable BESS energy storage capacity / state of charge (SOC), with operation permissible throughout this full range. Some battery OEMs quote battery capacity inclusive of unusable capacity. For these OEMs a max and min SOC of 90% and 10% respectively could be expected. It is not however necessary to apply these adjustments to the performance and cost figures presented in this report.
Allowable minimum state of charge (SOC)	%	0				As above.
Maximum number of cycles		7,300				Typical warranty conditions based on one cycle per day for 20 years for LFP batteries. Warranties to cover a 20-year battery life may incur additional cost, as indicated herein. Design life for lithium-ion deployed on large scale BESS projects varies from approx. 3,650 to 7,300 depending of the application and lithium-ion battery chemistry.
Depth of Discharge	%	100				100% in terms of typically defined 'useable state of charge.'
<b>Project timeline</b>						
Time for development	Years	1-2				
Total EPC Programme	Years	1.0	1.2	1.4	1.6	For NTP to COD.
■ Total lead time	Years	0.8	1	1.2	1.4	
■ Construction time	Weeks	8	8	12	20	Significantly dependent on BESS arrangement.
Economic Life (Design Life)	Years	20				Dependent on battery chemistry. 20 years available at one cycle per day with LFP batteries, which are of increasing prominence in large scale BESS proposals. Warranties to cover a 20-year battery life may incur additional cost, as indicated herein.
Technical Life (Operational Life)	Years	20				Extended project life with battery upgrades.

### 8.1.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 8-3: Cost estimates

Item	Unit	1 hour	2 hours	4 hours	8 hours	Comment
<b>CAPEX – EPC cost for 100 MW BESS (with dedicated grid connection)</b>						
Relative cost - Power component	\$ / kW	370	370	370	370	Indicative cost for power related components

Item	Unit	1 hour	2 hours	4 hours	8 hours	Comment
Relative cost - Energy component	\$ / kWh	326	287	287	287	Indicative cost for energy related components
Total EPC cost	\$M	69.6	94.5	151.9	266.8	Based on Aurecon internal database of similarly sized projects and scaled for additional energy storage capacity.
■ Equipment cost	\$M	57.8	78.4	126.1	221.4	As above.
■ Installation cost	\$M	11.8	16.1	25.8	45.4	As above.
<b>CAPEX – EPC cost for 100 MW BESS (co-located with large renewable installation)</b>						
Relative cost - Power component	\$ / kW	300	300	300	300	Indicative cost for power related components
Relative cost - Energy component	\$ / kWh	326	287	287	287	Indicative cost for energy related components
Total EPC cost	\$M	62.6	87.5	144.9	259.8	Based on an assumed \$7,000,000 savings in transformer and associated grid voltage equipment (i.e. cost worn by co-located project)
■ Equipment cost	\$M	51.9	72.6	120.3	215.6	As above.
■ Installation cost	\$M	10.7	14.9	24.6	44.2	As above.
<b>Other costs</b>						
Cost of land and development	\$	7,000,000				
<b>OPEX – Annual</b>						
Fixed O&M Cost	\$/MW (Net)	2,790	4,060	5,630	9,160	Provided on \$/MW basis for input into GenCost template only.
Variable O&M Cost	\$/MWh (Net)	-	-	-	-	BESS long term service agreements not typically based on fixed / variable.
Total annual O&M Cost (excluding extended warranties)	\$	279,000	406,000	563,000	916,000	Highly variable between OEMs. Annual average cost over the design life Does not include battery replacement cost at end of Economic Life (Design Life)
Extended warranty (20-year battery life)	\$/MW (Net)	2,980	5,870	10,230	17,240	Indicative annual average cost for 20-year extended warranties for LFP batteries
Total annual O&M Cost (including extended warranties)	\$	298,000	587,000	1,023,000	1,724,000	Highly variable between OEMs. Annual average cost over the design life

## 8.2 Residential Battery Storage

### 8.2.1 Overview

Residential battery energy storage systems (RBESS) form a rapidly growing market segment in Australia. There are a range of system architectures available, most of which utilise Lithium-ion technologies. The industry is immature and this is manifest through quality problems across many products and volatility among market players. However, this is likely to normalise in the coming years.

Price reductions in Li-ion batteries are expected to continue to drive uptake of the technologies which are used by consumers for a range of services but primarily to obtain better value from rooftop PV energy yield.

As battery systems become more common in Australia, effects on energy flows on the grid will become more pronounced and there will be greater potential to aggregate energy storage to perform services similar to large-scale BESS. Aggregators are emerging, with the role of operating distributed residential battery systems under a Virtual Power Plant (VPP) regime. Virtual power plants may challenge grid-scale batteries in some markets. However, these have differing economics and technical capability when compared to larger systems.

## 8.2.2 Typical options

As with large-scale BESS, residential battery storage is dominated by Lithium-ion technologies, with Lithium Iron Phosphate (LFP) and Lithium Nickel Manganese Cobalt Oxide (NMC) being the most common battery chemistries. Energy consumers use home batteries to provide several key services including storage of excess solar energy generation, arbitrage, contingency FCAS (with VPP aggregated systems) and back-up during grid power outages. The back-up may include all home circuits or selected essential circuits only, with the former entailing a larger storage capacity. RBESS systems also have potential to provide distribution network support services such as load flow and voltage constraint management, particularly if aggregated through a VPP.

RBESS may be coupled with the DC circuit associated with a rooftop solar installation or the AC electrical system of a household. Depending on how the system is positioned electrically, integrated home battery systems may consist of one or more battery cells connected in series, charge controllers and/or 'two-way' inverters (which also rectify AC current to DC, when coupled with the AC circuit). They may also include smart system controllers to enable various services such as arbitrage and power back-up, often with an interactive user interface. However, many RBESS products are designed to be paired with a suitable solar inverter to provide more sophisticated functionality.

Battery capacities for RBESS of 2-13 kW are typical, with around 4 kW being common. The systems often integrate up to 2 hours of storage but this also varies considerably. There are a large number of RBESS manufacturers who offer significantly different products in terms of the system components, services provided and quality. This is reflected in the variation of prices of RBESS on a per kWh basis.

## 8.2.3 Recent trends

The Clean Energy Council estimates that 23,796 batteries with a combined energy capacity of 238 MWh were installed in Australia in 2020, with a similar number installed the previous year<sup>66</sup>. These installations were generally tied with new rooftop solar PV systems. As approximately 15% of Australian households have rooftop PV systems, there is large scope for the retrofitting of solar-tied battery systems as the price of batteries falls. Several states including South Australia, Victoria and ACT are offering rebates which were seen to drive battery uptake over the last year.

The RBESS market is still relatively immature. An independent testing facility performing accelerated testing on battery products has highlighted the large variation in product quality<sup>67</sup>. Faults, failures and underperformance were common across many products, generally attributed to poor product development and/or poor integration with external system components. Perhaps in response to these problems, a more recent trend is evident towards integrated battery systems or compatible battery-inverter systems from the same manufacturer, to avoid interfacing issues. The study has also found a large variation in capacity degradation rates across the products tested, while system efficiency was less variable.

Although Li-ion battery production has been subject to bottlenecks which have stymied price reductions at times, the increasing use of Li-ion batteries across various markets including electronics, electric vehicles, large-scale storage and residential storage is expected to continue to drive down prices. This will result in further uptake of RBESS in Australia as payback periods become more financially attractive to consumers.

<sup>66</sup> <https://www.cleanenergycouncil.org.au/resources/technologies/energy-storage>

<sup>67</sup> Public Report 10 – Lithium-ion Battery Testing, ITP Renewables, March 2021

## 8.2.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM, given the above discussion on typical options and current trends.

Table 8-4: RBESS configuration and performance

Item	Unit	2 hours	Comment
<b>Configuration</b>			
Technology		Li-ion	
<b>Performance</b>			
Power Capacity (gross)	kW	5	
Energy Capacity	kWh	10	
Auxiliary power consumption (operating)	W	50	Indicative figures (variable dependent on system components and services performed).
Power Capacity (Net)	kW	4.95	
Seasonal Rating – Summer (Net)	kW	4.95	Dependent on inverter supplier. Potentially no de-rate, or up to approx. 4% at 35°C.
Seasonal Rating – Not Summer (Net)	kW	4.95	
<b>Annual Performance</b>			
Equivalent forced outage rate	%	4.3	This will be highly variable depending on the quality and serving arrangements for a particular RBESS system, noting that product faults are common. A range of 1 day to 1 month may be reasonable, giving an outage rate of 0.3% to 8.3%. The midpoint of this range has been considered but this should be reviewed as further data becomes available.
Annual number of cycles		365	Typical default assumption is one cycle per day, however this is highly dependent on functional requirements and operating strategy.
Annual degradation over design life	%	1.8	Indicative average annual degradation figure provided for 10-year RBESS, assuming LFP battery chemistry. Significant range dependent battery supplier, or approx. 79 – 85% energy retention after 10 years (based on one cycle per day). Degradation dependent on factors such as energy throughput, charge / discharge rates, depth of discharge, and resting state of charge.

Table 8-5: RBESS technical parameters and project timeline

Item	Unit	2 hours	Comment
<b>Technical parameters</b>			
Ramp Up Rate	kW/min	10,000+	0 to 100% rated kW capacity within approx. 250 ms typical for frequency response, within approx. 1 s typical for response to external commands.
Ramp Down Rate	kW/min	10,000+	As above
Round trip efficiency	%	90	Energy retention, at the point of connection (including auxiliaries), for a full cycle of charge and discharge. Range of 85-90% noted in RBESS battery testing study <sup>68</sup> .
■ Charge efficiency	%	95	Assumed to be half of the round-trip efficiency.
■ Discharge efficiency	%	95	Assumed to be half of the round-trip efficiency.
Allowable maximum state of charge (SOC)	%	100	Performance and costs presented relate to the useable RBESS energy storage capacity / state of charge (SOC), with operation permissible throughout this full range.

<sup>68</sup> Public Report 10 – Lithium-ion Battery Testing, ITP Renewables, March 2021

Item	Unit	2 hours	Comment
Allowable minimum state of charge (SOC)	%	0	As above.
Maximum number of cycles		3,653	Typical warranty conditions based on one cycle per day for 10 years for a RBESS.
Depth of Discharge	%	100	100% in terms of typically defined 'useable state of charge.'
Project timeline			
Time for development ordering, installation	Days	90	Pragmatic assumption.
Economic Life (Design Life)	Years	10	10 years is a typical warranted period for RBESS.
Technical Life (Operational Life)	Years	10	Given the volatility of the RBESS market and observed problems with product quality, it is reasonable to assume that many RBESS products will not reach or operate beyond their warranted period.

## 8.2.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 8-6: Cost estimates

Item	Unit	2 hours	Comment
Installation costs for 5 kW RBESS (AC-coupled, not including new PV inverter)			
Relative cost - Power component	\$ / kW	-	Correlation based on power and energy storage ratings do not follow readily identifiable patterns due to the wide range of products
Relative cost - Energy component	\$ / kWh	-	As above
Total cost	\$	13,000	
■ Equipment cost	\$	10,700	As above.
■ Installation cost	\$	2,300	As above.
Other costs			
Operational costs	\$	-	Maintenance costs due to faults or component failures should be covered under the product warranty.

## 8.3 Large-Scale Vanadium-Redox Flow Battery Storage

### 8.3.1 Overview

Large-scale vanadium-redox flow batteries have the potential to complement lithium-ion and other storage technologies in medium duration energy storage applications. The technical characteristics of flow batteries make them a potential option for services that require relatively large energy storage to power ratios (4-12-hour durations), such as solar farm energy yield shifting. Like other types of battery storage, flow batteries are highly modular and scalable and may perform a range of services in a particular setting.

Although large-scale flow batteries are still considered immature compared to their lithium-ion counterparts, the technology is making an entrance to the NEM and has potential to become part of the storage mix over the coming decades.

## 8.3.2 Typical options

Flow batteries are similar to conventional electrochemical batteries in the function that they perform, however they differ in how their energy is stored. While energy is stored as the electrode material in conventional batteries, flow batteries store energy in two separate electrolytes that are stored in tanks. The electrolyte is pumped through a reaction stack of electrochemical cells (the battery cell “stack”), in which charge and discharge reactions take place at electrode surfaces.

There are a range of different types of flow battery, which can be categorised in several ways based on variations in chemistry and operating principle. Vanadium redox batteries fall within the ‘pure flow’ category. In pure flow batteries, all electroactive materials are fully dissolved within the electrolyte and do not come out of the solution on the electrodes within the stack. The key implication of this is that it allows the battery’s energy storage capacity to be fully decoupled from the power rating of the battery. In these batteries, the energy storage capacity is determined only by the electrolyte volume. The stack does not introduce any limitations on the effective energy storage capacity. As a result, the battery system’s specifications can be tuned to meet the user’s specific needs.

Flow batteries perform reasonably well in many areas, however have relatively poor performance across some metrics such as round-trip efficiency and standby power consumption if held in active fast response modes. Flow batteries are typically suited to applications requiring a duration of at least 4 hours, but preferably longer, up to approximately 12 hours. The AEMO report ‘Building power system resilience with pumped hydro energy storage’ published in July 2019, has identified that energy storage developments with 6-8 hours storage potential are the most valuable in providing intra-day and day-ahead energy shifting, complementing generation from utility-scale solar and rooftop PV systems. This supports the potential of flow batteries for such applications.

Other potential uses of flow batteries include integration with solar Renewable Energy Zones (REZs) to improve utilisation of transmission infrastructure, long duration storage in isolated power grids and curtailment management at existing power plants. There are also opportunities for flow batteries to form hybrid storage systems with lithium ion batteries for certain applications that require long duration, low-power energy shifting combined with short duration power peaks.

## 8.3.3 Recent trends

Vanadium Redox is the leading flow battery technology in terms of technical and commercial readiness, followed by Zinc-bromine. There are several companies developing Vanadium Redox batteries, with CellCube and Sumitomo Electric considered to be the leading manufacturers globally<sup>69</sup>.

The first large-scale flow battery is currently being constructed in South Australia, developed by Invinity. The Yadlamalka Energy project consists of a 2 MW / 8 MWh vanadium redox flow battery and is co-located to a 6 MW solar farm. The project was partly funded by ARENA and will act as a test-case for the technology in an Australian context. The largest operational vanadium redox battery system is a 15 MW / 60 MWh system in Hokkaido, Japan.

Although large-scale flow batteries have a higher capital cost than lithium-ion batteries, they have a longer effective lifetime (20-25 years compared to 10-20 years for lithium-ion) due to the higher depth of discharge and low capacity degradation rate. Upgrades to the reaction stack are however required mid-life to achieve this project life. Many of the services provided by large-scale batteries to the NEM to date have been high-power, low storage duration applications which has favoured lithium-ion technology, however there is expected to be an increasing role for longer duration storage in future.

There is potential for uptake of large-scale flow batteries to increase as the suite of services provided by batteries trends towards larger energy capacities, and as flow batteries mature as a technology. The longer lifetime of flow batteries also more closely aligns with the typical lifetimes of large-scale wind and solar projects which may make them an attractive proposition for development in conjunction with these projects, from a financing perspective.

<sup>69</sup> Guidehouse Insights Leaderboard: Flow Battery Vendors, 2019

### 8.3.4 Selected hypothetical project

The following tables outline the technical parameters for the hypothetical project. The hypothetical project has been selected based on what is envisaged as a plausible project for installation in the NEM, given the above discussion on typical options and current trends.

Table 8-7: Vanadium-redox BESS configuration and performance

Item	Unit	4 hours	8 hours	Comment
<b>Configuration</b>				
Technology		Vanadium-redox flow		
<b>Performance</b>				
Power Capacity (gross)	MW	5		
Energy Capacity	MWh	20	40	
Auxiliary power consumption (operating)	kW	300	300	Indicative figures (highly variable, dependent on BESS arrangement, cooling systems etc.). Driven primarily by power rating rather than energy storage capacity and volume of electrolyte
Auxiliary power consumption (standby)	kW	170	170	Figure provided is indicative mid-range figure. Significant range depending on supplier, technology maturity, required standby mode and site conditions. Indicative range of 1 to 5% of power rating, with the upper end reflecting systems held in active fast response standby mode.
Power Capacity (Net)	MW	4.7	4.7	
Seasonal Rating – Summer (Net)	MW	4.7	4.7	Dependent on inverter supplier. Potentially no de-rate, or up to approx. 4% at 35°C.
Seasonal Rating – Not Summer (Net)	MW	4.7	4.7	
<b>Annual Performance</b>				
Equivalent forced outage rate	%	1.5 - 3%		Dependent on level of long-term service agreement, retention of strategic spares etc.
Annual number of cycles		365 - 730		Flow batteries have high cycling potential, with assumption presented based on 1 – 2 cycles per day without appreciable degradation impact. Actual cycling dependent on use case and economically rational cycling opportunities.
Annual degradation over design life	%	0.5		Indicative average annual degradation figure.

Table 8-8: Vanadium-redox BESS technical parameters and project timeline

Item	Unit	4 hours	8 hours	Comment
<b>Technical parameters</b>				
Ramp Up Rate	MW/min	10,000+		0 to 100% rated MW capacity within less than a second if held in active standby mode with pumps running (150 ms typical, dependent inverter response times)
Ramp Down Rate	MW/min	10,000+		As above.
Round trip efficiency	%	62	62	Indicative round trip efficiency, at the point of connection (including auxiliaries), for a full cycle of charge and discharge. Significant range dependent battery product. Variability between suppliers expected.
■ Charge efficiency	%	81	81	Assumed to be half of the round-trip efficiency.



Item	Unit	4 hours	8 hours	Comment
■ Discharge efficiency	%	81	81	Assumed to be half of the round-trip efficiency.
Allowable maximum state of charge (SOC)	%	100		Vanadium-redox batteries can be fully discharged.
Allowable minimum state of charge (SOC)	%	0		As above.
Maximum number of cycles		9,000-18,000		Represents 1-2 cycles over a 25 year period; dependent on battery product.
Depth of Discharge	%	100		Vanadium-redox batteries can be fully discharged.
<b>Project timeline</b>				
Time for development	Years	1-2		
Total EPC Programme	Years	1	1	For NTP to COD.
■ Total lead time	Years	0.8	0.8	
■ Construction time	Weeks	12	12	Significantly dependent on BESS arrangement.
Economic Life (Design Life)	Years	25		20 to 25-year warranted lifetime is reasonable for vanadium-redox flow batteries, with the battery stack typically needing replacement at approximately 10 years. The electrolyte may be useable in future projects or sold on the wholesale market at end of project life.
Technical Life (Operational Life)	Years	25		Technical life may potentially be extended beyond economic life with appropriate maintenance and/or equipment refurbishment.

### 8.3.5 Cost estimate

The following table provides the cost parameters for the hypothetical project as outlined above.

Table 8-9: Cost estimates

Item	Unit	4 hours	8 hours	Comment
<b>CAPEX – EPC cost for 5 MW BESS (with dedicated grid connection)</b>				
Relative cost - Power component	\$ / kW	2,855	2,855	Indicative cost for power related components
Relative cost - Energy component	\$ / kWh	372	372	Indicative cost for energy related components
Total EPC cost	\$M	21.7	29.1	Based on an assumed \$330,000 savings in transformer and associated grid voltage equipment (i.e. cost worn by co-located project)
■ Equipment cost	\$M	18.9	25.3	As above.
■ Installation cost	\$M	2.8	3.8	As above.
<b>CAPEX – EPC cost for 5 MW BESS (co-located with renewable installation)</b>				
Relative cost - Power component	\$ / kW	2,790	2,790	Indicative cost for power related components
Relative cost - Energy component	\$ / kWh	372	372	Indicative cost for energy related components
Total EPC cost	\$M	21.4	28.8	Based on Aurecon internal database of similarly sized projects and scaled for additional energy storage capacity.
■ Equipment cost	\$M	18.6	25.1	As above.
■ Installation cost	\$M	2.8	3.7	As above.
<b>Other costs</b>				

Item	Unit	4 hours	8 hours	Comment
Cost of land and development	\$	1,000,000		
<b>OPEX – Annual</b>				
Fixed O&M Cost	\$/MW (Net)	33,500	45,200	Provided on \$/MW basis for input into GenCost template only.
Variable O&M Cost	\$/MWh (Net)	-	-	BESS long term service agreements not typically based on fixed / variable.
Total annual O&M Cost	\$	167,500	226,000	Highly variable between OEMs. Indicative average cost over the design life Does not include mid-life stack replacement

## 9 Capacity Factors for New Solar and Wind Generators

As part of this exercise, AEMO has requested a forecast of benchmark new entrant capacity factors for the following technologies:

- Solar PV - single axis tracking
- Wind - onshore
- Wind - offshore

The intention is to provide an indication of the likely future capacity factor improvements in a NEM context for long-term forecast purposes.

Capacity factors for wind and solar PV are dependent to some extent on the technology, but are more affected by the resource at the project location as well as the design of the project as a whole. Generally speaking, the capacity factor is the result of optimising the cost of energy and not significantly affected by technological advancement. Achieving notably higher capacity factors with wind turbines, and to a lesser extent Solar PV, is possible however with inefficient increases in capital cost. As the capital cost of wind farms (on a \$/MW basis) and solar PV modules continues to come down project capacity factors are likely to continue to slightly increase in the near term. In the medium to long term continued improvements in capacity factors for NEM based projects are increasingly unlikely.

For this analysis NEM based projects has been assumed in line with the hypothetical projects represented throughout this report. The projected capacity factor trends are shown in the figure below with the raw data in the subsequent table which are intended to indicate NEM fleet wide trends over time considering the range of factors as discussed above.

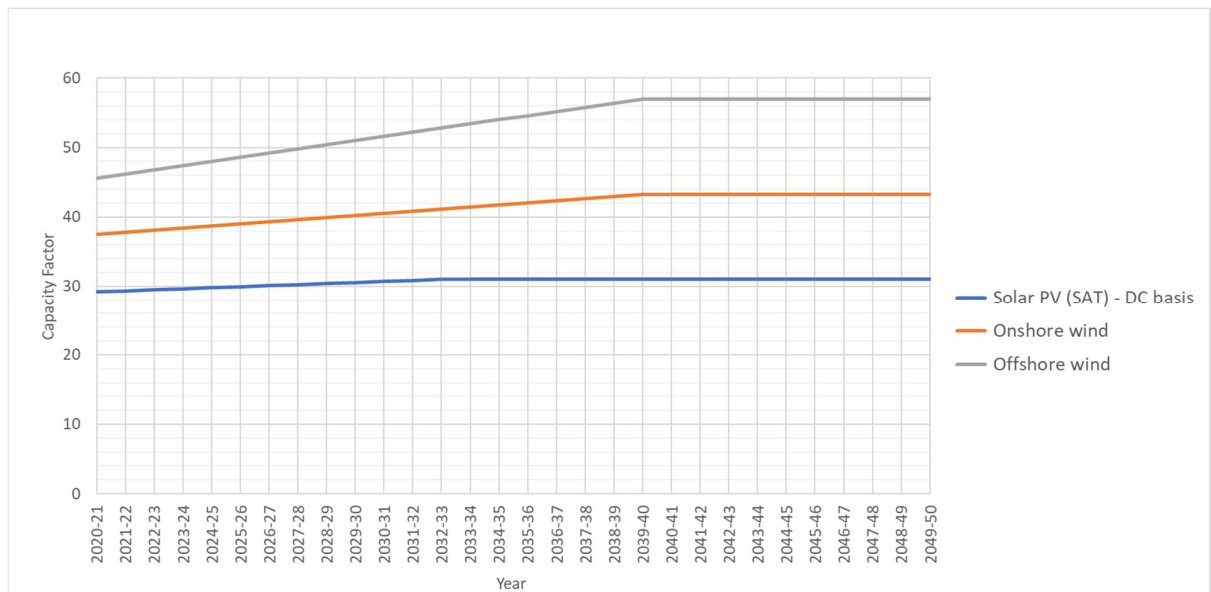


Figure 5: Capacity Factors for new solar and wind generators over time – NEM wide trend

For SAT solar PV, for a given solar resource, capacity factors can be increased by either increasing the spacing between rows of modules or by increasing the DC installed capacity. Both of these increase the equipment and land cost. The cost of modules will continue to gradually decrease, but we expect the optimum capacity factor to not change significantly. Capacity factor is also increased if sites with higher irradiance are used. The development of the grid and renewable energy zones is likely to make areas with good resource available,

however fleet-wide averages are expected to increase only marginally. Further improvements in capacity factors beyond the next 10 to 15 years may be unlikely to be commercially attractive if the rate of cost reduction of modules and other components decreases.

For wind (both onshore and offshore) project capacity factors are continually seeing improvement mainly as the result of increases in hub heights. For the purpose of this exercise continued improvements along the current long-term global weighted average trend has been assumed as reported by IRENA, 2019<sup>70</sup>. Larger rotor sizes, which roughly follow the hub height, are increasingly difficult to achieve due to design/ manufacture, construction and transport constraints as well as potential approval restrictions. This will potentially put downward pressure on capacity factors for wind, ie turbines may have relatively higher rated power compared to rotor diameter. This is presently the case with the largest available onshore turbines having rated power of 6 MW and rotor diameters of 160-170 m. This is equivalent to 130-140m for a 4 MW turbine, but the slightly older 4 MW turbines are available with rotor diameters up to 150m. Therefore, the presently available 6 MW turbines will have lower capacity factor at lower wind speed sites. It is unclear how this trend will continue. On a NEM fleet wide basis however it is anticipated that the existing low capacity factor sites will reach the end of their design life and undergo repowering. This will effectively increase the fleet average capacity factor.

For offshore wind, continued theoretical improvement along the same global weighted average trend has been assumed in the absence of any data for an Australian context. Theoretical Australian offshore resource potential has not been reviewed or examined as part of this exercise.

**Table 9-1: Capacity Factors for new solar and wind generators**

Year	Solar PV - Single axis tracking	Wind - Onshore	Wind - Offshore
2020-21	29.2	37.5	45.6
2021-22	29.3	37.8	46.2
2022-23	29.5	38.1	46.8
2023-24	29.6	38.4	47.4
2024-25	29.8	38.7	48.0
2025-26	29.9	39.0	48.6
2026-27	30.1	39.3	49.2
2027-28	30.2	39.6	49.8
2028-29	30.4	39.9	50.4
2029-30	30.5	40.2	51.0
2030-31	30.7	40.5	51.6
2031-32	30.8	40.8	52.2
2032-33	31.0	41.1	52.8
2033-34	31.0	41.4	53.4
2034-35	31.0	41.7	54.0
2035-36	31.0	42.0	54.6
2036-37	31.0	42.3	55.2
2037-38	31.0	42.6	55.8
2038-39	31.0	42.9	56.4
2039-40	31.0	43.2	57.0
2040-41	31.0	43.2	57.0
2041-42	31.0	43.2	57.0
2042-43	31.0	43.2	57.0
2043-44	31.0	43.2	57.0
2044-45	31.0	43.2	57.0

<sup>70</sup> IRENA (2019), Renewable Power Generation Costs in 2018, International Renewable Energy Agency, Abu Dhabi

Year	Solar PV - Single axis tracking	Wind - Onshore	Wind - Offshore
2045-46	31.0	43.2	57.0
2046-47	31.0	43.2	57.0
2047-48	31.0	43.2	57.0
2048-49	31.0	43.2	57.0
2049-50	31.0	43.2	57.0



**A**

**AEMO GenCost  
2021 Excel  
Spreadsheet**

# Appendix A

## AEMO GenCost 2021 Excel Spreadsheet

Spreadsheet to be provided separately

**Document prepared by**

**Aurecon Australasia Pty Ltd**

ABN 54 005 139 873

Ground Floor, 25 King Street  
Bowen Hills QLD 4006

Locked Bag 331  
Brisbane QLD 4001  
Australia

**T** +61 7 3173 8000

**F** +61 7 3173 8001

**E** [brisbane@aurecongroup.com](mailto:brisbane@aurecongroup.com)

**W** [aurecongroup.com](http://aurecongroup.com)

