


Summary: Managing safety and environmental risks on Line 21 (Tuggerah – Sydney North)

RIT-T Project Assessment Conclusions Report

Region: Newcastle and Central Coast

Date of issue: 10 December 2021

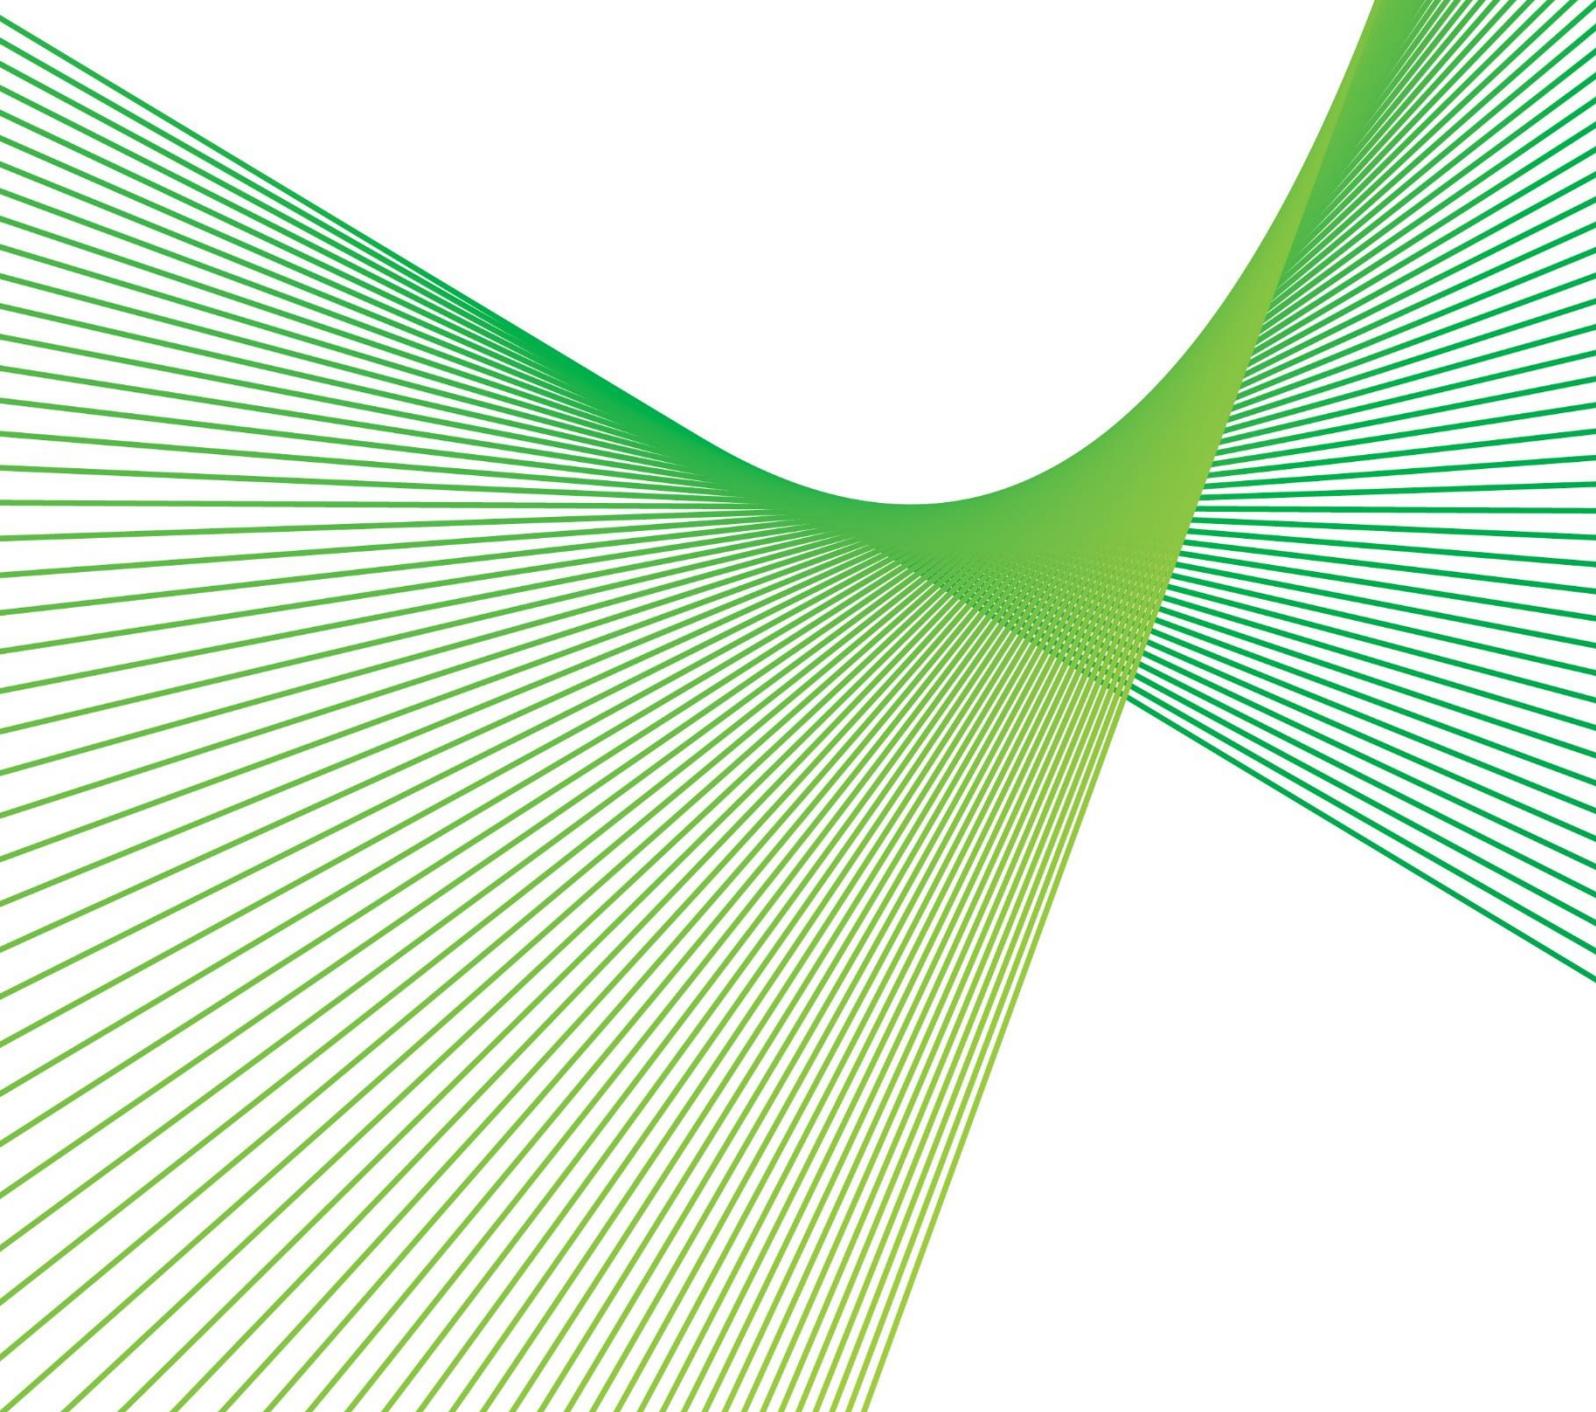

Disclaimer

This suite of documents comprises Transgrid's application of the Regulatory Investment Test for Transmission (RIT-T) which has been prepared and made available solely for information purposes. It is made available on the understanding that Transgrid and/or its employees, agents and consultants are not engaged in rendering professional advice. Nothing in these documents is a recommendation in respect of any possible investment.

The information in these documents reflect the forecasts, proposals and opinions adopted by Transgrid at the time of publication, other than where otherwise specifically stated. Those forecasts, proposals and opinions may change at any time without warning. Anyone considering information provided in these documents, at any date, should independently seek the latest forecasts, proposals and opinions.

These documents include information obtained from the Australian Energy Market Operator (AEMO) and other sources. That information has been adopted in good faith without further enquiry or verification. The information in these documents should be read in the context of the Electricity Statement of Opportunities, the Integrated System Plan published by AEMO and other relevant regulatory consultation documents. It does not purport to contain all of the information that AEMO, a prospective investor, Registered Participant or potential participant in the National Electricity Market (NEM), or any other person may require for making decisions. In preparing these documents it is not possible, nor is it intended, for Transgrid to have regard to the investment objectives, financial situation and particular needs of each person or organisation which reads or uses this document. In all cases, anyone proposing to rely on or use the information in this document should:

1. Independently verify and check the currency, accuracy, completeness, reliability and suitability of that information
2. Independently verify and check the currency, accuracy, completeness, reliability and suitability of reports relied on by Transgrid in preparing these documents
3. Obtain independent and specific advice from appropriate experts or other sources.

Accordingly, Transgrid makes no representations or warranty as to the currency, accuracy, reliability, completeness or suitability for particular purposes of the information in this suite of documents.

Persons reading or utilising this suite of RIT-T-related documents acknowledge and accept that Transgrid and/or its employees, agents and consultants have no liability for any direct, indirect, special, incidental or consequential damage (including liability to any person by reason of negligence or negligent misstatement) for any damage resulting from, arising out of or in connection with, reliance upon statements, opinions, information or matter (expressed or implied) arising out of, contained in or derived from, or for any omissions from the information in this document, except insofar as liability under any New South Wales and Commonwealth statute cannot be excluded.

Privacy notice

Transgrid is bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, TransGrid will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions.

Under the National Electricity Law, there are circumstances where Transgrid may be compelled to provide information to the Australian Energy Regulator (AER). Transgrid will advise you should this occur.

Transgrid's Privacy Policy sets out the approach to managing your personal information. In particular, it explains how you may seek to access or correct the personal information held about you, how to make a complaint about a breach of our obligations under the Privacy Act, and how Transgrid will deal with complaints. You can access the Privacy Policy here (<https://www.transgrid.com.au/Pages/Privacy.aspx>).

Summary

Transgrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for mitigating safety and environmental risks caused by the deteriorating condition of Line 21. Publication of this Project Assessment Conclusions Report (PACR) represents the final step in the RIT-T process.

Spanning a route of 65 km, Line 21 is a 330 kV transmission line that runs between Tuggerah and Sydney North substations. It was originally built in 1959 as part of a double circuit 132 kV line from Sydney North to Dora Creek, but was upgraded to single circuit 330 kV and turned in to Munmorah in 1962, and a tee to Tuggerah added in 1986 at Sterland¹. This RIT-T is being undertaken to address environmental and safety risks on a portion of this original section of Line 21 – between the Tuggerah cut-in and Sydney North substation. This section of the line is comprised of 113 steel towers and spans approximately 51 km.

Line 21 is a key link between the Central Coast and Sydney metropolitan area and will continue to play a central role in supporting the flow of energy to take advantage of naturally-diverse weather patterns, and in the safe and reliable operation of the power system throughout and after the transition to a low-carbon electricity future.

The transmission line mainly traverses semi-urban and forested areas.

Condition issues that will impact the safe and reliable operation of the network have been found on the line. These raise a number of risks associated with asset failure, including safety and environmental (bushfire) risks.

Table 1 Condition issues along Line 21 and their consequences

Issue	Consequences if not remediated
Corrosion of tower steel members	Steel corrosion, particularly of critical members, can lead to structural failure of tower Delaying these works can result in refurbishment being less effective or no longer being possible. Resulting in increased lifetime management costs or the need to build an entire new structure.
Corroded fasteners	Structural failure
Corroded insulators and conductor attachment fittings	Conductor drop
Corrosion of earth wire and earthwire attachment fittings	Public safety risk increase in case of fault
Corroded earth straps	Increased step/touch potentials – electric shock Decreased line reliability during lightning
Conductor and earthwire vibration dampers	Accelerated conductor fatigue due to vibration
Condition of conductor spacers	Damaged spacers can lead to conductor clashing
Buried legs and ground level steel corrosion (Includes grillage)	Foundation failure
Corroded tower ladders	Failure whilst climbing, worker injury.

¹ Location of Tuggerah cut-in at Palm Cove

Issue	Consequences if not remediated
Climbing deterrent condition	Increased exposure to unauthorised climbing
Asbestos paint	Worker or public exposure to hazardous substance.

As the asset condition deteriorates over time, the likelihood of failure and subsequent risks will increase should these issues not be addressed.

Identified need: managing safety and environmental risks from corrosion on Line 21

The proposed investment will enable Transgrid to manage safety and environmental risks on Line 21. Options considered under this RIT-T have been assessed relative to a base case. Under the base case, no proactive capital investment is made and the condition of Line 21 will continue to deteriorate.

Further deterioration of the condition of the affected assets due to corrosion would mean an increase in bushfire and safety risks along Line 21 as the likelihood of failure increases. If left untreated, corrosion of some of the vital components of the steel towers could result in incidents such as conductor drop and tower collapse. Such incidents could have serious safety consequences for nearby residents and members of the public, as well as Transgrid field crew members who may be working on or near the assets.

Transgrid manages and mitigates bushfire and safety risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS).²

The proposed investment will enable Transgrid to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP. Consequently, it is considered a reliability corrective action under the RIT-T. A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

No submissions received in response to Project Specification Consultation Report

Transgrid published a Project Specification Consultation Report (PSCR) on 26 July 2021 and invited written submissions on the material presented within the document. No submissions were received in response to the PSCR.

No material developments since publication of the PSCR

No additional credible options were identified during the consultation period following publication of the PSCR.

The following changes have occurred since the PSCR which have not made an impact on the preferred option:

- the cost estimate for Option 1 has been adjusted to reflect the latest estimated resource requirements. This resulted in a decrease to the total cost estimate from \$19.6m to \$16.7m, and

² Transgrid's ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following hierarchy of hazard mitigation approach

- adjusted phasing of risk cost benefits to align with the Option 1 commissioning timeframe.

Option 1 remains the preferred option at this stage of the RIT-T process.

Transgrid considers refurbishing Line 21 is the only credible option

Transgrid put forward for consideration one technically and commercially feasible option³: refurbishing the existing line by remediating or replacing the identified components. This option (Option 1) involves the refurbishment of Line 21 including replacement of asset components, earthwire, remediation of steelwork and foundations.

The primary driver for the identified need is to mitigate bushfire and safety risks associated with condition issues on Line 21 caused by corrosion. Two other options to address the need were considered but were not progressed further as they were determined technically or commercially non-feasible when assessed against the preferred option. These are summarised in the following table.

Transgrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs and timing associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2021/22 dollars.

Table 2 Options considered

Option	Description	Capital costs (\$m 2021/22)	Operating costs (\$ per year)	Remarks
Option 1	Line refurbishment	16.7 (+/- 25%)	41,000	Most economical and preferred option
Option 2	Line dismantling	~ 19.2	0	Not progressed due to technical infeasibility. Dismantling Line 21 will reduce the supply capability from the Northern NSW network to Greater Sydney and Tuggerah significantly, which may lead to reliability of supply issues.
Option 3	New transmission line from Tuggerah cut-in to Sydney North substation	> 150	Not considered	Due to significant costs of this option, a new 330 kV transmission line from Tuggerah cut-in to Sydney North substation is not commercially feasible.

³ As per clause 5.15.2(a) of the NER.

Non-network options are not able to assist in this RIT-T

Transgrid does not consider non-network options to be commercially and technically feasible to assist with meeting the identified need for this RIT-T, as non-network options will not mitigate the safety and environment risk posed as a result of corrosion-related asset deterioration.

Conclusion: refurbishment of Line 21 is optimal

The optimal commercially and technically feasible option presented in this PACR – Option 1 (line refurbishment) – is the preferred option to meet the identified need.

Moving forward with this option is the most prudent and economically efficient solution to manage and mitigate safety and environmental risk to ALARP. Consequently, it will ensure Transgrid's obligations under the New South Wales Electricity Supply (Safety and Network Management) Regulation 2014 and Transgrid's Electricity Network Safety Management System (ENSMS) are met.

The estimated capital expenditure associated with this option is \$16.7 million +/- 25 per cent. Routine operating and maintenance costs relating to planned checks by Transgrid field crew are approximately \$41,000 per year – similar to the cost under the base case. Transgrid calculates that the avoided risk cost by undertaking Option 1 is approximately \$27.3 million per year.

This preferred option, Option 1, is found to have positive net benefits under all scenarios investigated and on a weighted basis will deliver \$307 million in net economic benefits. Transgrid also conducted sensitivity analysis on the net economic benefit to investigate the robustness of the conclusion to key assumptions. Transgrid finds that under all sensitivities, positive net benefits are expected from refurbishing Line 21.

The works will be undertaken between 2020/21 and 2022/23. Planning and procurement (including completion of the RIT-T) commenced in 2020/21 and is due to conclude in 2021/22, while project delivery and construction will occur in 2022/23.

All works will be completed in accordance with the relevant standards by 2022/23 with minimal modification to the wider transmission assets. Necessary outages of affected line(s) in service will be planned appropriately in order to complete the works with minimal impact on the network.

The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T. Option 1 is the preferred option in accordance with NER clause 5.16.1(b) because it is the credible option that maximises the net present value of the net economic benefit to all those who produce, consume and transport electricity in the market. This preferred option, Option 1, was found to have the highest net economic benefit or least lifecycle cost while also maintaining compliance with regulatory and safety obligations. Transgrid also conducted sensitivity analysis on the net economic benefit to investigate the robustness of the conclusion to key assumptions. Transgrid finds that under all sensitivities, Option 1 delivers the most net benefit.

Next steps

This PACR represents the third and final step of the consultation process in relation to the application of the Regulatory Investment Test for Transmission (RIT-T) process undertaken by Transgrid. It follows a Project Specification Consultation Report (PSCR) released in July 2021. No submissions were received in response to the PSCR.

The second step, production of a Project Assessment Draft Report (PADR), was not required as Transgrid considers its investment in relation to the preferred option to be exempt from that part of the RIT-T process under NER clause 5.16.4(z1). Production of a PADR is not required⁴ due to:

- the estimated capital cost of the proposed preferred option being less than \$43 million;
- the PSCR stating:
 - the proposed preferred option (including reasons for the proposed preferred option)
 - the RIT-T is exempt from producing a PADR
 - the proposed preferred option and any other credible option will not have material market benefits⁵ except for voluntary load curtailment and involuntary load shedding
- the RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and
- the PACR addressing any issues raised in relation to the proposed preferred option during the PSCR consultation.

Parties wishing to raise a dispute notice with the AER may do so prior to 12 January 2022 (30 days after publication of this PACR⁶). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from Transgrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Line 21 PACR'.


To read the full Project Assessment Conclusions Report visit [Transgrid's website](#).

⁴ In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if Transgrid considers that an additional credible option that could deliver a material market benefit is identified during the consultation period. No additional credible options were identified.

⁵ As per clause 5.16.1(c)(6)

⁶ Additional days have been added to cover public holidays

Figure 1 This PACR is the first stage of the RIT-T process⁷

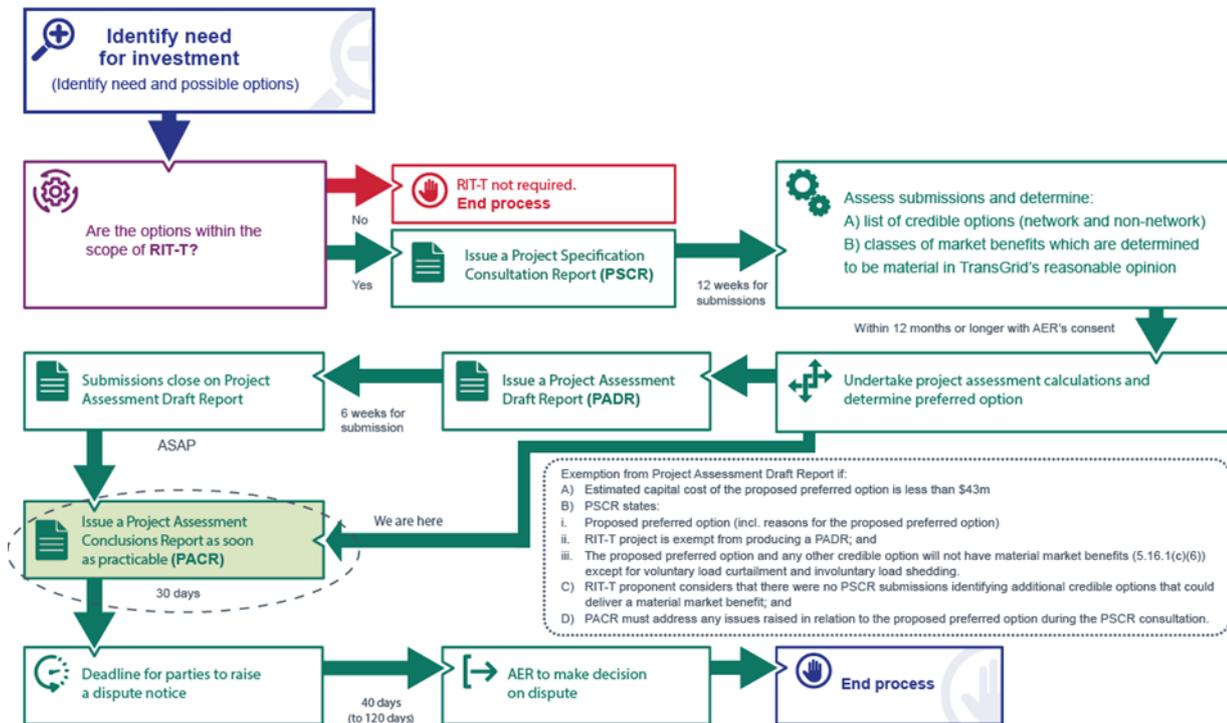

⁷ Australian Energy Market Commission. "Replacement expenditure planning arrangements, Rule determination". Sydney: AEMC, 18 July 2017.65. Accessed 14 May 2020. <https://www.aemc.gov.au/sites/default/files/content/89fbf559-2275-4672-b6ef-c2574eb7ce05/Final-rule-determination.pdf>